

# DAC INTERNATIONAL

# Inline filters NF up to 3500 l/min, up to 25 bar





### 1. TECHNICAL **SPECIFICATIONS**

### 1.1 FILTER HOUSING Construction

The filter housings are designed in accordance with international regulations. They consist of a filter housing and a threaded cover plate. Standard equipment:

- bypass valve
- port for clogging indicator

### 1.2 FILTER ELEMENTS

HYDAC filter elements are validated and their quality is constantly monitored according to the following standards:

- ISO 2941
- ISO 2942
- ISO 2943
- ISO 3724 ● ISO 3968
- ISO 11170
- ISO 16889

### Number of filter elements

NF	Elements	
160	1x0160 R	
240	1x0240 R	
280	1x0280 R	
330	1x0330 R	
500	1x0500 R	
750	1x0750 R	
950	1x0950 R	
13xx	1x1300 R	
26xx	1x2600 R	
5240	2x2600 R	
7840	3x2600 R	
10440	4x2600 R	

Filter elements are available with the following pressure stability values:

20 bar
10 bar
20 bar
30 bar
10 bar
10 bar
10 bar
10 bar

### 1.3 FILTER SPECIFICATIONS

NI 1 I	05.1
Nominal pressure	25 bar
Max. operating pressure	30 bar at max. 10 <sup>6</sup> cycles
Temperature range	-10 °C to +100 °C
Material of filter head	Aluminium
Material of tube (housing)	Steel up to NF 750
	Aluminium for NF 950 and above
Material of cover plate	Aluminium
Type of clogging indicator	VM (differential pressure measurement)
Pressure setting of clogging indicator	2 bar (others on request)
Bypass cracking pressure	3 bar (others on request)

### 1.4 SEALS

NBR (=Perbunan)

## 1.5 MOUNTING

Inline filter

### 1.6 SPECIAL MODELS AND **ACCESSORIES**

- Mounting bracket for NF 1310, 1340, 2610, 2640
- Mounting flange for NF 1340/2640
- Filling connection for NF 330, 500, 750, 950, 1350, 2650 on the contaminated side
- Foot bracket option for NF 160-750, 950, 1350, 2650
- Quick release coupling on the filling connection for NF 160, 240, 280
- Check valve on the clean side for NF 160, 240, 280
- For applications up to 40 bar, please make separate request! (only for NF 950, 1350, 2650)
- NF filter as tank-top return line filter (type code 1.x) and as inline filter (horizontal inlet flange at top, outlet vertical;(type code 3.x) on request

### 1.7 SPARE PARTS

See Original Spare Parts List


### 1.8 CERTIFICATES AND APPROVALS On request


### 1.9 COMPATIBILITY WITH **HYDRAULIC FLUIDS ISO 2943**

- Hydraulic oils H to HLPD DIN 51524
- Lubrication oils DIN 51517, API, ACEA, DIN 51515, ISO 6743
- Compressor oils DIN 51506
- Biodegradable operating fluids VDMA 24568 HETG, HEES, HEPG
- Fire-resistant fluids HFA, HFB, HFC and HFD
- Operating fluids with high water content (>50% water content) on request

### 1.10 IMPORTANT INFORMATION

- Filter housings must be earthed.
- When using visual clogging indicators, the BM version (visual with manual reset) only should be used.
- When using electrical clogging indicators, the electrical power supply to the system must be switched off before removing the clogging indicator connector.






VA = clogging indicator


E 7.112.7/11.16



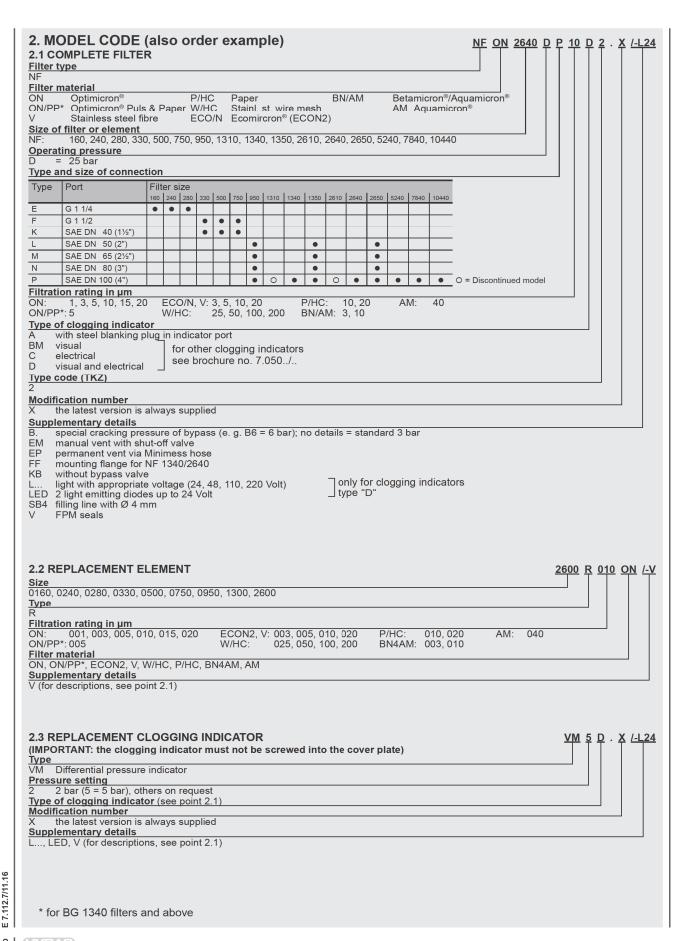



### 2.4 INLINE FILTER - INDIVIDUAL SHUT-OFF CAPABILITY





### **TECHNICAL DESCRIPTION**

The NF n+1 filter series has been developed in line with the classic NF filters. It features a ball change-over valve from HYDAC Filtertechnik GmbH and offers a cost-efficient and space saving alternative to the classic, fully duplex version of the NF series. In comparison to the previous butterfly change-over valve with 16 bar operating pressure, the new HYDAC ball change-over valve is rated to the higher operating pressure of 25 bar. Since each filter tower can be shut off individually using the ball change-over valve, the filters can be changed while the system is running, guaranteeing 24 hour operation.

Flow rate: 500–4000 l/min Nom. pressure: up to 25 bar

Size: 5240, 7840, 10440 (others on request)

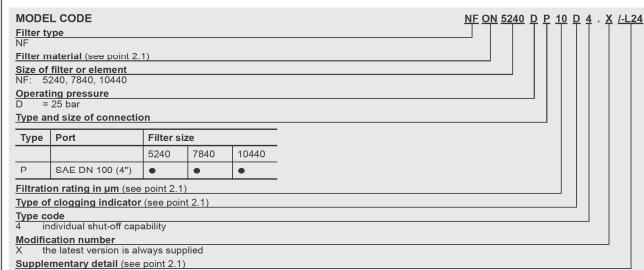

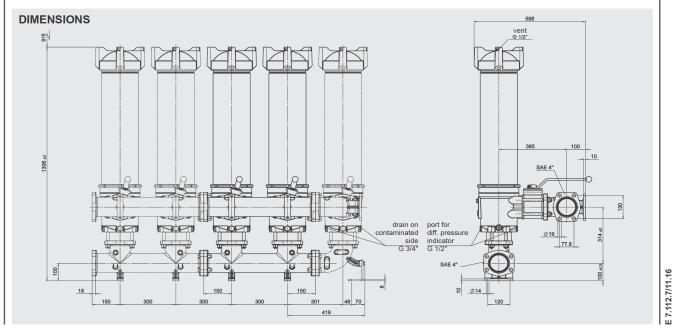

HYDAC 3



# 3. FILTER CALCULATION / SIZING

The total pressure drop of a filter at a certain flow rate Q is the sum of the housing  $\Delta p$  and the element  $\Delta p$  and is calculated as follows:


$$\begin{array}{ll} \Delta p_{\text{total}} &= \Delta p_{\text{nousing}} + \Delta p_{\text{element}} \\ \Delta p_{\text{housing}} &= (\text{see Point 3.1}) \\ \Delta p_{\text{element}} &= Q \bullet \frac{\text{SK*}}{1000} \bullet \frac{\text{viscosity}}{30} \\ &\quad (\text{*see point 3.2}) \end{array}$$


For ease of calculation, our Filter Sizing Program is available on request free of charge.


**NEW:** Sizing online at <u>www.hydac.com</u>


# 3.1 $\Delta p$ -Q HOUSING CURVES BASED ON ISO 3968


The housing curves apply to mineral oil with a density of 0.86 kg/dm³ and a kinematic viscosity of 30 mm²/s. In this case, the differential pressure changes proportionally to the density.
















### 3.2 GRADIENT COEFFICIENTS (SK) FOR FILTER ELEMENTS

The gradient coefficients in mbar/(l/min) apply to mineral oils with a kinematic viscosity of 30 mm²/s. The pressure drop changes proportionally to the change in viscosity.


NF	ON						ON/PP
	1 µm	3 µm	5 µm	10 μm	15 µm	20 µm	5 μm
160	16.0	8.00	5.68	3.22	2.69	2.32	_
240	10.4	5.18	3.66	2.27	1.84	1.41	-
280	5.10	2.57	2.08	1.43	1.06	0.80	-
330	8.09	3.72	2.73	1.48	1.28	1.02	_
500	5.27	2.60	1.90	1.09	0.84	0.69	-
750	2.11	1.12	0.92	0.53	0.34	0.32	_
950	2.39	1.03	0.79	0.48	0.38	0.31	-
1300	1.72	0.72	0.59	0.35	0.32	0.22	1.00
2600	0.84	0.36	0.29	0.18	0.16	0.11	0.45

NF	V				W/HC	ECON2			
	3 µm	5 µm	10 µm	20 µm	_	3 µm	5 μm	10 µm	20 µm
160	4.9	3.5	2.4	1.5	0.193	9.5	5.9	3.8	2.9
240	3.2	2.6	1.7	1.2	0.123	6.2	3.8	2.6	1.8
280	1.4	1.1	0.7	0.5	0.017	3.1	2.2	1.6	1.0
330	2.1	1.7	1.1	0.8	0.195	4.2	2.7	1.7	1.2
500	1.5	1.2	0.8	0.5	0.128	3.0	1.9	1.3	0.8
750	0.6	0.5	0.3	0.2	0.049	1.3	0.9	0.6	0.4
950	0.7	0.6	0.4	0.2	0.048	1.2	0.8	0.5	0.4
1300	0.5	0.4	0.3	0.2	0.034	0.8	0.6	0.4	0.3
2600	0.3	0.2	0.1	0.1	0.017	0.4	0.3	0.2	0.1

E 7.112.7/11.16

HYDAD | 5



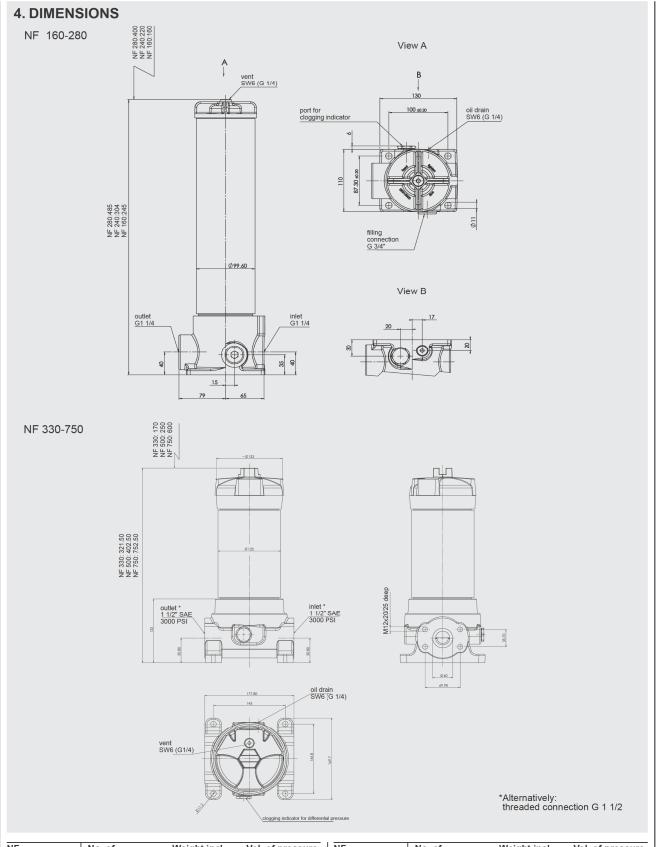


	NF	No. of elements	Weight incl. element [kg]	Vol. of pressure chamber [I]
il	160	1x0160 R	4.5	0.8
1	240	1x0240 R	5.6	1.1
	280	1x0280 R	9.1	2.1

NF	No. of elements	Weight incl. element [kg]	Vol. of pressure chamber [l]
330	1x0330 R	7.8	2.05
500	1x0500 R	9.0	2.80
750	1x0750 R	14.1	6.08


6 HYDAC

E 7.112.7/11.16



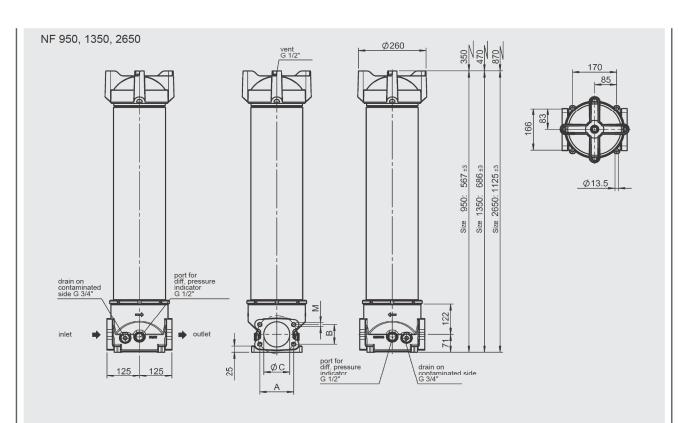

NF 1310/2610 ... 2.X (on request)

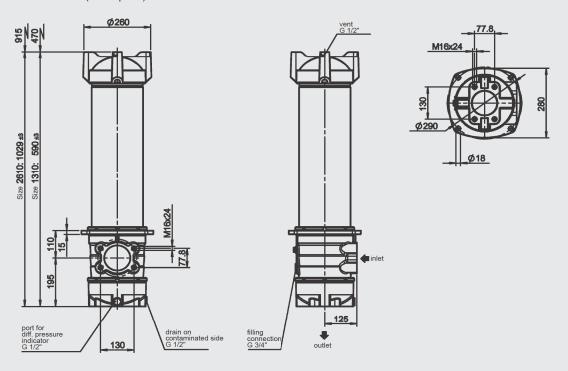

Port	Α	В	ØС	M	
SAE DN 50 (2")	77.8	42.9	50	M12x15	_
SAE DN 65 (2½")	88.9	50.8	65	M12x15	
SAE DN 80 (3")	106.4	62.9	75	M16x24	_
SAE DN 100 (4")	130.2	77.8	100	M16	

NF	No. of elements	Weight incl. element [kg]	Vol. of pressure chamber [I]
13102.X	1x1300 R	17	14


NF	No. of elements	Weight incl. element [kg]	Vol. of pressure chamber [l]
950	1x0950 R	16	10
1350	1x1300 R	18	13
2650	1x2600 R	25	25


NF	No. of elements	Weight incl. element [kg]	Vol. of pressure chamber [I]
26102.X	1x2600 R	23	25

HYDAC 7





NF 1340/2640 ... 2.X/-FF






NF 5240 ... 2.X






480

249.5



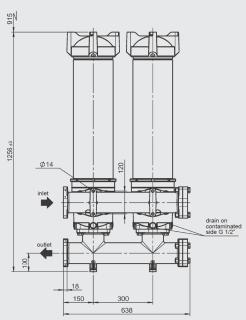

drain on contaminated side G 1/2"	
110	

No. of elements	Weight incl. element [kg]	Vol. of pressure chamber [I]
1x2600 R	23	25
	No. of elements	No. of Weight incl. elements element [kg]


	No. of elements	Weight incl. element [kg]	Vol. of pressure chamber [I]
13402.X	1x1300 R	17	14

NF	No. of elements	Weight incl. element [kg]	Vol. of pressure chamber [I]
52402.X	2x2600 R	90	60

8 HYDAC

E 7.112.7/11.16



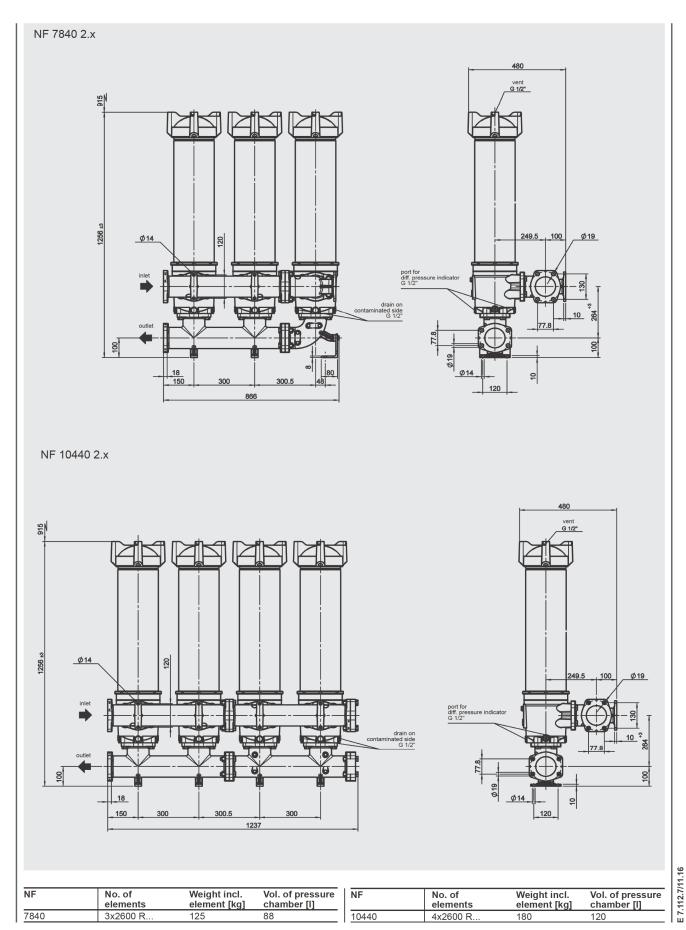



# **NOTES**

### **NOTE**

The information in this brochure relates to the operating conditions and applications described.

For applications or operating conditions not described, please contact the relevant technical department.

Subject to technical modifications.

10 | HYDAC