



## Tank breathing filters

Type TLF I 1-25 to 8-250; TLF II 1-25 to 6-80;  
TLF III 1-25 to 7-125

**RD 51415**  
Edition: 2021-04  
Replace: -



- Size according to Hengst standard:  
1 - 25 to 8-250
- Connection G1 to DN250
- Operating temperature -40 °C to +100 °C [-40 °F to 212 °F]

### Features

The breathing filters are used in hydraulic systems for breathing and bleeding air from the hydraulic tank. They are mounted directly on the tank.

They distinguish themselves by the following:

- Highly efficient, special filter material
- Filtration of ultra-fine particles and high dirt holding capacity
- Use of Aquasorb filter material minimizes the risk of corrosion in the hydraulic tank
- Standard filling strainer in version TLF III
- Replaceable filter element

### Contents

Features	1
Ordering code filter	2, 3
Preferred types	4
Symbol	4
Function, section	5
Technical data	6
Compatibility with permitted hydraulic fluids	6
Characteristic curves	7
Dimensions	8 ... 11
Ordering code spare parts	12
Assembly, commissioning, maintenance	13
Tightening torques	14
Directives and standardization	14

RE 51415, edition: 2021-04, Hengst Filtration GmbH

Knowledge is POWER – Motion Force Control is our Business

HYQUIP Limited New Brunswick Street Horwich Bolton Lancashire BL6 7JB UK

2/14 TLF I 1-25 ... 8-250; TLF II 1-25 ... 6-80; TLF III 1-25 ... 7-125 | Tank breathing filters

## Ordering code filter

### Size 1-25 to 6-80

01	02	03	04	05	06	07	08	09	10	11	12			
TLF				-	S00	-	0	0	0	-	00		0	0

### Series

01	Tank breathing filters	TLF
----	------------------------	-----

### Connection

02	Internal thread	I
	Male thread	II
	Male thread and filling strainer	III

### Size

03	TLF ...	1-25 2-32 3-40 4-50 5-65 6-80
----	---------	--

### Filter rating in µm

04	Glass fiber material, not cleanable	Air retention, ASHRAE 52.1, test dust SAE fine: 95% for particles > 0.3 µm	H10XL
	Nominal		
	Filter paper, not cleanable	Air retention, ASHRAE 52.1, test dust SAE fine: 95% for particles > 1.24 µm	P10

### Pressure difference

05	Max. admissible pressure differential of the filter element of 1 bar [14.5 psi]	S00
----	---	-----

### Solenoid

06	Without solenoid	0
----	------------------	---

### Valve

07	Without valve	0
----	---------------	---

### Maintenance indicator

08	Without maintenance indicator	0
----	-------------------------------	---

### Connection

09	Frame size	1-25	2-32	3-40	4-50	5-65	6-80	00
	Connection	G1	G1 1/4	G1 1/2	G2	G2 1/2	G3	

### Seal

10	NBR seal	M
	FKM seal	V

### Material

11	Standard	0
----	----------	---

### Supplementary information

12	Without supplementary information	0
----	-----------------------------------	---

### Order example:

TLF III 3-40 P10-S00-000-00M00

Material no. R928018862

Further versions are available on request.

Hengst Filtration GmbH, RE 51415, edition: 2021-04

Knowledge is POWER – Motion Force Control is our Business

HYQUIP Limited New Brunswick Street Horwich Bolton Lancashire BL6 7JB UK

## Ordering code filter

### Size 7-125 to 8-250

01	02	03	04	05	06	07	08	09	10	11	12			
TLF				-	S00	-	0	0	0	-	00		0	0

### Series

01	Tank breathing filters	TLF
----	------------------------	-----

### Connection

02	DIN flange	I
	DIN-flange and filling strainer	III

### Size

03	TLF I; TLF III	7-125
	TLF I	8-250

### Filter rating in µm

04	Glass fiber material, not cleanable	Air retention, ASHRAE 52.1, test dust SAE fine: 95% for particles > 0.3 µm	H10XL
	<b>Nominal</b>		
	Filter paper, not cleanable	Air retention, ASHRAE 52.1, test dust SAE fine: 95% for particles > 1.24 µm	P10

### Pressure difference

05	Max. admissible pressure differential of the filter element of 1 bar [14.5 psi]	S00
----	---	-----

### Solenoid

06	Without solenoid	0
----	------------------	---

### Valve

07	Without valve	0
----	---------------	---

### Maintenance indicator

08	Without maintenance indicator	0
----	-------------------------------	---

### Connection

09	Frame size	7-125	8-250	00
	Connection	DIN 2573 DN125	DIN 2573 DN250	

### Seal

10	NBR seal	M
	FKM seal	V

### Material

11	Standard	0
----	----------	---

### Supplementary information

12	Without supplementary information	0
----	-----------------------------------	---

### Order example:

TLF I 8-250 P10-S00-000-00M00

Material no. R928018835

Further versions are available on request.

4/14 TLF I 1-25 ... 8-250; TLF II 1-25 ... 6-80; TLF III 1-25 ... 7-125 | Tank breathing filters

## Preferred types

Tank breathing filters TLF I, filter rating **paper 10 µm**

Type	Material no. Filter	Material no. Replacement element
TLF I 1-25 P10-S00-000-00M00	R928018814	R928039681
TLF I 2-32 P10-S00-000-00M00	R928018817	R928039681
TLF I 3-40 P10-S00-000-00M00	R928018820	R928016621
TLF I 4-50 P10-S00-000-00M00	R928040890	R928016621
TLF I 5-65 P10-S00-000-00M00	R928018826	R928016621
TLF I 6-80 P10-S00-000-00M00	R928018829	R928016624
TLF I 7-125 P10-S00-000-00M00	R928018832	R928016627
TLF I 8-250 P10-S00-000-00M00	R928018835	R928016630

Tank breathing filters TLF II, filter rating **paper 10 µm**


Type	Material no. Filter	Material no. Replacement element
TLF II 1-25 P10-S00-000-00M00	R928018838	R928039681
TLF II 2-32 P10-S00-000-00M00	R928018841	R928039681
TLF II 3-40 P10-S00-000-00M00	R928040622	R928016621
TLF II 4-50 P10-S00-000-00M00	R928018847	R928016621
TLF II 5-65 P10-S00-000-00M00	R928018850	R928016621
TLF II 6-80 P10-S00-000-00M00	R928018853	R928016624

Tank breathing filters TLF III, filter rating **paper 10 µm**

Type	Material no. Filter	Material no. Replacement element
TLF III 1-25 P10-S00-000-00M00	R928018856	R928039681
TLF III 2-32 P10-S00-000-00M00	R928018859	R928039681
TLF III 3-40 P10-S00-000-00M00	R928018862	R928016621
TLF III 4-50 P10-S00-000-00M00	R928018865	R928016621
TLF III 5-65 P10-S00-000-00M00	R928018868	R928016621
TLF III 6-80 P10-S00-000-00M00	R928018871	R928016624
TLF III 7-125 P10-S00-000-00M00	R928028258	R928016627

## Symbol

Tank breathing filters



Hengst Filtration GmbH, RE 51415, edition: 2021-04

Knowledge is POWER – Motion Force Control is our Business

HYQUIP Limited New Brunswick Street Horwich Bolton Lancashire BL6 7JB UK

## Function, section

The tank breathing filter guarantees air exchange in the fluid tank. Depending on the machine cycles, air can be pulled into the tank with contamination when a breather filter is not used. A tank breather filter will accomplish both the pressure equalization and air filtration preventing contamination from entering the tank through the air exchange. It basically consists of a threaded cover (1), a filter element (2) and a bottom housing (3) to accommodate the filter element.

The contaminated air is transported through the filter element into the hydraulic tank (T) via the opening (A). Only filtered air enters the tank. Escaping air is also directed through the filter element.

### Version TLF I 1-25 to 8-250

Sizes 1-25 to 6-80 have an internal thread, sizes 7-125 and 8-250 have a flange.

### Version TLF II 1-25 to 6-80

All sizes have a male thread.



### Design TLF III 1-25 to 7-125

Sizes 1-25 to 6-80 have a male thread, sizes 7-125 and 8-250 have a flange.

Version III also has a 130 µm filling strainer (4).

When air humidity is high or when there are large temperature variations, the exchanged air may condense and promote the oxidation process of the oil. This leads to corrosion and damage to the fluid tank.

In this case, we recommend use of our "AS10" water-absorbent filter material to dry the incoming air.

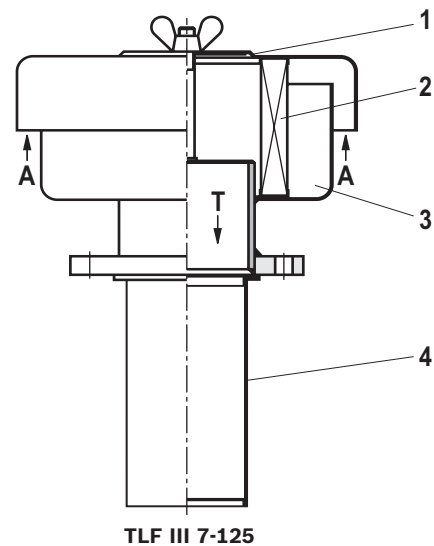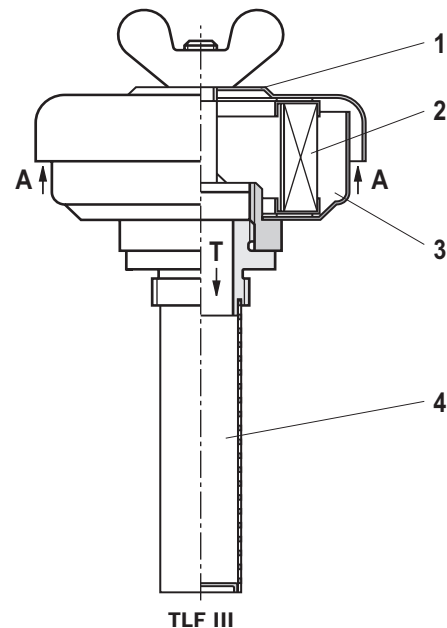

6/14 TLF I 1-25 ... 8-250; TLF II 1-25 ... 6-80; TLF III 1-25 ... 7-125 | Tank breathing filters

## Technical data

(For applications outside these parameters, please consult us!)

General										
Installation position			Tank structure							
Operating temperature			°C [°F]	-40 °C ... +100 °C [-40 °F ... 212 °F]						
Ambient temperature range			°C [°F]	-40 ... +65 [-40 ... +149]						
Storage conditions	► NBR seal		°C [°F]	-40 ... +65 [-40 ... +149]; max. relative air humidity of 65%						
	► FKM seal		°C [°F]	-20 ... +65 [-4 ... +149]; max. relative air humidity of 65%						
Weight				TLF I 1-25	TLF I 2-32	TLF I 3-40	TLF I 4-50	TLF I 5-65	TLF I 6-80	TLF I 7-125
	Size									
	kg		0.5	0.6	2.0	1.6	1.5	2.4	11.4	
	[lbs]		[1.1]	[1.3]	[4.4]	[3.5]	[3.3]	[5.3]	[25.1]	
	Size			TLF I 8-250	TLF II 1-25	TLF II 2-32	TLF II 3-40	TLF II 4-50	TLF II 5-65	TLF II 6-80
	kg		51.0	0.6	0.7	2.3	1.7	1.8	2.7	
	[lbs]		[112.4]	[1.3]	[1.5]	[5.1]	[3.8]	[4.0]	[6.0]	
	Size			TLF III 1-25	TLF III 2-32	TLF III 3-40	TLF III 4-50	TLF III 5-65	TLF III 6-80	TLF III 7-125
	kg		0.7	0.8	2.4	1.8	1.6	2.5	11.6	
	[lbs]		[1.5]	[1.8]	[5.3]	[4.0]	[3.5]	[5.5]	[25.6]	
Material	► Filter cover		Polyamide (sizes 1-25 and 2-32), tin-coated steel (NG 3-40 to 8-250)							
	► Lower filter part		Tin-coated steel (version I), aluminum / tin-coated steel (versions II and III)							
	► Filling strainer		Stainless steel / aluminum							
	► Seals		NBR or FKM							

## Compatibility with permitted hydraulic fluids

### TLF II, TLF III 1-25 to 7-125

Hydraulic fluid	Classification	Suitable sealing materials	Standards
Mineral oil	HLP	NBR	DIN 51524

Other fluids upon request

### TLF I

Hydraulic fluid	Classification	Suitable sealing materials	Standards
Mineral oil	HLP	NBR	DIN 51524
Bio-degradable	- insoluble in water	HETG	VDMA 24568
		HEES	
	- soluble in water	HEPG	VDMA 24568
Flame-resistant	- water-free	HFDU, HFDR	VDMA 24317
	- containing water	HFAS	DIN 24320
		HFAE	
		HFC	VDMA 24317



#### Important information on hydraulic fluids:







- For more information and data on the use of other hydraulic fluids, please refer to data sheet 90220 or contact us.
- Flame-resistant - containing water: due to possible chemical reactions with materials or surface coatings of machine and system components, the service life with these hydraulic fluids may be less than expected.

Filter materials made of filter paper (cellulose) must not be used, filter elements with glass fiber material must be used instead.

- Bio-degradable: If filter materials made of filter paper are used, the filter life may be shorter than expected due to material incompatibility and swelling.

## Characteristic curves

(measured at test temperature = 20 °C [68 °F])

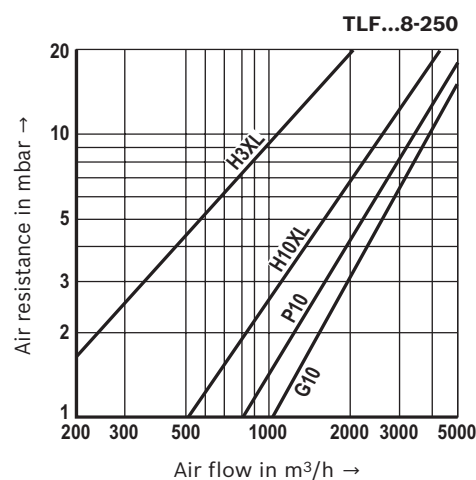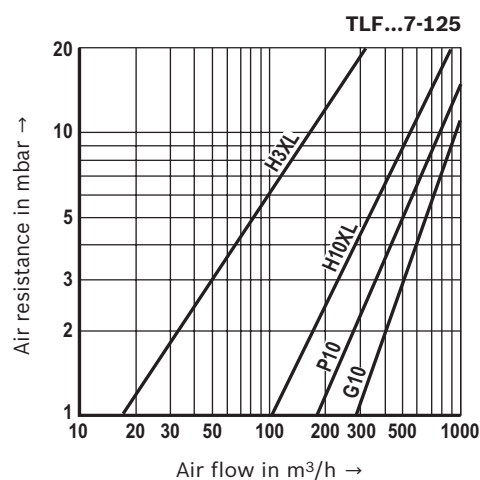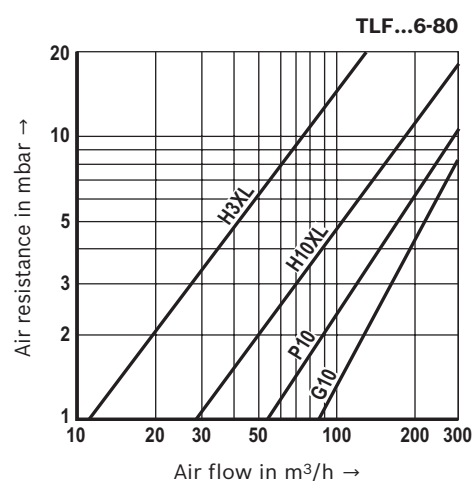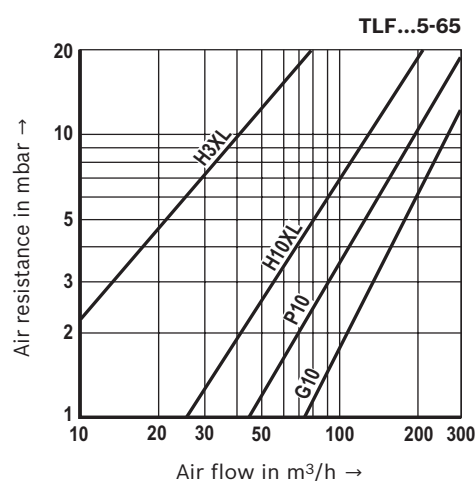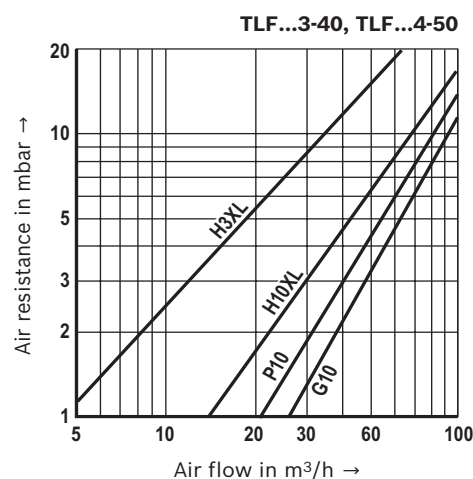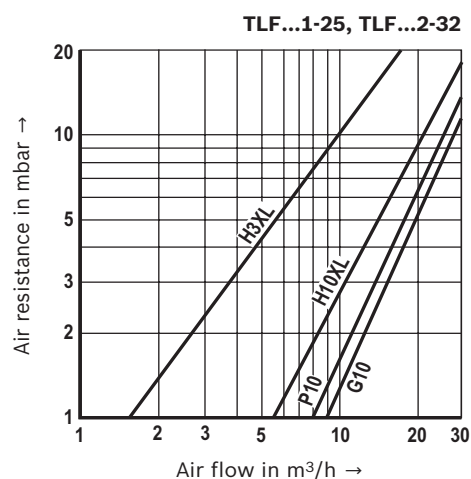


RE 51415, edition: 2021-04, Hengst Filtration GmbH

Knowledge is POWER – Motion Force Control is our Business

HYQUIP Limited New Brunswick Street Horwich Bolton Lancashire BL6 7JB UK

8/14 TLF I 1-25 ... 8-250; TLF II 1-25 ... 6-80; TLF III 1-25 ... 7-125 | Tank breathing filters

**Dimensions: TLF I; II; III size 1-25 to 6-80**  
(dimensions in mm [in])

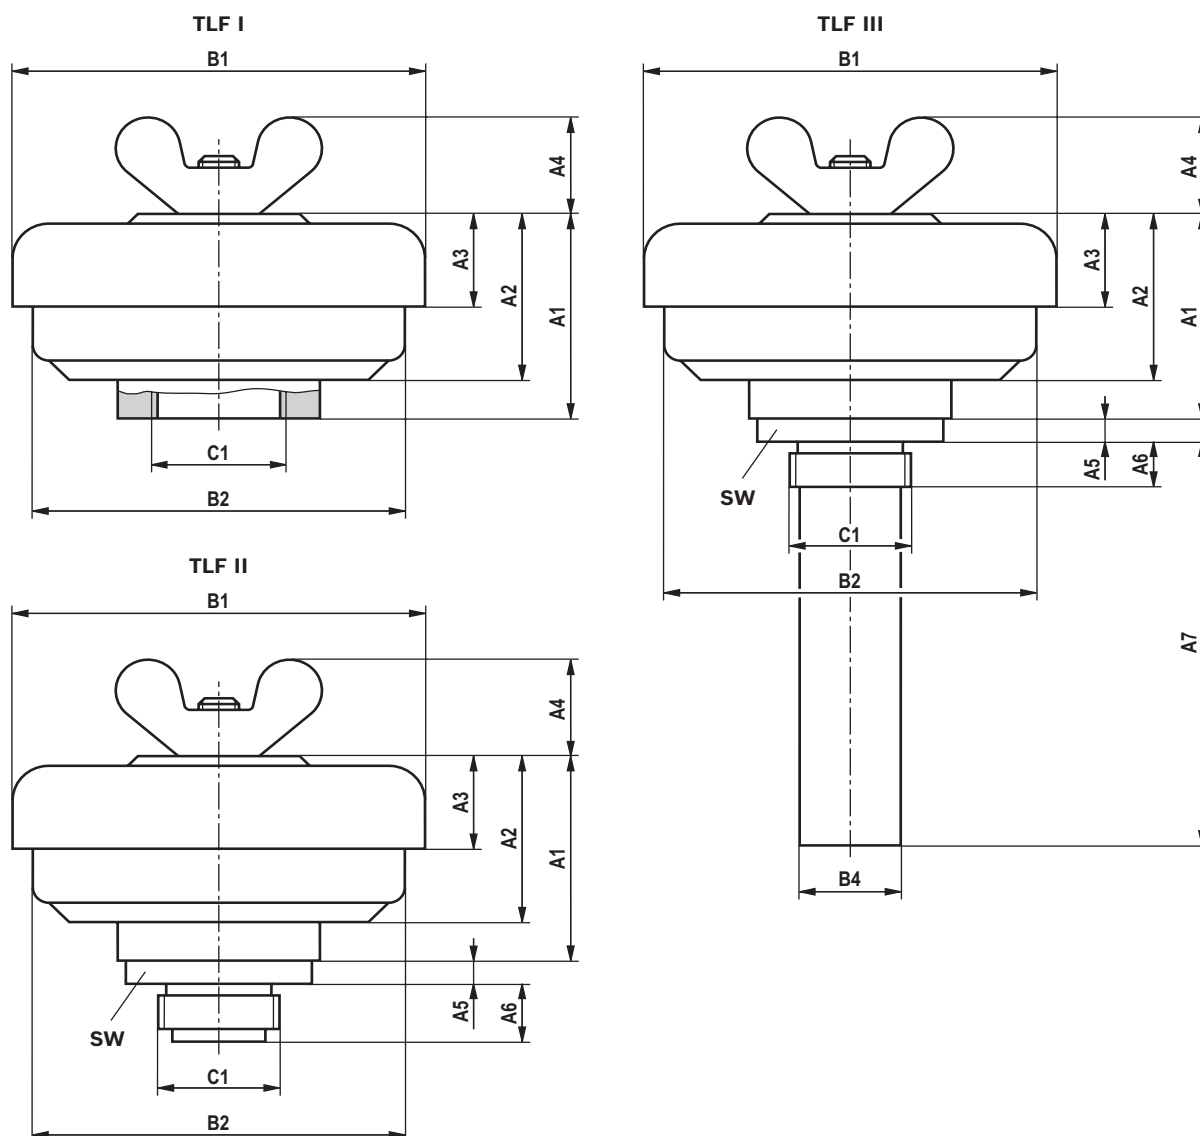

Hengst Filtration GmbH, RE 51415, edition: 2021-04

Knowledge is POWER – Motion Force Control is our Business

HYQUIP Limited New Brunswick Street Horwich Bolton Lancashire BL6 7JB UK




**Dimensions: TLF I; II; III size 1-25 to 6-80**  
(dimensions in mm [in])



Type	A1	A2	A3	A4	A5	A6	A7	Ø B1	Ø B2	Ø B3	Ø B4	C1	SW	
TLF I 1-25	53 [2.09]	43 [1.69]	24 [0.94]	25 [0.98]	–	–	–	104 [4.09]	92 [3.62]	–	–	G1	–	
TLF I 2-32	63 [2.48]							G1 1/4						
TLF I 3-40	90 [3.54]	80 [3.15]	46 [1.81]					177 [6.97]	162 [6.38]			G1 1/2		
TLF I 4-50								G2						
TLF I 5-65								G2 1/2						
TLF I 6-80	88 [3.46]	78 [3.07]	45 [1.77]					210 [8.27]	190 [7.48]			240 [9.45]		G3
TLF II 1-25	53 [2.09]	43 [1.69]	24 [0.94]	25 [0.98]	6 [0.24]	25 [0.98]	–	104 [4.09]	92 [3.62]	–	–	G1	46 [1.81]	
TLF II 2-32	63 [2.48]				G1 1/4	55 [2.17]								
TLF II 3-40	90 [3.54]	80 [3.15]	46 [1.81]		7 [0.28]	26 [1.02]		177 [6.97]	162 [6.38]			G1 1/2	60 [2.36]	
TLF II 4-50					G2	75 [2.95]								
TLF II 5-65					8 [0.31]	28 [1.10]						G 2 1/2	90 [3.54]	
TLF II 6-80	88 [3.46]	78 [3.07]	45 [1.77]		9 [0.35]	30 [1.18]						210 [8.27]	190 [7.48]	G3
TLF III 1-25	53 [2.09]	43 [1.69]	24 [0.94]	25 [0.98]	6 [0.24]	17 [0.67]	107 [4.21]	104 [4.09]	92 [3.62]	–	–	G1	46 [1.81]	
TLF III 2-32	63 [2.48]						131 [5.16]					G1 1/4	55 [2.17]	
TLF III 3-40	90 [3.54]	80 [3.15]	46 [1.81]		7 [0.28]	18 [0.71]	155 [6.10]	177 [6.97]	162 [6.38]			42 [1.65]	G1 1/2	60 [2.36]
TLF III 4-50					185 [7.28]	53 [2.09]	G2					75 [2.95]		
TLF III 5-65					8 [0.31]	20 [0.79]	217 [8.54]					67 [2.64]	G2 1/2	90 [3.54]
TLF III 6-80	88 [3.46]	78 [3.07]	45 [1.77]		9 [0.35]	22 [0.87]	254 [10.00]	210 [8.27]	190 [7.48]			82 [3.23]	G3	105 [4.13]

10/14 TLF I 1-25 ... 8-250; TLF II 1-25 ... 6-80; TLF III 1-25 ... 7-125 | Tank breathing filters


## Dimensions: TLF I 7-125, 8-250 (dimensions in mm [in])

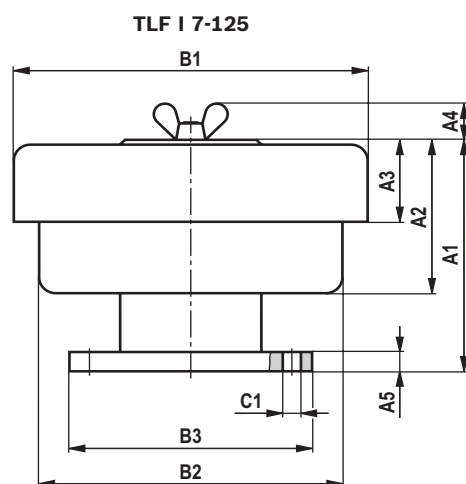

hole pattern

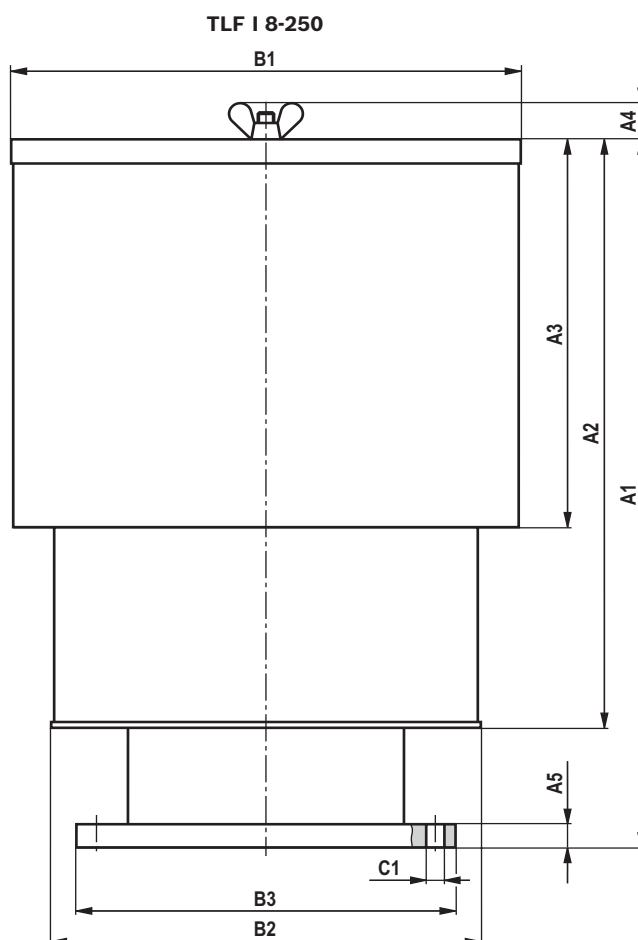

hole pattern

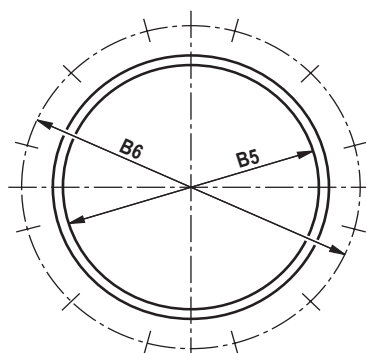


Type	A1	A2	A3	A4	A5	Ø B1	Ø B2	Ø B3	Ø B5	Ø B6	C1
TLF I 7-125	263 [10.35]	154 [6.06]	85 [3.35]	36 [1.42]	20 [0.79]	350 [13.78]	300 [11.81]	375 [14.76]	130 [5.12]	200 [7.87]	8x Ø 18 [8x Ø 0.71]
TLF I 8-250	734 [28.90]	620 [24.41]	402 [15.83]	37.5 [1.48]	24 [0.94]	502 [19.76]	419 [16.50]	—	253 [9.96]	335 [13.19]	12x Ø 18 [12x Ø 0.71]

Hengst Filtration GmbH, RE 51415, edition: 2021-04


Knowledge is POWER – Motion Force Control is our Business

HYQUIP Limited New Brunswick Street Horwich Bolton Lancashire BL6 7JB UK

Dimensions: TLF III 7-125  
(dimensions in mm [in])

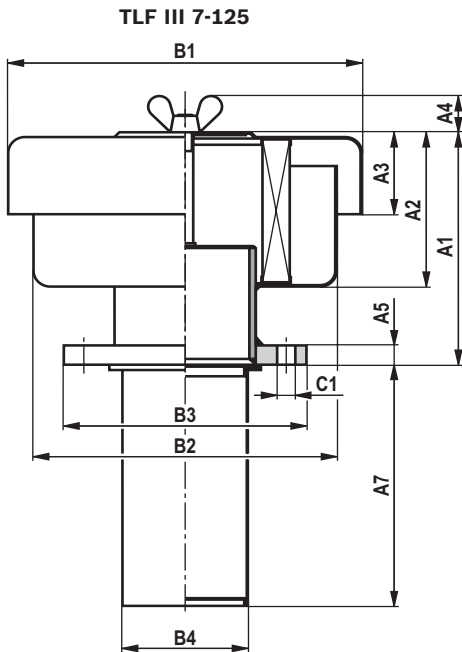

hole pattern



Type	A1	A2	A3	A4	A5	A7	Ø B1	Ø B2	Ø B3	Ø B4	Ø B5	Ø B6	C1
TFL III 7-125	263 [10.35]	154 [6.06]	85 [3.35]	36 [1.42]	20 [0.79]	250 [9.84]	350 [13.78]	300 [11.81]	240 [9.45]	124 [4.88]	130 [5.12]	200 [7.87]	8x Ø 18 [8x Ø 0.71]

12/14 TLF I 1-25 ... 8-250; TLF II 1-25 ... 6-80; TLF III 1-25 ... 7-125 | Tank breathing filters

## Ordering code spare parts

### Filter element

01	02	03	04	05	06
7.			- S00	- 0	-

### Filter element

01	Design	7.
----	--------	----

### Size

02	TLF ... 1-25; 2-32	002
	TLF ... 3-40; 4-50; 5-65	004
	TLF ... 6-80	006
	TLF I 7-125; TLF III 7-125	007
	TLF I 8-250	008

### Filter rating in µm

### Air retention, ASHRAE 52.1, test dust SAE fine

03	Glass fiber material, not cleanable	95% for particles > 0.3 µm	H10XL
	Nominal Filter paper, not cleanable	95% for particles > 1.24 µm	P10

### Pressure difference

04	Max. admissible pressure differential of the filter element of 1 bar [14.5 psi]	S00
----	---	-----

### Bypass valve

05	Without bypass valve	0
----	----------------------	---

### Seal

06	NBR seal	M
	FKM seal	V

### Order example:

**7.002 P10-S00-0-M**

**Material no.: R928039681**

For detailed information on Hengst filter elements please refer to data sheet 51420.

### Preferred program replacement elements

Filter element type	Filter material/material no. P10
7.002 P10-S00-0-M	R928039681
7.004 P10-S00-0-M	R928016621
7.006 P10-S00-0-M	R928016624
7.007 P10-S00-0-M	R928016627
7.008 P10-S00-0-M	

Hengst Filtration GmbH, RE 51415, edition: 2021-04

Knowledge is POWER – Motion Force Control is our Business

HYQUIP Limited New Brunswick Street Horwich Bolton Lancashire BL6 7JB UK

## Assembly, commissioning, maintenance

### Assembly

- ▶ The filter connection must correspond to the tank connection.
- ▶ If the size is TLF ... 7 or the TLF I 8 version is used (version with DIN flanges), the hole pattern (DIN 2573) of the tank must be compared to the dimensions from the "Dimensions" chapter prior to installation.
- ▶ Install the filter on the tank.
- ▶ When installing the filter, the required servicing height of the replacement filter must be taken into account.
- ▶ For servicing reasons, we recommend installing the filter in a vertical position.
- ▶ All filter components must be tightened manually.

### Commissioning

- ▶ It is not necessary to commission the filter.

### Maintenance

#### Exchange of the filter element

- ▶ No maintenance indicator is provided, but the filter element must be changed at minimum every 6 months.
- ▶ Since the ambient conditions are very different depending on the place of installation, we recommend considering more frequent replacement of the filter element according to the specific installation conditions for TLF tank breathing filters.



#### Notice:

Vacuum switch (upon request) for monitoring the suction pressure can be mounted on the tank separately.

### WARNING!

- ▶ The filter must not be operated without a filter element



#### Notes:

- ▶ All work on the filter must be performed by trained specialists.
- ▶ Proper function and safety are only guaranteed if original Hengst filter elements and spare parts are used.
- ▶ Warranty becomes void if the delivered item is changed by the ordering party or third parties or improperly mounted, installed, maintained, repaired, used or exposed to environmental condition that do not comply with the installation conditions.

14/14 TLF I 1-25 ... 8-250; TLF II 1-25 ... 6-80; TLF III 1-25 ... 7-125 | Tank breathing filters

## Tightening torques

Series		TLF I 1-25 -6-80	TLF II 1-25 -6-80 TLF III 1-25 -6-80	TLF I 7-125 and 8-250; TLF III 7-125
Breathing filter	Nm [lbf-ft]	Tighten by hand	Max. 20 [14.8]	80 ± 8 [59 ± 5.9]
Tightening torque with $\mu_{total} = 0.14$				
Wing nut		Tighten by hand		

## Directives and standardization

### Product validation

Hengst filters, the filter elements built into them and filter accessories are tested and quality-monitored according to different ISO test standards:

Filtration performance test (multipass test)	ISO 16889:2008-06
Compatibility with hydraulic fluid	ISO 2943:1998-11

The development, manufacture and assembly of Hengst industrial filters and Hengst filter elements is carried out within the framework of a certified quality management system in accordance with ISO 9001:2015.

### Classification according to the Pressure Equipment

#### Directive

Off-line tank breathing filters according to 51415 are not classified as devices or components for the purpose of the Pressure Equipment Directive 97/23/EC (PED).

#### Directive 94/9/EC (ATEX)

According to the assessment of the risk of ignition, the tank breathing filters must not be used in explosive areas.