


The Drive & Control Company

**Rexroth**  
 Bosch Group

Directional control valve, pilot-operated,  
 with integrated digital axis controller  
 (IAC-Multi-Ethernet)

Type 4WRLD

**RE 29289**  
 Edition: 2017-09  
 Replaces:  
 2016-05  
 and 29288

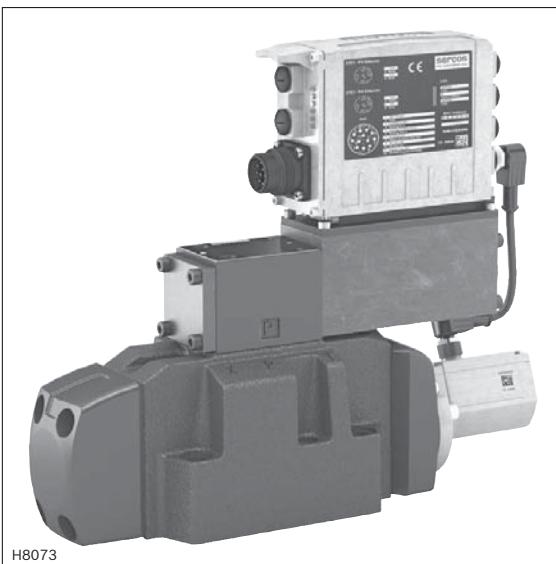

- ▶ Sizes 10 ... 35
- ▶ Component series 4X
- ▶ Maximum operating pressure of 350 bar (ports P, A, B)
- ▶ Rated flow 60 ... 1500 l/min ( $\Delta p = 10$  bar)



## Features

- ▶ Open
  - Integrated digital axis control functionality (IAC-Multi-Ethernet)
  - Bus connection/service interface (Sercos, EtherCAT, EtherNet/IP, PROFINET RT, POWERLINK, VARAN)
- ▶ Scalable
  - 2 configurable analog sensor inputs
  - 1 input for linear position measurement system (SSI, 1Vpp or EnDat 2.2)
- ▶ Precise
  - Best-in-class hydraulic controller
  - High response sensitivity and little hysteresis
- ▶ Safe
  - Internal safety function (can be used up to category 4/PL e according to EN 13849-1)
  - CE conformity according to EMC Directive 2014/30/EU

## Contents

Features	1
Ordering code	2, 3
Symbols	4
Function	5, 6
Pilot oil supply	7, 8
Technical data	8 ... 12
Representation of the axis controller in the system	
network	13
Block diagram/controller function block	14
Electrical connections, assignment	15, 16
LED displays	17
Characteristic curves	18 ... 30
Dimensions	31 ... 35
Accessories	36 ... 38
Project planning and maintenance instructions	38
Further information	39

2/40      **4WRLD** | Directional control valve

### Ordering code

01	02	03	04	05	06	07	08	09	10	11	12	13	14	15	16
<b>4</b>	<b>WRL</b>	<b>D</b>						<b>- 4X /</b>			<b>/ 24</b>		<b>D6</b>		*

01	4 main ports	4
02	Directional control valve, pilot-operated	<b>WRL</b>
03	With integrated digital axis controller	<b>D</b>
04	Size 10	<b>10</b>
	Size 16	<b>16</b>
	Size 25	<b>25</b>
	Size 27	<b>27</b>
	Size 35	<b>35</b>

### Symbols

05	Possible versions see page 4
----	------------------------------

**Rated flow** at 10 bar pressure differential (5 bar/control edge)

06	<b>- Size 10</b>	
	60 l/min (only symbol E, E1-, W6-, W8-, V and V1-)	<b>60</b>
	100 l/min	<b>100</b>
	<b>- Size 16</b>	
	200 l/min (only symbol W6- and W8-)	<b>200</b>
	250 l/min (only symbol E, E1-, V, V1- and Q3)	<b>250</b>
	<b>- Size 25</b>	
	350 l/min (only symbol W6- and W8-) <sup>1)</sup>	<b>350</b>
	400 l/min (only symbol E, E1-, V, V1- and Q3)	<b>400</b>
	<b>- Size 27</b>	
	430 l/min (only symbol W6- and W8-) <sup>1)</sup>	<b>430</b>
	600 l/min (only symbol E, E1-, V, V1- and Q3)	<b>600</b>
	<b>- Size 35</b>	
	1000 l/min (only symbol E, E1-, V and V1-)	<b>1000</b>
	1200 l/min (only symbol W6- and W8-) <sup>1)</sup>	<b>1200</b>
	1500 l/min (only symbol E, E1-, V, V1- and Q3-)	<b>1500</b>

### Flow characteristic

07	Linear	<b>L</b>
	Linear with fine control range (only NG10; other sizes on request)	<b>P</b>
	Progressive with linear fine control range (only symbols Q3-)	<b>M</b>
08	<b>Without</b> overlap jump (only symbols V, V1- and Q3)	<b>no code</b>
	<b>With</b> overlap jump (opening point 5% with covered valve; only symbols E, E1-, W6-, W8-)	<b>J</b>
09	Component series 40 ... 49 (40 ... 49: unchanged installation and mounting dimensions)	<b>4X</b>

### Seal material

10	NBR seals	<b>M</b>
	FKM seals	<b>V</b>
Observe compatibility of seals with hydraulic fluid used! (other seals on request)		

### Pilot oil flow

11	External pilot oil supply, external pilot oil return	<b>XY</b>
	Internal pilot oil supply, external pilot oil return	<b>PY</b>
	Internal pilot oil supply; internal pilot oil return	<b>PT</b>
	External pilot oil supply, internal pilot oil return	<b>XT</b>

<sup>1)</sup> Higher rated flow upon request

### Ordering code

01	02	03	04	05	06	07	08	09	10	11	12	13	14	15	16
<b>4</b>	<b>WRL</b>	<b>D</b>					-	<b>4X</b>	/		/	<b>24</b>	<b>D6</b>		*

12	Supply voltage 24 V	<b>24</b>
----	---------------------	-----------

### Ethernet interface

13	EtherNET/IP	<b>E</b>
	PROFINET RT	<b>N</b>
	Sercos	<b>S</b>
	EtherCAT (CANopen profile)	<b>T</b>
	POWERLINK (CANopen profile)	<b>W</b>
	VARAN	<b>V</b>

### Electrical interface


14	±10 VDC or 4 ... 20 mA	<b>D6</b>
----	------------------------	-----------

### Sensor interfaces

15	0 ... 10 V/4 ... 20 mA/EnDat 2.2	<b>S</b>
	0 ... 10 V/4 ... 20 mA/SSI	<b>T</b>
	0 ... 10 V/4 ... 20 mA/1Vss	<b>U</b>

16	Further details in the plain text	*
----	-----------------------------------	---

## Symbols

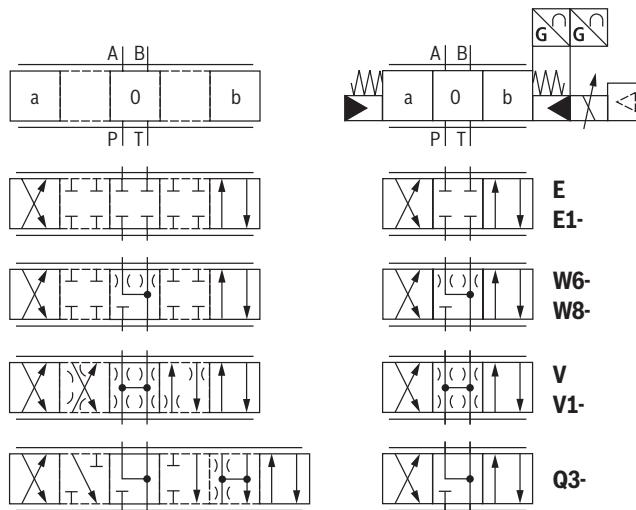

With symbol E1-, V1- and W8-:

P → A:  $q_{V \max}$       B → T:  $q_V/2$   
 P → B:  $q_V/2$       A → T:  $q_{V \max}$

Version	simple	detailed
"XY"		
"PY"		
"PT"		
"XT"		<p><b>Notice:</b></p> <ul style="list-style-type: none"> <li>Representation according to DIN ISO 1219-1. Hydraulic interim positions are shown by dashes.</li> <li>For information on the "switch-off behavior", refer to "Technical data" on page 10.</li> <li>Symbols V and V1 are not suitable for use in safety applications (no overlap).</li> </ul>

## Function

### General

The pilot-operated **IAC-Multi-Ethernet** valve (Integrated Axis Controller based on directional control valves) is a digital directional control valve with integrated axis controller and the following functionalities:

- ▶ Position control
- ▶ Pressure/force control
- ▶ Closed-loop speed control
- ▶ Substitutional closed-loop control (position - pressure/force)
- ▶ Substitutional control (flow - pressure/force)
- ▶ pQ function (flow-controlled)


Among others, the following operating modes are possible:

- ▶ Valve direct control
- ▶ Drive-controlled position control
- ▶ Drive-controlled positioning
- ▶ Positioning block operation
- ▶ The command values are preset via the Ethernet interface (X7E1 or X7E2) or, alternatively, via the analog/digital interface (XH2)
- ▶ The feedback information of the actual value signals to the superior control system is provided optionally either via the Ethernet interface (X7E1 or X7E2) or the analog/digital interface (XH2)
- ▶ The controller parameters are set via the Ethernet interface (X7E1 or X7E2)

### Set-up

The directional control valve with IAC-Multi-Ethernet electronics mainly consists of:

- ▶ Pilot control valve (1) with control spool and sleeve in servo quality
- ▶ Main stage (2) with centering springs and position feedback
- ▶ Integrated digital axis controller (3) with:
  - analog/digital interface (XH2)
  - Ethernet interfaces (X7E1, X7E2)
  - analog sensor interfaces (X2M1, X2M2)
  - digital sensor interface (X8M)
  - interface for the position transducer of the main stage (X8A)

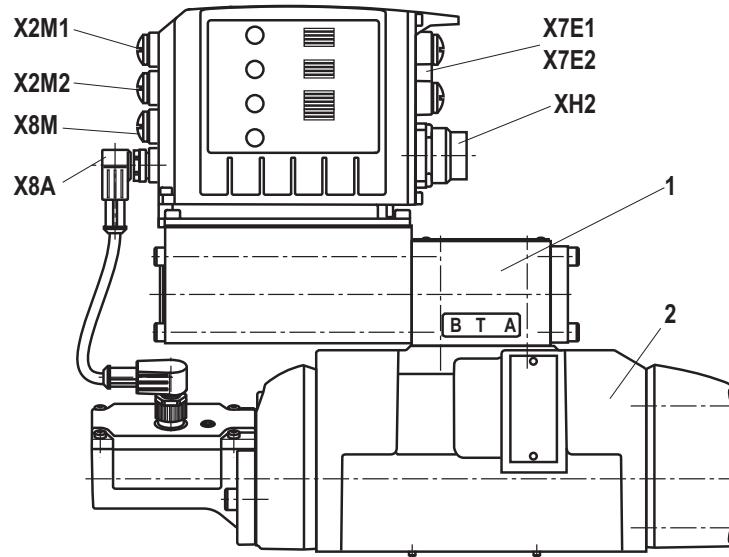

6/40 4WRLD | Directional control valve

## Function

### Function (symbol V, V1- and Q3)

When the control solenoid of the pilot control valve is de-energized, its spring-operated control spool is in the "fail safe" position. The control spool of the main valve is in the spring-centered offset position at approx. 6% of the stroke in direction P→B/A→T.

The integrated electronics (OBE) compare the specified command value to the position actual value of the control spool of the main stage. In case of a control deviation, the control solenoid of the pilot control valve is activated and its control spool is adjusted.

The flow which is activated via the control cross-sections at the pilot control valve leads to an adjustment of the control spool of the main valve. The stroke/control cross-section of the main valve is regulated proportionally to the command value. In case of a command value presetting of 0%, the electronics adjust the control spool of the main valve to central position.

The pilot oil supply in the pilot control valve is either internal via port P or external via port X. The feedback can be internal via port T or external via port Y to the tank.

### Switching off the release (symbol V and V1-)

If the supply voltage fails or in case of cable break, the integrated electronics will de-energize the control solenoid, the pilot control spool will move to the fail-safe position and will unload the pilot oil chambers of the main valve. Operated by the spring, the main valve control spool will move to the offset position (approx. 6% P→B/A→T).

### Function (symbol E. and W.)

When the control solenoid of the pilot control valve is de-energized, its spring-operated control spool is in the "fail safe" position. The control spool of the main valve is in spring-centered central position.

The integrated electronics (OBE) compare the specified command value to the position actual value of the control spool of the main stage. In case of a control deviation, the control solenoid of the pilot control valve is activated and its control spool is adjusted.

The flow which is activated via the control cross-sections at the pilot control valve leads to an adjustment of the control spool of the main valve. The stroke/control cross-section of the main valve is regulated proportionally to the command value.

The pilot oil supply in the pilot control valve is either internal via port P or external via port X. The feedback can be internal via port T or external via port Y to the tank.

### Switching off the release (symbol E. and W.)

If the supply voltage fails or in case of cable break, the integrated electronics will de-energize the control solenoid, the pilot control spool will move to the fail-safe position and will unload the pilot oil chambers of the main valve. Operated by the spring, the main valve control spool will move to the central position.

### Monitoring

The digital control electronics enable comprehensive monitoring functions/error detection including:

- ▶ Undervoltage
- ▶ Communication error
- ▶ Cable break for analog sensor inputs and digital position measurement system
- ▶ Short-circuit monitoring for analog/digital outputs
- ▶ Monitoring of the microcontroller (watchdog)
- ▶ Temperature of the integrated electronics

### IndraWorks DS PC program

To implement the project planning task and to parameterize the IAC-Multi-Ethernet valves, the user may use the IndraWorks DS engineering tool (see accessories):


- ▶ Project planning
- ▶ Parameterization
- ▶ Commissioning
- ▶ Diagnosis
- ▶ Comfortable management of all data on a PC
- ▶ PC operating systems: Windows XP (SP3), Windows 7-10

### ☞ Notes:


- ▶ Symbol V and V1-:  
Pilot-operated 4/3 directional control valves are only functional in the active control loop and do not have a locking basic position when deactivated. Thus, "external isolator valves" are necessary in many applications and have to be considered in the switch-on/switch-off order.  
While the electrical supply voltage is being switched off, the drive may be accelerated for a short time in functional direction P→B.
- ▶ Symbol E. and W.:  
Pilot-operated 4/3-directional control valves with positive overlap are functional in controlled or regulated axes. The overlap in the deactivated condition is approx. 20% of the control spool stroke. While the release is being switched off, the drive may be accelerated for a short time in functional direction P→B. (For further details, please refer to operating instructions 29391-B)

**Pilot oil supply (schematic illustration)**


**NG10**

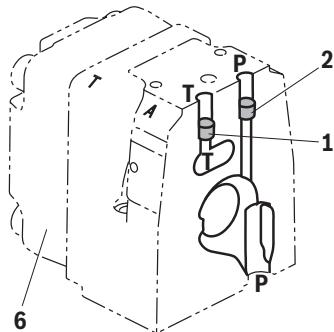


**NG16**

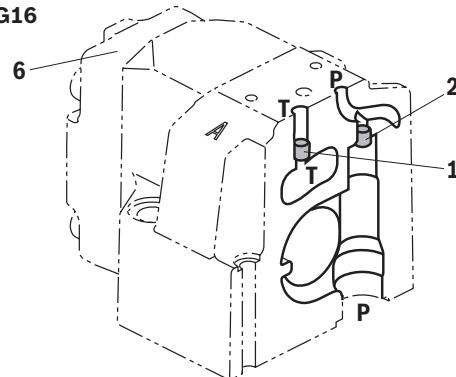


**NG25**

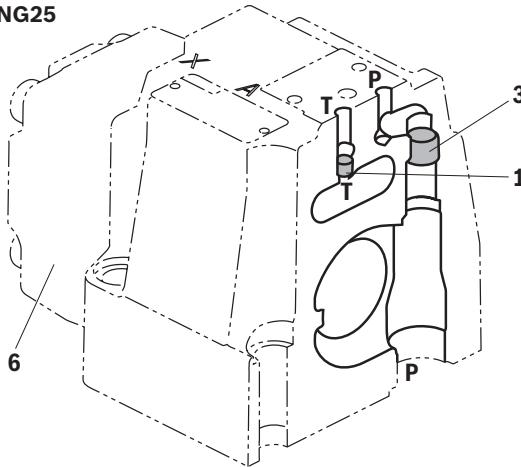

**NG27**

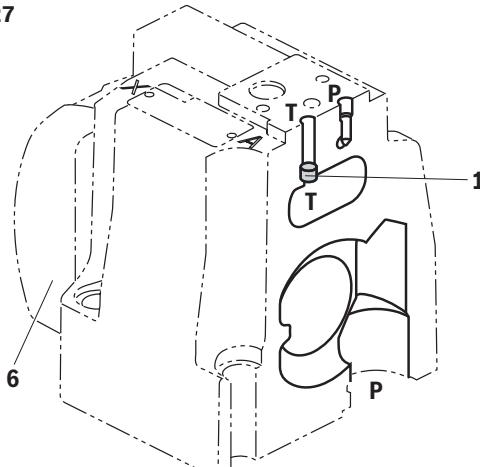

**NG35**

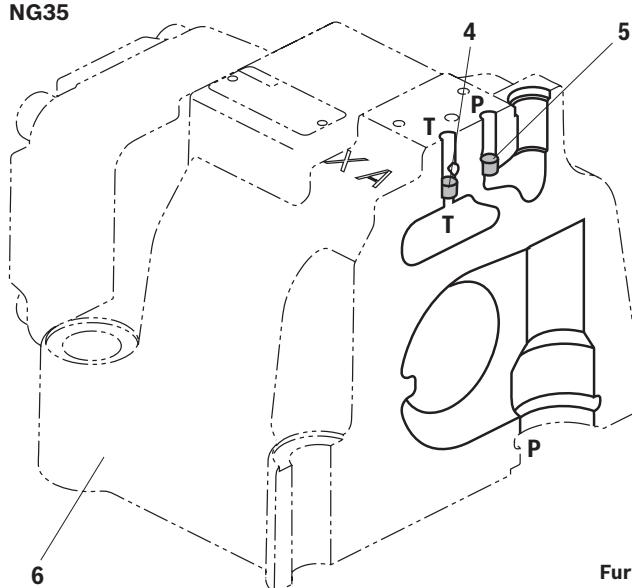

**1** Plug screw M6 according to DIN 906, wrench size 3  
– pilot oil return

**2** Plug screw M6 according to DIN 906, wrench size 3  
– pilot oil supply

**3** Plug screw M12 x 1.5 according DIN 906, wrench size 6  
– pilot oil supply

**4** Plug screw 1/16-27 NPTF, wrench size 4  
– pilot oil return

**5** Plug screw 1/16-27 NPTF, wrench size 4  
– pilot oil supply

**6** Housing cover main stage (position transducer side)

**Pilot oil supply**

external: **2, 3, 5** closed

internal: **2, 3, 5** open

**Pilot oil return**

external: **1, 4** closed

internal: **1, 4** open

**Further explanations on page 8.**

RE 29289, edition: 2017-09, **Bosch Rexroth AG**

8/40 4WORLD | Directional control valve

## Pilot oil supply

### Version "XY"

#### External pilot oil supply

#### External pilot oil return

In this version, the pilot oil is supplied from a separate control circuit (external).

The pilot oil return is not directed into channel T of the main valve, but is separately directed to the tank via port Y (external).

### Version "PY"

#### Internal pilot oil supply

#### External pilot oil return

With this version, the pilot oil is supplied from channel P of the main valve (internally).

The pilot oil return is not directed into channel T of the main valve, but is separately directed to the tank via port Y (external).

In the subplate, port X is to be closed.

### Version "PT"

#### Internal pilot oil supply

#### Internal pilot oil return

With this version, the pilot oil is supplied from channel P of the main valve (internally).

The pilot oil is directly returned to channel T of the main valve (internally).

In the subplate, ports X and Y are to be closed.

### Version "XT"

#### External pilot oil supply

#### Internal pilot oil return

In this version, the pilot oil is supplied from a separate control circuit (external).

The pilot oil is directly returned to channel T of the main valve (internally).

In the subplate, port Y is to be closed.

## Technical data

(For applications outside these parameters, please consult us!)

general								
Size	NG	10	16	25	27	35		
Installation position	any							
Ambient temperature range	°C	-20 ... +60						
Maximum storage time	Years	1 (if the storage conditions are observed; refer to the operating instructions 07600-B)						
Vibration resistance	► Sine test according to DIN EN 60068-2-6	10 ... 2000 Hz / maximum of 10 g / 10 cycles / 3 axes						
	► Noise test according to DIN EN 60068-2-64	20 ... 2000 Hz / 10 g <sub>RM</sub> / 30 g peak / 30 min. / 3 axes						
	► Transport shock according to DIN EN 60068-2-27	15 g / 11 ms / 3 axes						
Weight	kg	9	12	19	21	80		
Maximum relative humidity (no condensation)	%	95						
Maximum solenoid surface temperature	°C	120 (individual operation)						
MTTF <sub>d</sub> value according to EN ISO 13849	► Hydraulic (category 1)	Years	75 (for further details, see operating instructions 29391-B)					
	► Hydraulic and electric (category 3 and 4, without power supply unit)	Years	70 (for further details, see operating instructions 29391-B)					

## Technical data

(For applications outside these parameters, please consult us!)

hydraulic		Size	NG	10	16	25	27	35			
Maximum operating pressure	► Port A, B, P										
	– External pilot oil supply	bar		350		270		350			
	– Internal pilot oil supply	bar		280		270		280			
	► Port X	bar		280		270		280			
	► Ports T, Y	bar		250		210		250			
Minimum pilot pressure (pilot control valve)		bar	10								
Maximum flow		l/min	300	800	1250	1850	4700				
Rated flow ( $\Delta p = 5$ bar/control edge) <sup>1)</sup>		l/min	60/100	200/250	350/400	430/600	1000/1200/1500				
Pilot oil flow <sup>2)</sup>	► Symbol E, W	l/min	2.4	3.5		7.5		23			
	► Symbol V, Q3-	l/min	4.5	11.5		22		29			
Maximum leakage flow (inlet pressure 100 bar)	► Symbol E, E1-										
	– Main valve	l/min	0.06	0.13		0.17		0.61			
	– Main valve + pilot control valve	l/min	0.14	0.28		0.42		1.01			
	► Symbol W6-, W8-										
	– Main valve	l/min	0.12	0.26		0.35		1.23			
	– Main valve + pilot control valve	l/min	0.2	0.41		0.6		1.63			
Maximum zero flow (inlet pressure 100 bar)	► Symbol V, V1-										
	– Main valve	l/min	1.7	2.3	2.8	3.3		7.2			
	– Main valve + pilot control valve	l/min	1.85	2.6	3.2	3.7		7.65			
	► Symbol Q3-										
	– Main valve	l/min	0.4	1.6	1.8	2.2		1.6			
	– Main valve + pilot control valve	l/min	0.55	1.9	2.2	2.6		2.05			
Flow unloading central position $\Delta p = 5$ bar/control edge		A→T B→T A→T B→T A→T B→T A→T B→T A→T B→T									
	► Symbol W6-	l/min	2.8	2.8	4	4	6	6	25	25	
	► Symbol W8-	l/min	2.8	1.4	4	2	6	3	6	25	12.5
Hydraulic fluid			see table page 10								
Viscosity range	► recommended	mm²/s	30 ... 45								
	► maximum admissible	mm²/s	20 ... 380								
Hydraulic fluid temperature range (flown-through)		°C	-20 ... +70								
Maximum admissible degree of contamination of the hydraulic fluid, cleanliness class according to ISO 4406 (c)			Class 18/16/13 <sup>3)</sup>								

1) Flow for deviating  $\Delta p$  (valve pressure differential):

$$q_x = q_{Vnom} \times \sqrt{\frac{\Delta p_x}{10}}$$

2) At port X and Y with stepped input signal from 0 ... 100% (100 bar)

3) The cleanliness classes specified for the components must be adhered to in hydraulic systems. Effective filtration prevents faults and simultaneously increases the life cycle of the components.

Available filters can be found at [www.boschrexroth.com/filter](http://www.boschrexroth.com/filter).

10/40 4WORLD | Directional control valve

## Technical data

(For applications outside these parameters, please consult us!)

Hydraulic fluid	Classification	Suitable sealing materials	Standards	Data sheet
Mineral oils	HL, HLP, HLPD, HVLP, HVLPD	NBR, FKM	DIN 51524	90220
Bio-degradable	► Insoluble in water	HETG	NBR, FKM	ISO 15380 90221
	► Soluble in water	HEES	FKM	
Flame-resistant	► Water-free	HF DU (glycol base)	FKM	ISO 12922 90222
		HF DU (ester base)	FKM	
	► Containing water	HFC (Fuchs Hydrotherm 46M, Petrofer Ultra Safe 620)	NBR	ISO 12922 90223



### Important information on hydraulic fluids:

- For further information and data on the use of other hydraulic fluids, please refer to the data sheets above or contact us.
- There may be limitations regarding the technical valve data (temperature, pressure range, life cycle, maintenance intervals, etc.).
- The ignition temperature of the hydraulic fluid used must be 40 K higher than the maximum solenoid surface temperature.
- **Flame-resistant – containing water:**
  - Maximum operating pressure 210 bar, otherwise increased cavitation erosion
  - Life cycle as compared to operation with mineral oil HL, HLP 30 ... 100%
  - Maximum hydraulic fluid temperature 60 °C
- **Bio-degradable and flame-resistant:** When using hydraulic fluids that are simultaneously zinc-solving, zinc may accumulate (700 mg zinc per pole tube).

### static / dynamic

Size	NG	10	16	25	27	35
Hysteresis	%	< 0.1				
Response sensitivity	%	< 0.05				
Range of inversion	%	< 0.08				
Manufacturing tolerance $\text{q}_{V\max}$	%	≤ 10				
Actuating time for 0 ... 100% at X = 100 bar	► Symbol E, E1-, W6-, W8-	ms	40	60	60	60
Switch-off behavior (after electrical shut-off)	► Symbol E, E1-, W6-, W8- ► Symbol V, V1- ► Symbol Q3		Pilot control valve in fail-safe position, main valve moves to overlapped spring-centered central position			
Temperature drift (temperature range 20 °C ... 80 °C)	%/10 °C		Pilot control valve in fail-safe position, main valve moves to spring-centered "offset position" (approx. 6%, P→B/A→T)			
Zero compensation			Pilot control valve in fail-safe position, main valve moves to spring-centered "offset position" (P blocked, A/B to port T open)			
Zero shift < 0.25						
Ex plant						
±1%						

### electrical, integrated electronics (OBE)

Relative duty cycle	%	100 (continuous operation)
Protection class according to EN 60529		IP 65 with mounted and locked plug-in connectors
Supply voltage <sup>4; 5)</sup>	► Nominal voltage	VDC 24
	► Lower limit value	VDC 18
	► Upper limit value	VDC 36
	► Maximum admissible residual ripple	Vpp 2.5 (Comply with absolute supply voltage limit value)
Current consumption	► Maximum <sup>6)</sup>	A 2.5
	► Impulse current	A 4

<sup>4)</sup> Supply voltage is used directly for sensor connections X2M1, X2M2 and X8M (no internal voltage limitation)

<sup>5)</sup> Voltage limit values must be observed directly at the connector of the valve (observe line length and cable cross-section!)

<sup>6)</sup> The maximum current consumption will increase when using the sensor inputs or the switching output according to the external load

## Technical data

(For applications outside these parameters, please consult us!)

electrical, integrated electronics (OBE)		
Maximum power consumption	W	40
AD/DA resolution	► Analog inputs	12 bit
	► Analog output	12 bit
Protective grounding conductor and screening		see connector pin assignment (CE-compliant installation) page 15 and 16
Required fuse protection, external	A	4, time-lag
Adjustment		calibrated in the plant, see characteristic curves page 18 ... 30
Conformity		CE according to EMC Directive 2014/30/EU tested according to EN 61000-6-2 and EN 61000-6-3
Parameterization interface		Ethernet
Scan time pressure and force controller (minimum)	msec	0.5
Scan time position controller (minimum)	msec	1
Booting time	sec	< 15
Digital inputs	► Quantity	optionally up to 2, configurable (analog inputs are omitted)
XH2	► Low level	V -3 ... 5
	► High level	V 15 ... $U_B$
	► Current consumption at high level	mA < 1
	► Reference potential	Pin 5
Digital outputs	► Quantity	1
XH2	► Low level	V 0 ... 3
	► High level	V 15 ... $U_B$
	► Current carrying capacity	A 1.5 (short-circuit-proof)
	► Signal delay time	msec < 2 (depending on set scan time)
	► Reference potential	GND
Analog inputs	► Number (current and voltage input parameterizable)	optionally up to 2, configurable (digital inputs are no longer required)
XH2	► AD resolution	bit 12
	► Voltage inputs (differential inputs)	
	- Measurement range	V -10 ... +10
	- Input resistance	kΩ 80 +10%
	- Temperature drift	< 14 mV / 10 K
	► Current inputs (reference to AGND)	
	- Input current	4 ... 20 (0 ... 20 physically)
	- Input resistance	Ω 200, measuring resistance plus FET
	- Temperature drift	< 25 μA / 10 K
Analog outputs	► Number (current and voltage input parameterizable)	1
XH2	► DA resolution	bit 12
	► Voltage outputs	
	- Output range	V -10 ... +10 (0 ... 10 by software)
	- Minimum load impedance	kΩ 10
	- Temperature drift	< 5 mV / 10 K
	► Current outputs	
	- Output range	mA 0 ... 20 (4 ... 20 by software)
	- Maximum load	Ω 200


12/40 4WORLD | Directional control valve

### Technical data


(For applications outside these parameters, please consult us!)

Analog sensors X2M1, X2M2	▶ Number (current and voltage input configurable)	1 per connector
	▶ Supply voltage	V 24 (corresponding to supply voltage applied to XH2)
	▶ Maximum supply current	mA 350 (sum X2M1, X2M2 and X8M)
	▶ AD resolution	bit 12
	▶ Voltage inputs	
	– Measurement range	V 0 ... 10
	– Input resistance	kΩ 80 ±10%
	– Temperature drift	< 15 mV / 10 K
	▶ Current inputs (reference to AGND)	
	– Input current	4...20 (0...20 physically)
Digital sensor X8M	– Input resistance	Ω 200, measuring resistance plus PTC
	– Temperature drift	< 10 µA / 10 K
	▶ Supply voltage	24 V or 5 V
	▶ Maximum supply current	
	– 24 V	mA 350 (sum X2M1, X2M2 and X8M)
	– 5 V	mA 250
	▶ SSI transducer	
	– Coding	Gray
	– Data width	12 ... 28 bit
	– Transfer frequency	80 kHz ... 1 MHz
	– Line receiver / driver	RS485
	▶ Endat encoder	2.2
	– Line receiver / driver	RS485
	– Resolution	minimum 10 nm and multiple
	▶ 1Vpp-encoder	
	– Transfer frequency	kHz 250

**Representation of the axis controller in the system network**

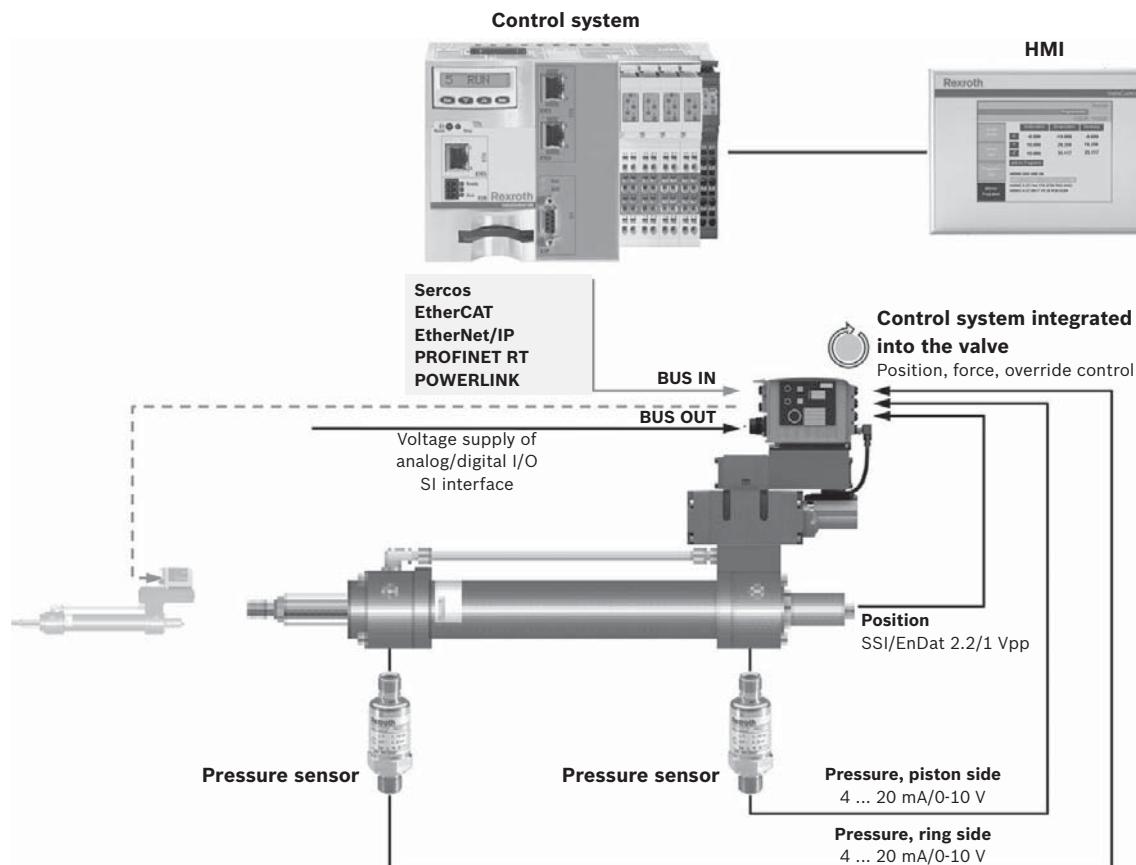

### Block diagram/controller function block

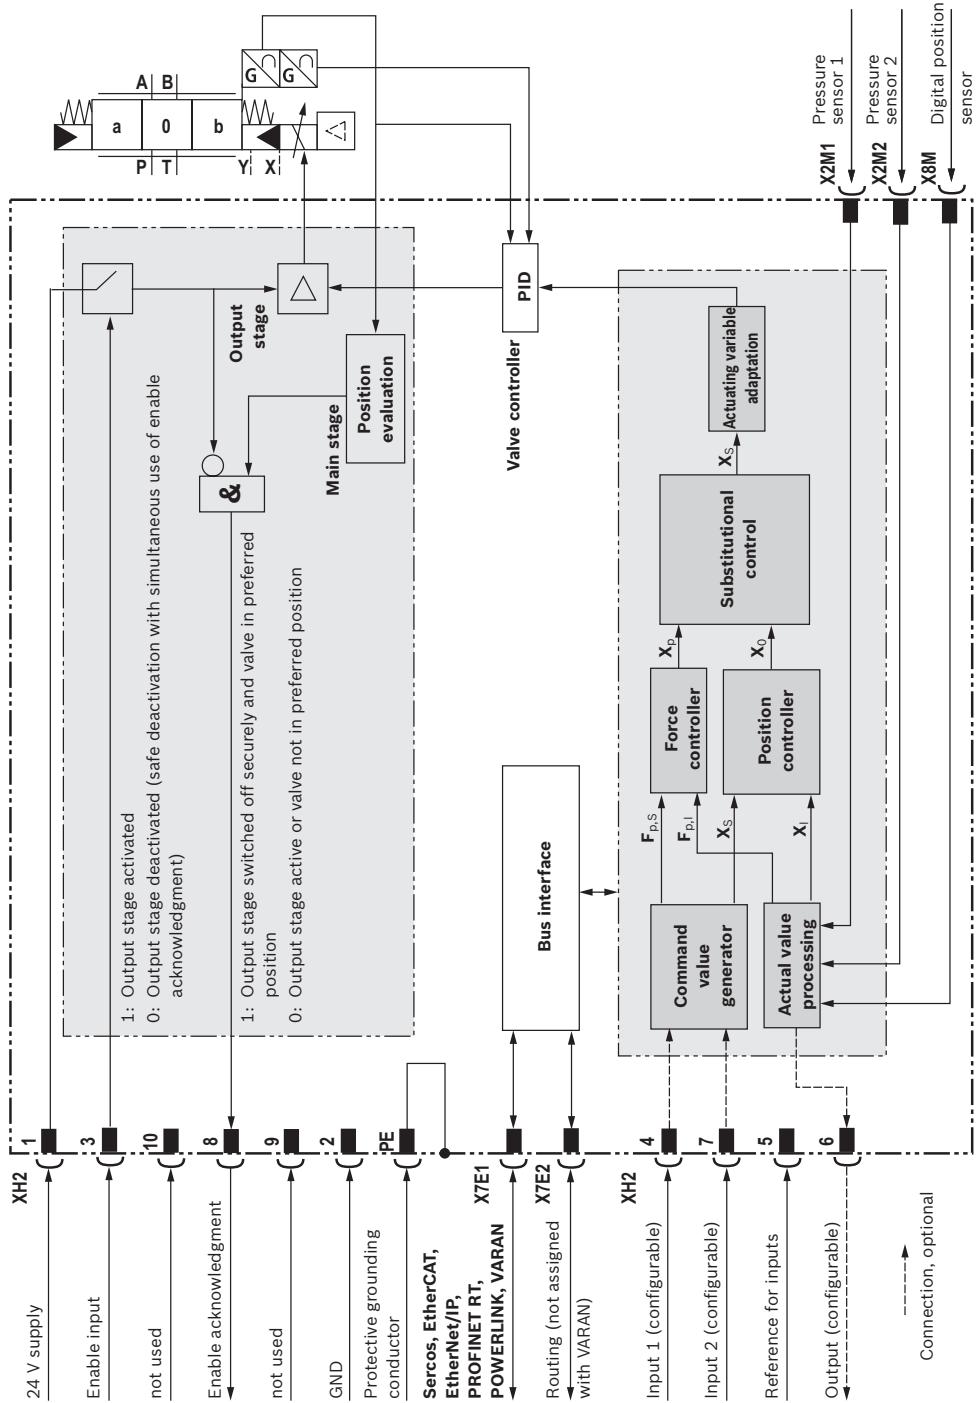

**Detailed description of the safety function:**

After the signal at the enable input has been removed, the output stage, and thus the solenoid of the valve, are internally separated from the available supply voltage. The enable acknowledgement will only be activated after the safe valve spool position has been achieved. For a detailed description of the safety function, refer to the operating instructions 29391-B.

## Electrical connections, assignment

Connector pin assignment XH2, 11-pole + PE according to EN 175201-804

Pin	Core marking Cable, one-part <sup>1)</sup>	Core marking Cable, split <sup>2)</sup>	Interface D6 assignment
1	1	1	24 V DC supply voltage
2	2	2	GND
3	3	white	Enable input 24 V DC (high $\geq$ 15 V; low < 2 V)
4	4	yellow	Command value 1 (4 ... 20 mA/ $\pm$ 10 V) <sup>3)</sup>
5	5	green	Reference for command values
6	6	violet	Actual value (4 ... 20 mA/ $\pm$ 10 V) <sup>3,4)</sup>
7	7	pink	Command value 2(4 ... 20 mA/ $\pm$ 10 V) <sup>3)</sup>
8	8	red	Enable acknowledgment 24 V DC ( $I_{max}$ 50 mA) <sup>5)</sup>
9	9	brown	not used
10	10	black	not used
11	11	blue	Switching output 24 V, configurable (fault-free operation (24 V)/error (0V) or power circuit signal), maximum 1.5 A <sup>3;5)</sup>
PE	Green-yellow	green-yellow	Functional ground (connected directly to metal housing)

1) Core marking of the connection lines for mating connector with cable set (see accessories, page 37, material numbers R901268000, R901272854, R901272852)


2) Core marking of the connection lines for mating connector with cable set (see accessories, page 37), material numbers R900884671, R900032356, R900860399)

3) Selection via commissioning software

4) For diagnostic purposes, precise actual value response via Ethernet interface

5) A load increases the current consumption on pin 1


XH2



Connector pin assignment for Ethernet interface "X7E1" and "X7E2" (coding D), M12, 4-pole, socket

Pin	Assignment
1	TxD +
2	RxD +
3	TxD -
4	RxD -
5	not used


X7E1



Analog configurable sensor interfaces, connections "X2M1", "X2M2" (coding A), M12, 5-pole, socket

Pin	Assignment
1	+24 V voltage output (sensor supply) <sup>1;2)</sup>
2	Sensor signal input current (4 ... 20 mA) <sup>3)</sup>
3	GND
4	Sensor signal input voltage (0 ... 10 V) <sup>3)</sup>
5	Negative differential amplifier input to pin 4 (optional)

X2M1



1) Voltage output same as voltage supply connected to input XH2!  
 (Maximum load capacity see page 16)

2) A load increased the current consumption of the valve (pin 1 on the connector XH2)

3) Only one signal input per interface, configurable

16/40 4WORLD | Directional control valve

## Electrical connections, assignment


Digital sensor interface SSI, EnDat 2.2 or 1Vpp measurement system "X8M", M12, 8-pole, socket

Pin	SSI pin assignment <sup>1)</sup>	EnDat 2.2 pin assignment <sup>1; 2)</sup>	1Vpp pin assignment
1	GND	GND	GND
2	+24 V <sup>3)</sup>	+5 V <sup>3)</sup>	+5 V <sup>3)</sup>
3	Data +	Data +	A +
4	Data -	Data -	A -
5	GND	GND	B +
6	Clock -	Clock -	B -
7	Clock +	Clock +	R +
8	+24 V <sup>3)</sup>	+5 V <sup>3)</sup>	R -

1) Pins 2, 8 and 1, 5 have the same assignment each

2) Supported resolution  $\geq 10 \text{ nm}$

3) A load increases the current consumption of the valve (pin 1 on the connector XH2)




### ☞ Notes:

- Reference potential for all signals: GND
- We recommend connecting the shields on both sides via the metal housings of the plug-in connectors.  
Using connector pins will affect the shielding effect! Internal screens are not required.

Bosch Rexroth AG, RE 29289, edition: 2017-09

## LED displays

LED	Interface	Sercos	EtherNET/IP	EtherCAT	PROFINET RT	POWERLINK	VARAN
1	X7E1	Activity	Activity	not used	Activity	not used	Active
2		Link	Link	Link/Activity	Link	Link/Data Activity	Link
3	Electronics module	S	Network Status	Network Status	Network Status	Status/Error	Network Status
4		Module Status	Module Status	Module Status	Module Status	Module Status	Module Status
5	X7E2	Activity	Activity	not used	Activity	not used	not used
6		Link	Link	Link/Activity	Link	Link/Data Activity	not used

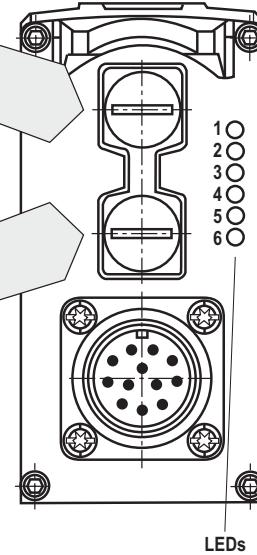

### Displays of the Status LEDs

Module status LED (LED 4)	Display status	Network status LED (LED 3)	Display status
Off	No voltage supply	Off	No voltage supply
Green-red, flashing	Initialization	Green	Operation
Green, flashing	Drive ready for operation		
Green	Drive active		
Orange, flashing	Warning		
Red, flashing	Error		

#### Notes:


- ▶ LEDs 1, 2, 5 and 6 relate to interfaces "X7E1" and "X7E2"
  - Link: Cable plugged in, connection established (permanently lit)
  - Activity: Data sent/received (flashing)
- ▶ Module status LEDs 3 and 4 relate to the electronics module
- ▶ For a detailed description of the diagnosis LEDs, please refer to the functional description Rexroth HydraulicDrive HDx.

18/40 4WRLD | Directional control valve


**Characteristic curves:** Flow characteristic "L" and "P"  
 (measured with HLP46,  $\vartheta_{\text{oil}} = 40 \pm 5^\circ\text{C}$ )

**Flow/signal function – Version "L"**

Symbol V, V1-

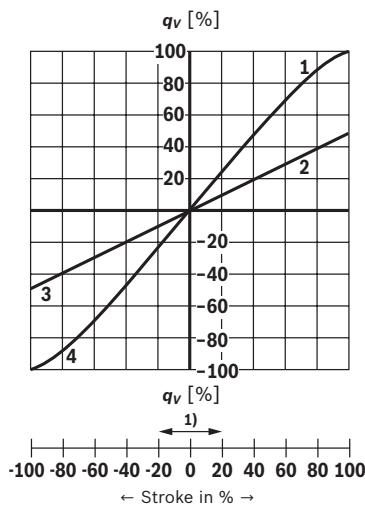


Symbol E, E1-, W6-, W8-

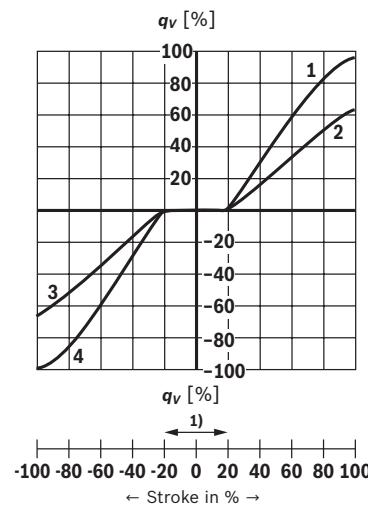


**Flow/signal function – Version "P"**

Symbol V, V1-

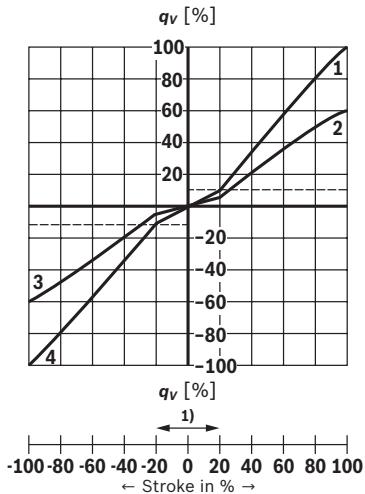

Symbol E, E1-, W6-, W8-

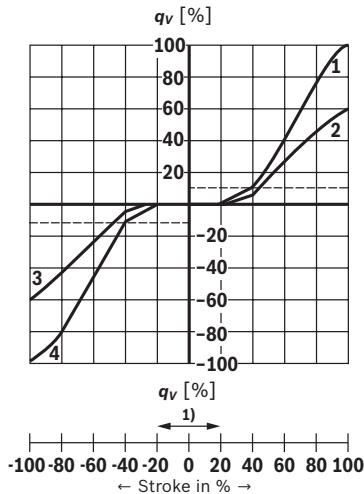

1 P-A; B-T (1:1)

2 B-T (2:1)

3 P-B (2:1)


4 P-B; A-T (1:1)

--- 10 %  $q_v$


1) Step compensation (opening at 5%)

**Characteristic curves:** Flow characteristic "M"  
 (measured with HLP46,  $\vartheta_{\text{oil}} = 40 \pm 5^\circ \text{C}$ )


Symbol Q3, version "100"

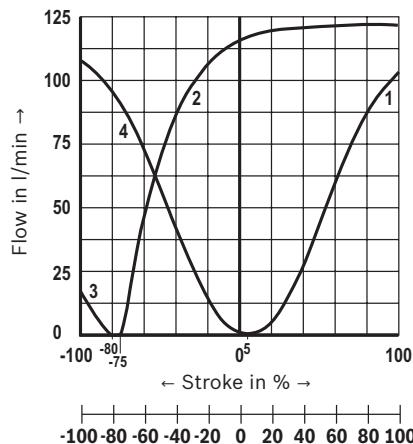


Symbol Q3, version "250"

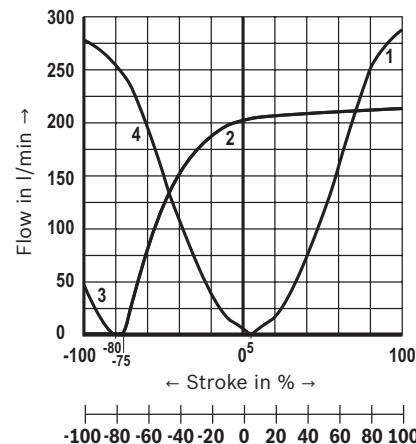

Symbol Q3, version "400"

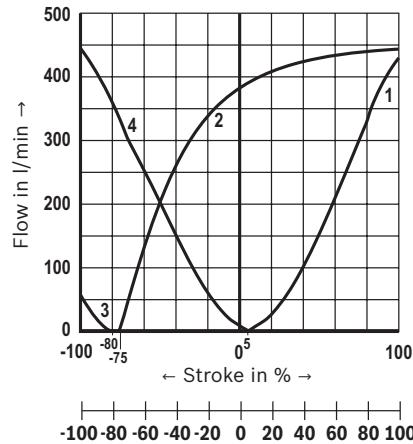

Symbol Q3, version "600"


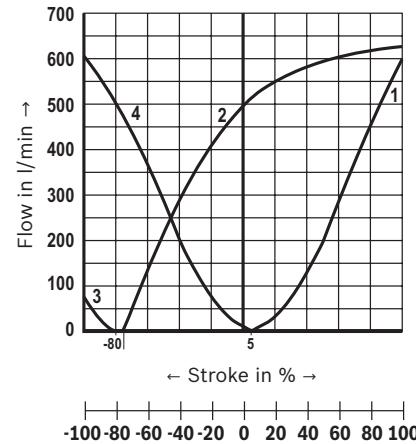


- 1 P-A
- 2 B-T
- 3 P-B
- 4 A-T

20/40 4WORLD | Directional control valve

**Characteristic curves**  
 (measured with HLP46,  $\vartheta_{\text{oil}} = 40 \pm 5^\circ\text{C}$ )

**Pressure amplification**

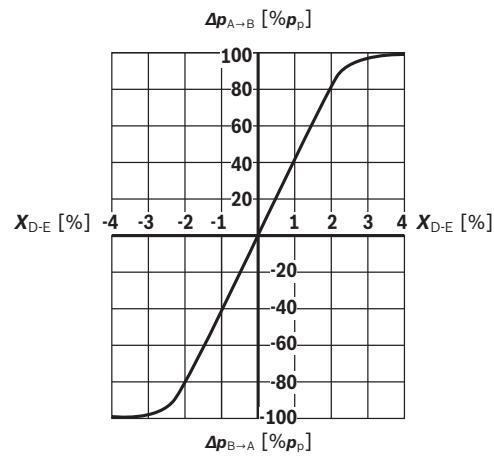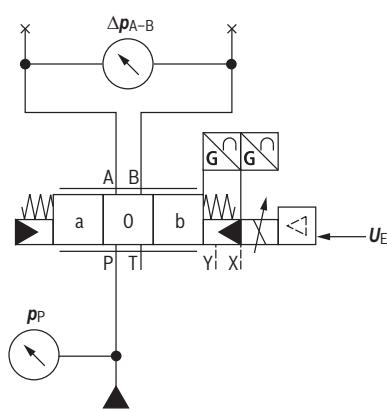


Bosch Rexroth AG, RE 29289, edition: 2017-09

**Characteristic curves:** Size 10  
(measured with HLP46,  $\vartheta_{\text{Oil}} = 40 \pm 5^\circ \text{C}$ )


## Transition function with stepped electric input signals

## Symbols V and Q3-

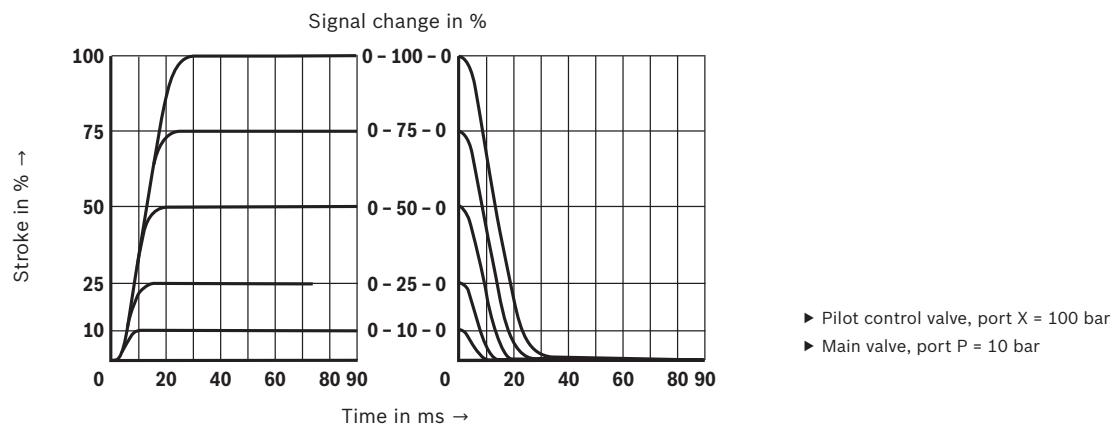

### Frequency response characteristic curves

## Symbols V and Q3-

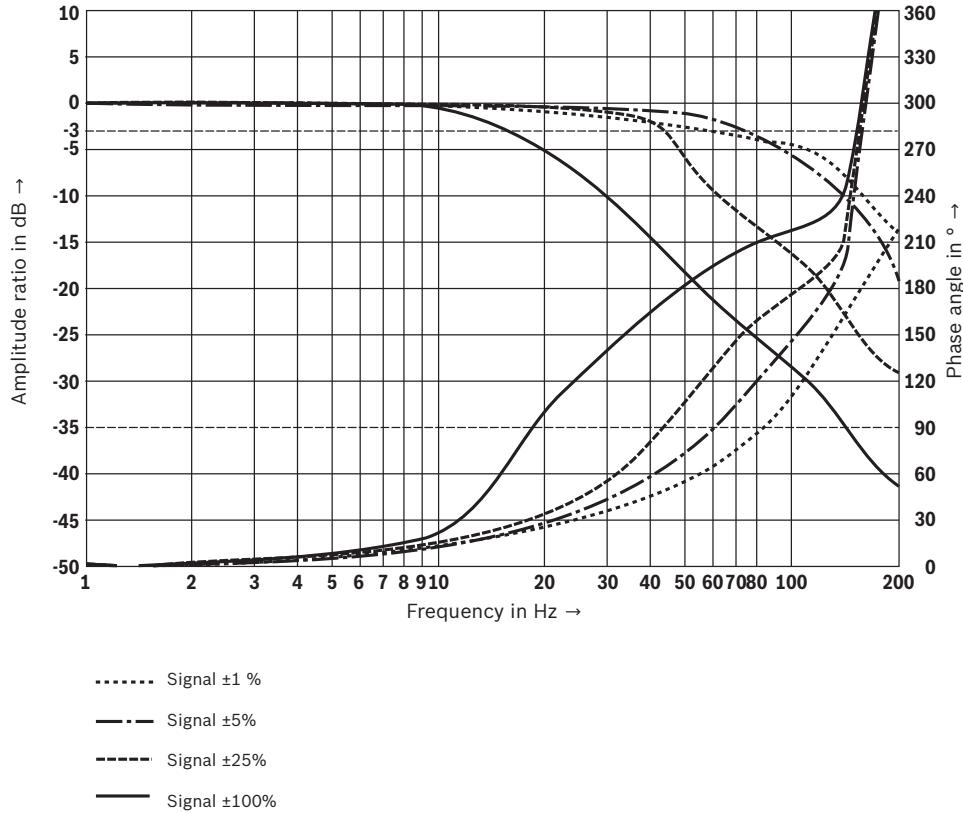


RE 29289, edition: 2017-09, **Bosch Rexroth AG**

22/40 4WRLD | Directional control valve

**Characteristic curves:** Size 10  
(valid for HLP46,  $\vartheta_{\text{oil}} = 40 \pm 5^\circ\text{C}$ )


**Flow/load function with maximum valve opening** (with maximum valve opening; tolerance  $\pm 10\%$ )

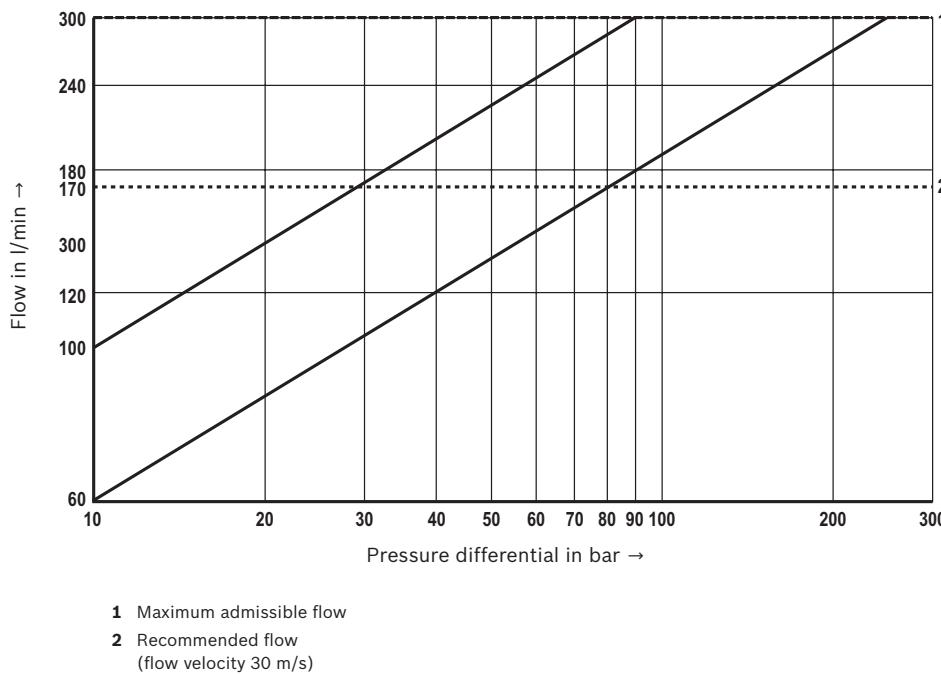


Bosch Rexroth AG, RE 29289, edition: 2017-09

**Characteristic curves:** Size 16  
 (measured with HLP46,  $\vartheta_{\text{oil}} = 40 \pm 5^\circ\text{C}$ )

**Transition function with stepped electric input signals**

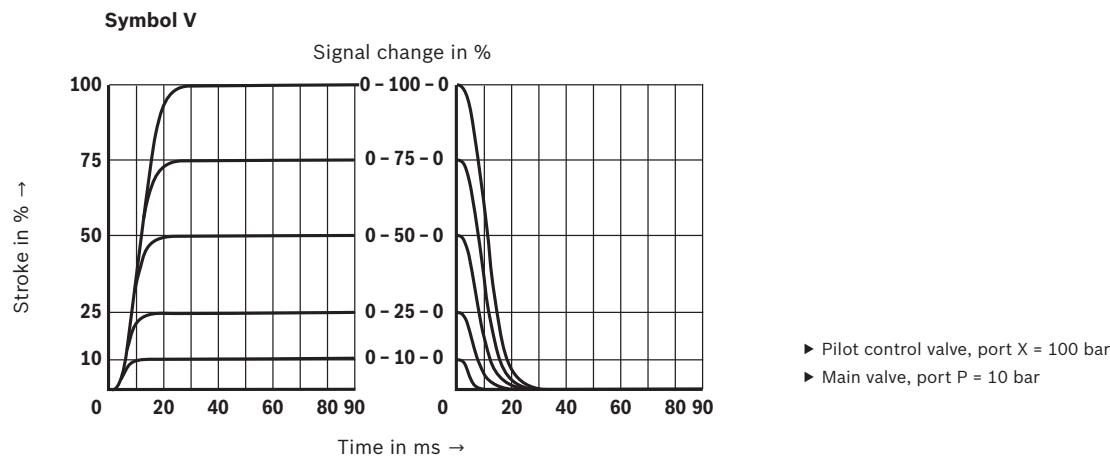

**Frequency response characteristic curves**

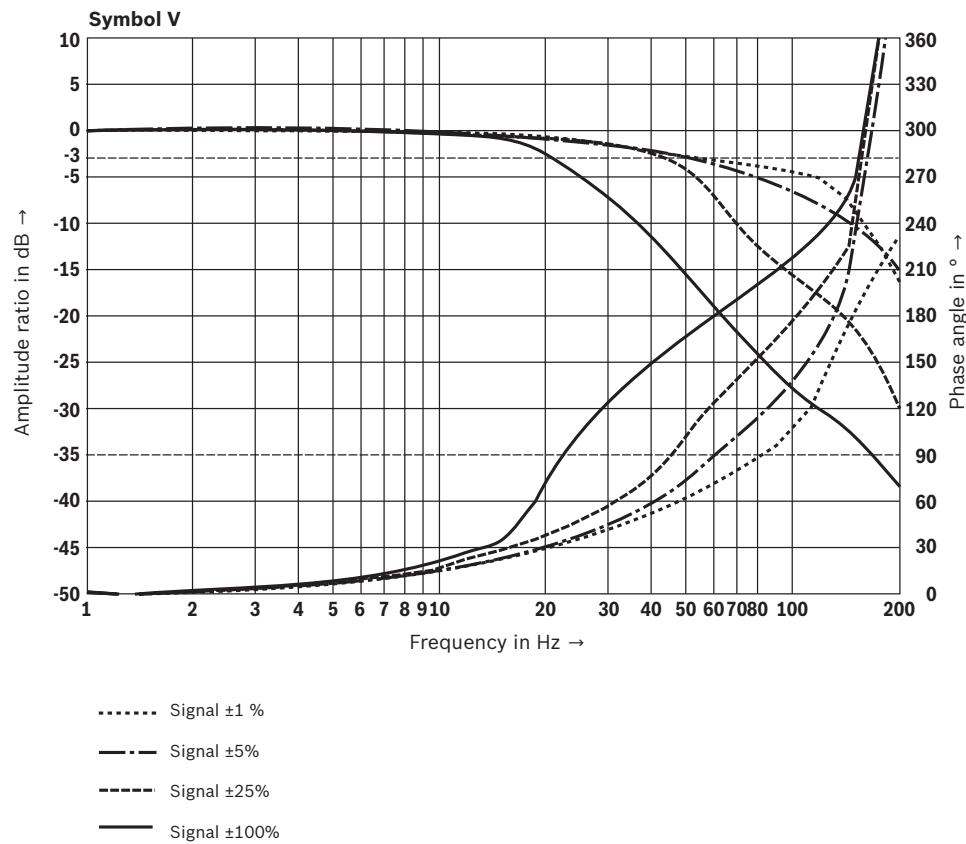


RE 29289, edition: 2017-09, **Bosch Rexroth AG**

24/40 4WRLD | Directional control valve

**Characteristic curves:** Size 16  
(measured with HLP46,  $\vartheta_{\text{oil}} = 40 \pm 5^\circ\text{C}$ )


**Flow/load function with maximum valve opening** (with maximum valve opening; tolerance  $\pm 10\%$ )

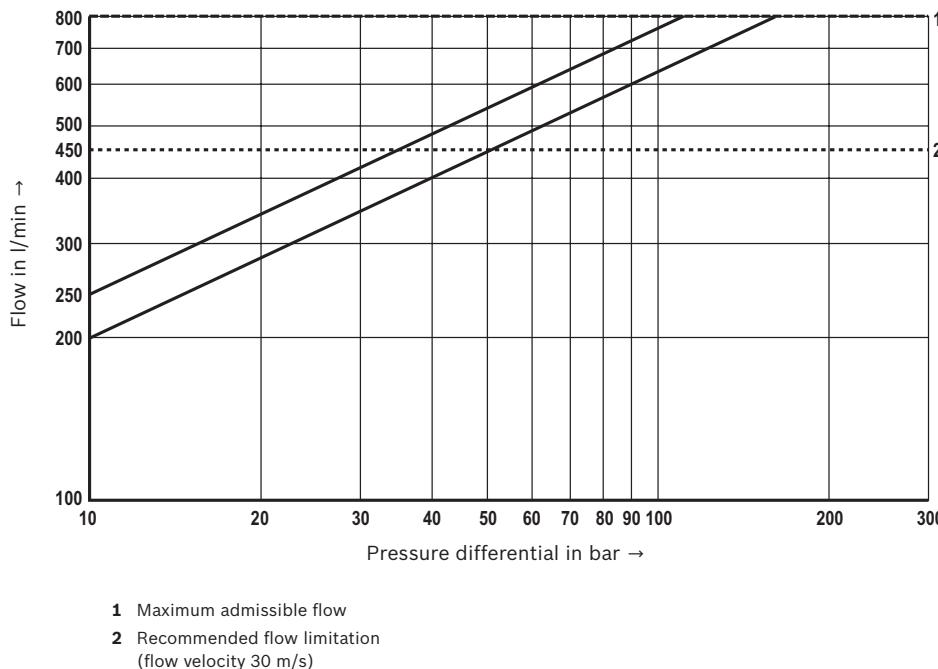


Bosch Rexroth AG, RE 29289, edition: 2017-09

**Characteristic curves:** Size 25  
 (measured with HLP46,  $\vartheta_{\text{oil}} = 40 \pm 5^\circ\text{C}$ )

**Transition function with stepped electric input signals**

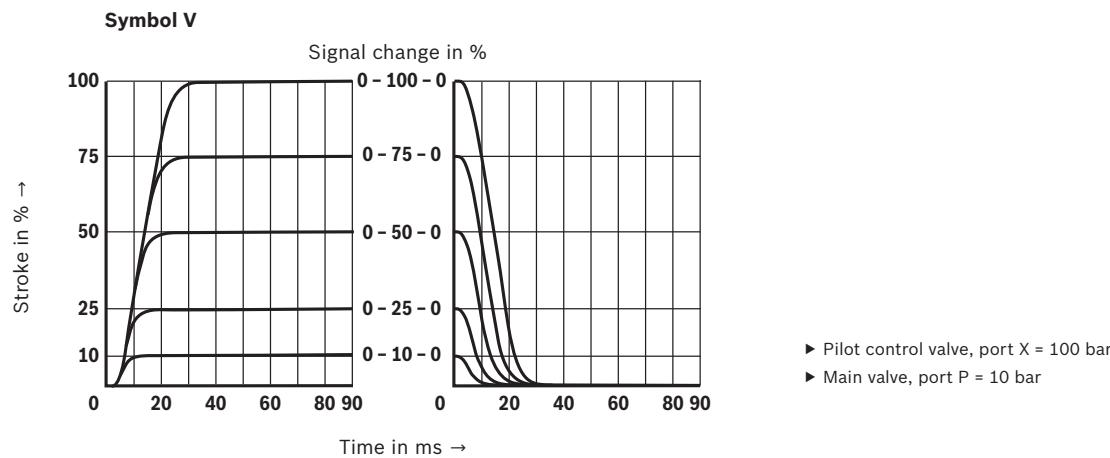


**Frequency response characteristic curves**

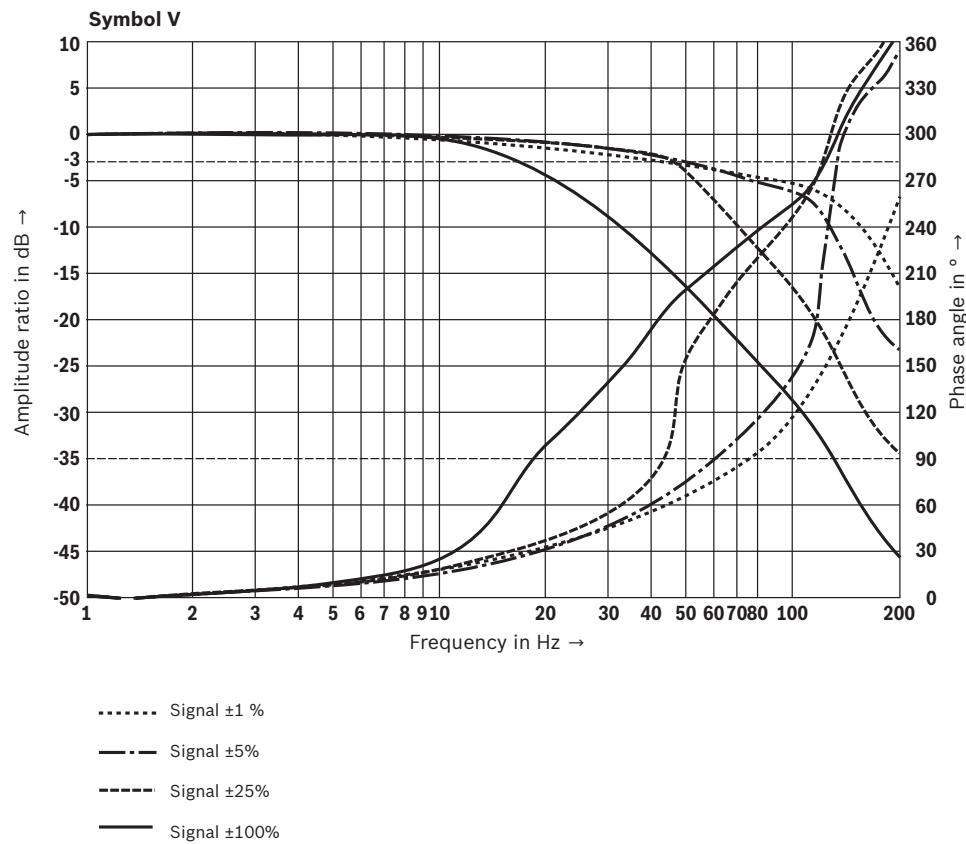

26/40 4WRLD | Directional control valve

**Characteristic curves:** Size 25  
(measured with HLP46,  $\vartheta_{\text{oil}} = 40 \pm 5^\circ \text{C}$ )


**Flow/load function with maximum valve opening** (with maximum valve opening; tolerance  $\pm 10\%$ )

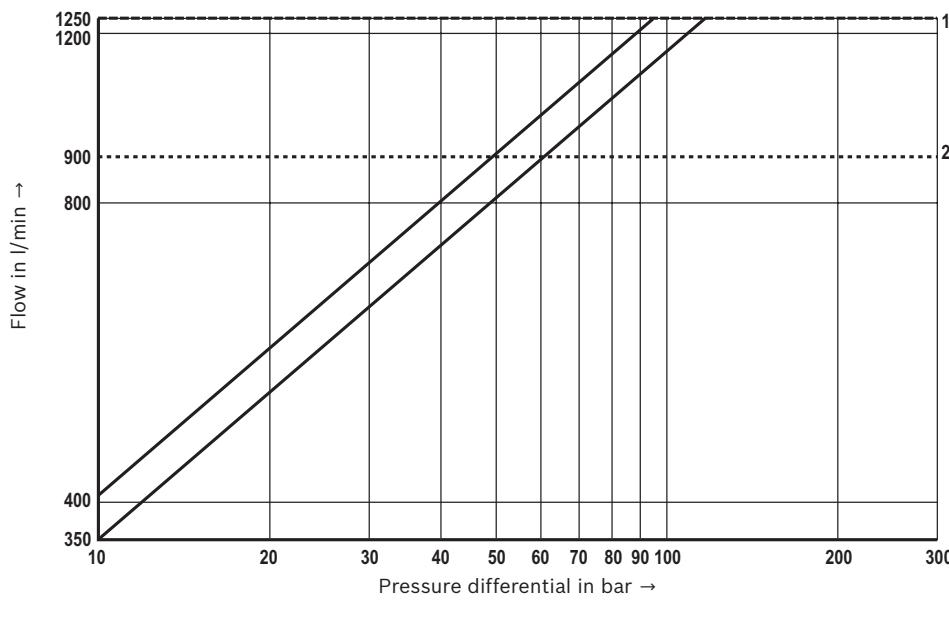


- 1 Maximum admissible flow
- 2 Recommended flow limitation  
(flow velocity 30 m/s)

**Characteristic curves:** Size 27  
 (measured with HLP46,  $\vartheta_{\text{oil}} = 40 \pm 5^\circ\text{C}$ )

**Transition function with stepped electric input signals**

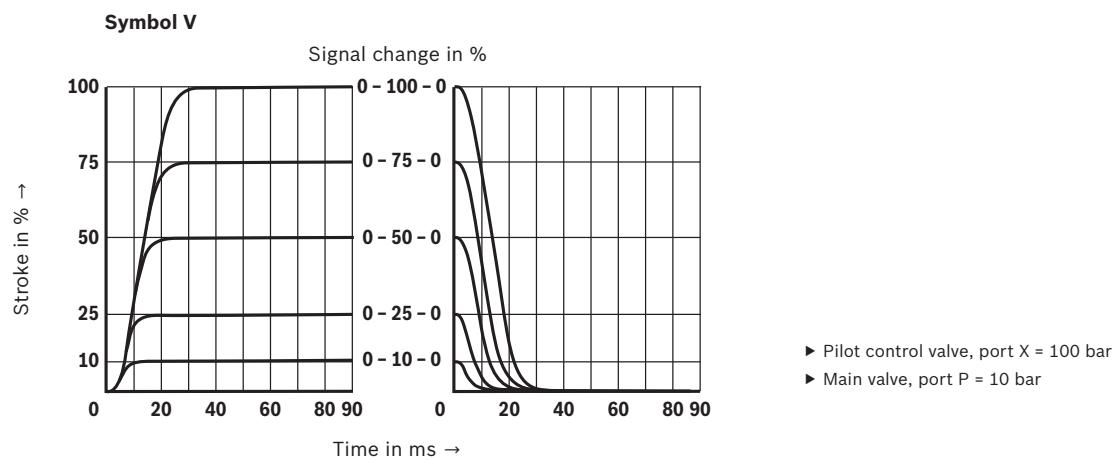

**Frequency response characteristic curves**

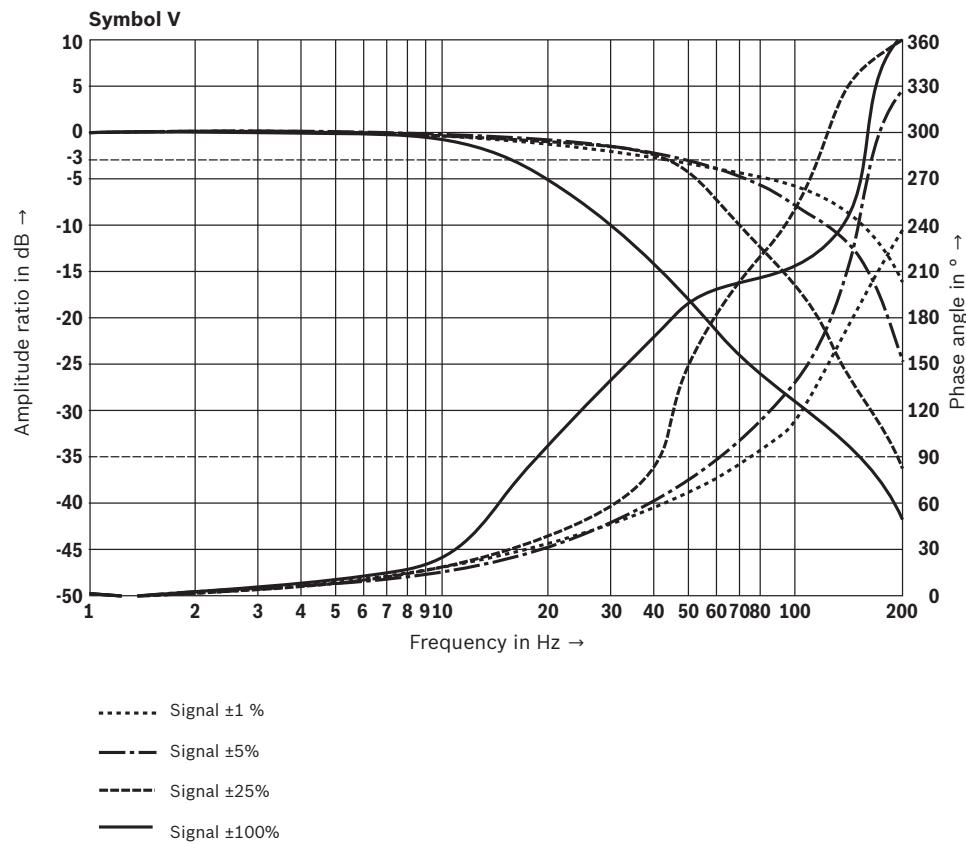


RE 29289, edition: 2017-09, **Bosch Rexroth AG**

28/40 4WRLD | Directional control valve

**Characteristic curves:** Size 27  
(measured with HLP46,  $\vartheta_{\text{oil}} = 40 \pm 5^\circ \text{C}$ )

**Flow/load function with maximum valve opening** (with maximum valve opening; tolerance  $\pm 10\%$ )

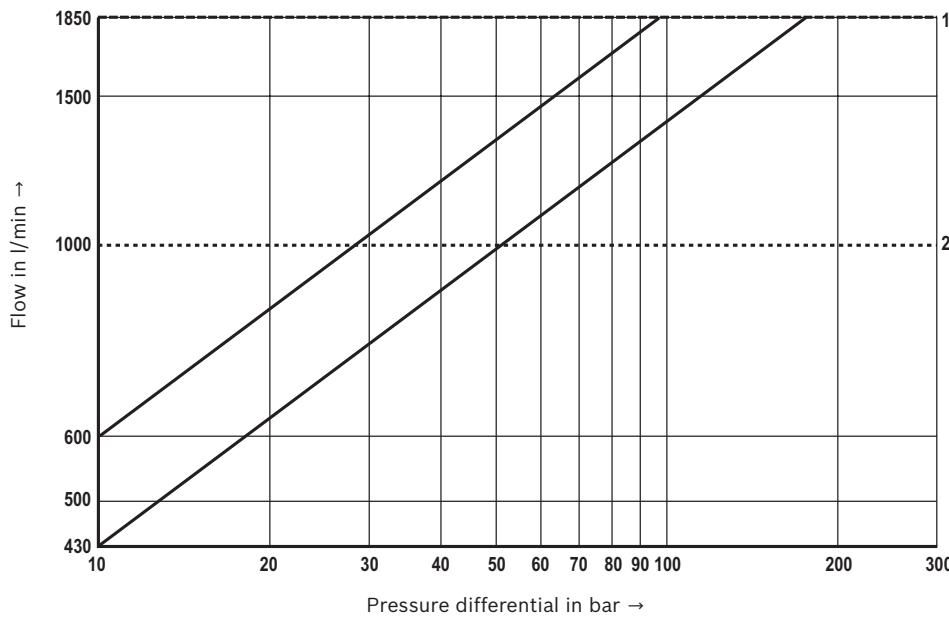


- 1 Maximum admissible flow
- 2 Recommended flow limitation  
(flow velocity 30 m/s)

**Characteristic curves:** Size 35  
 (measured with HLP46,  $\vartheta_{\text{oil}} = 40 \pm 5^\circ\text{C}$ )


**Transition function with stepped electric input signals**

**Symbols V and Q3-**

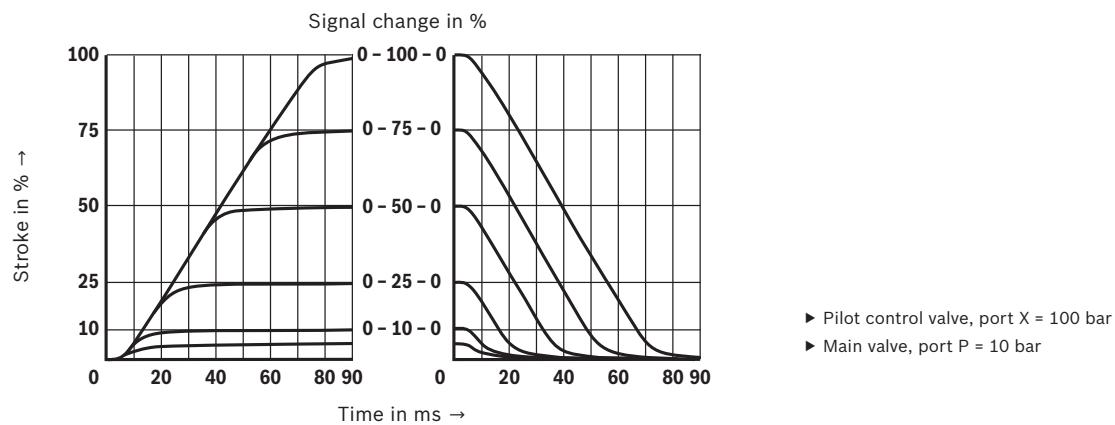

**Frequency response characteristic curves**


**Symbols V and Q3-**

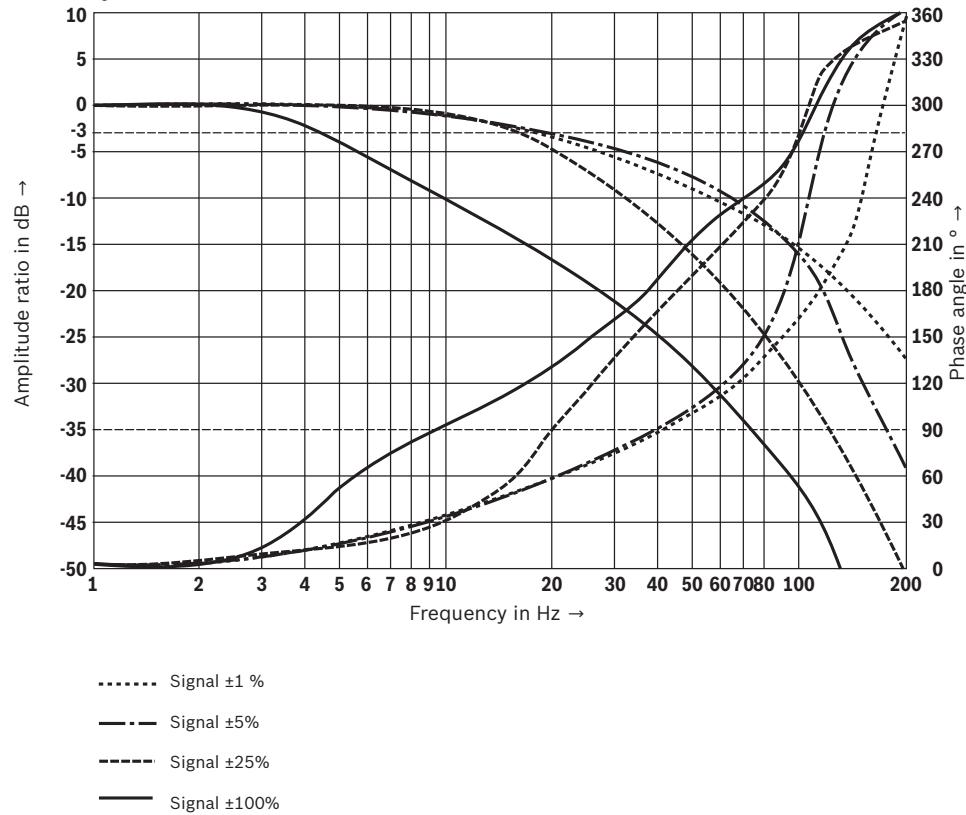

30/40 4WRLD | Directional control valve


**Characteristic curves:** Size 35  
(valid for HLP46,  $\vartheta_{\text{oil}} = 40 \pm 5^\circ\text{C}$ )

**Flow/load function with maximum valve opening** (with maximum valve opening; tolerance  $\pm 10\%$ )

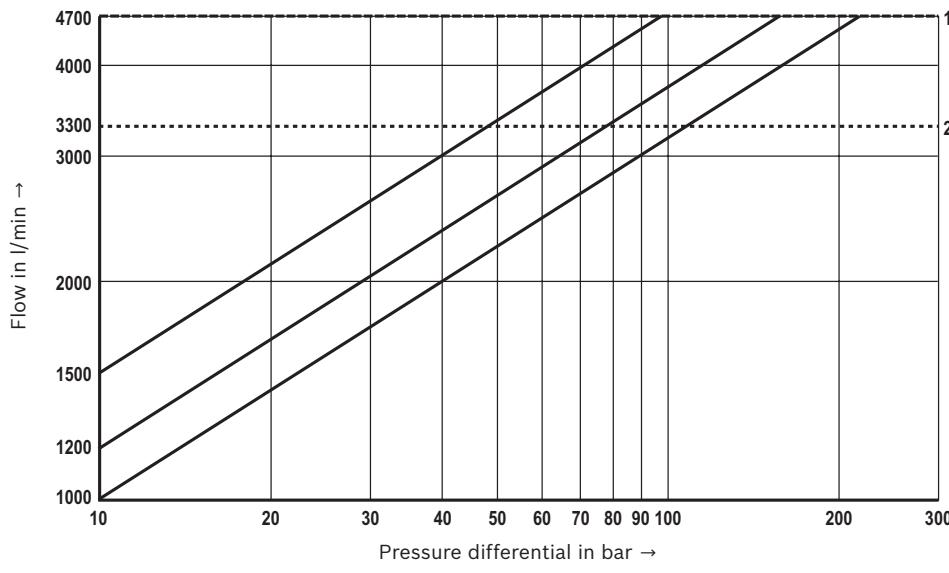


- 1 Maximum admissible flow
- 2 Recommended flow  
(flow velocity 30 m/s)

**Dimensions:** Size 10  
 (dimensions in mm)

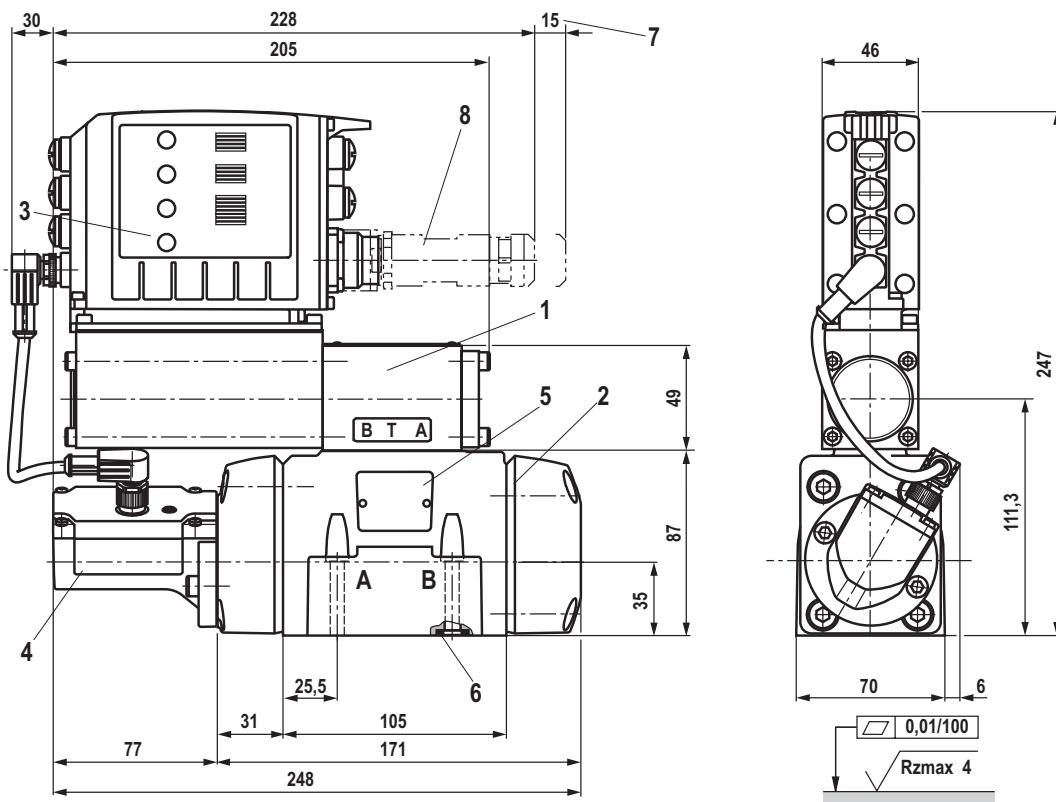

Required surface quality of  
 the valve contact surface

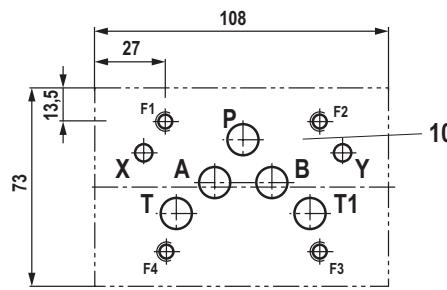

**Valve mounting screws and subplates,** see page 35.

- 1 Pilot control valve
- 2 Main valve
- 3 Integrated electronics (OBE)
- 4 Inductive position transducer (main valve)
- 5 Name plate
- 6 Identical seal rings for ports P, A, B, T;  
 Identical seal rings for ports X, Y
- 7 Space required for removing the mating connector
- 8 Mating connectors, separate order, see page 37 and  
 data sheet 08006.
- 9 Locking pin
- 10 Machined valve contact surface,  
 porting pattern according to ISO 4401-05-05-0-05


**Notes:**

The dimensions are nominal dimensions which are subject to tolerances.

RE 29289, edition: 2017-09, **Bosch Rexroth AG**

32/40 4WORLD | Directional control valve

**Dimensions:** Size 16  
 (dimensions in mm)

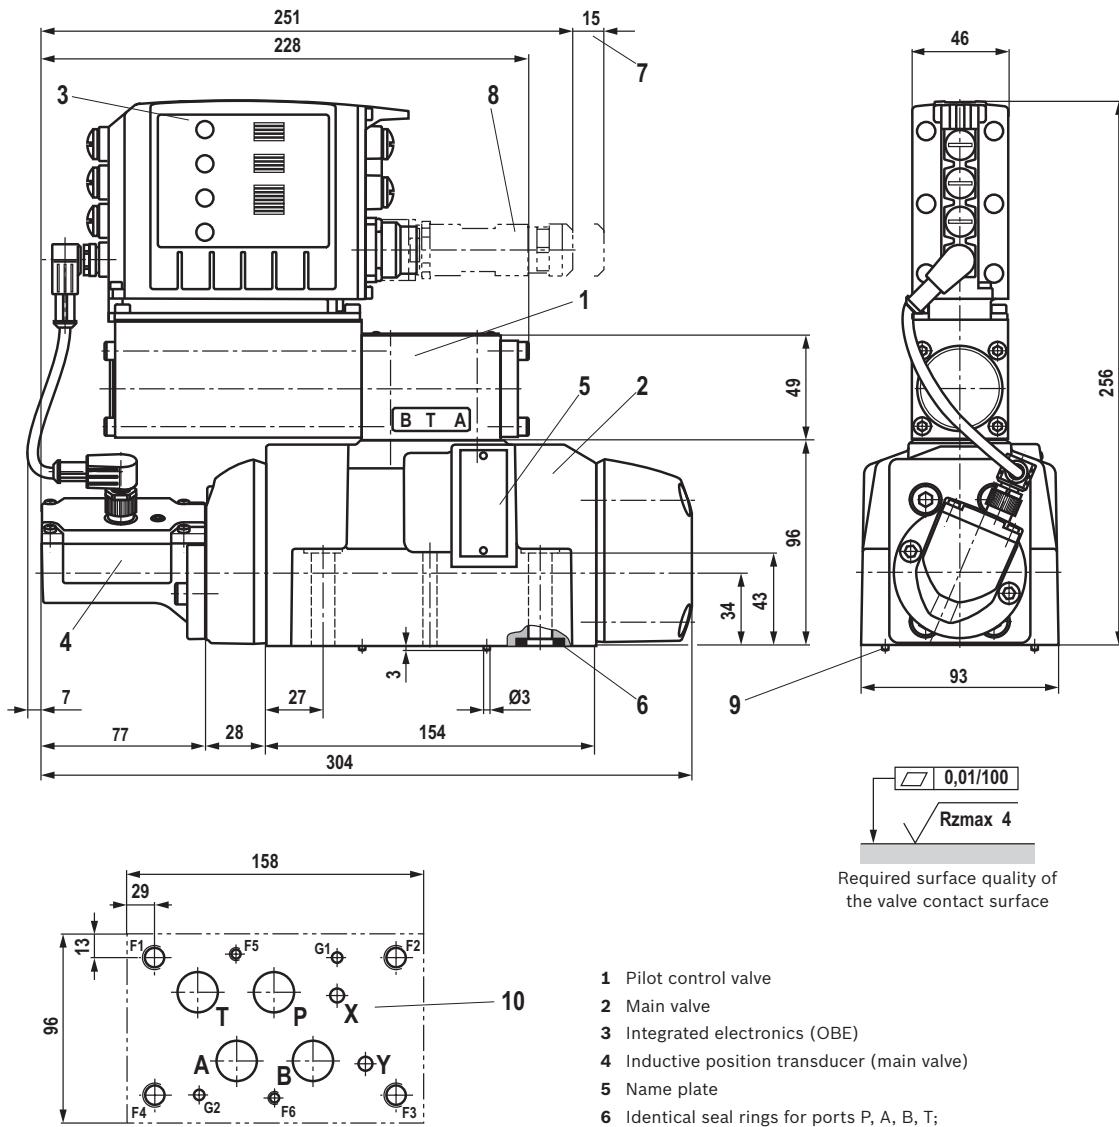


**Valve mounting screws** and **subplates**, see page 35.

**Notes:**


The dimensions are nominal dimensions which are subject to tolerances.

Bosch Rexroth AG, RE 29289, edition: 2017-09

**Dimensions:** Size 25 and 27  
 (dimensions in mm)

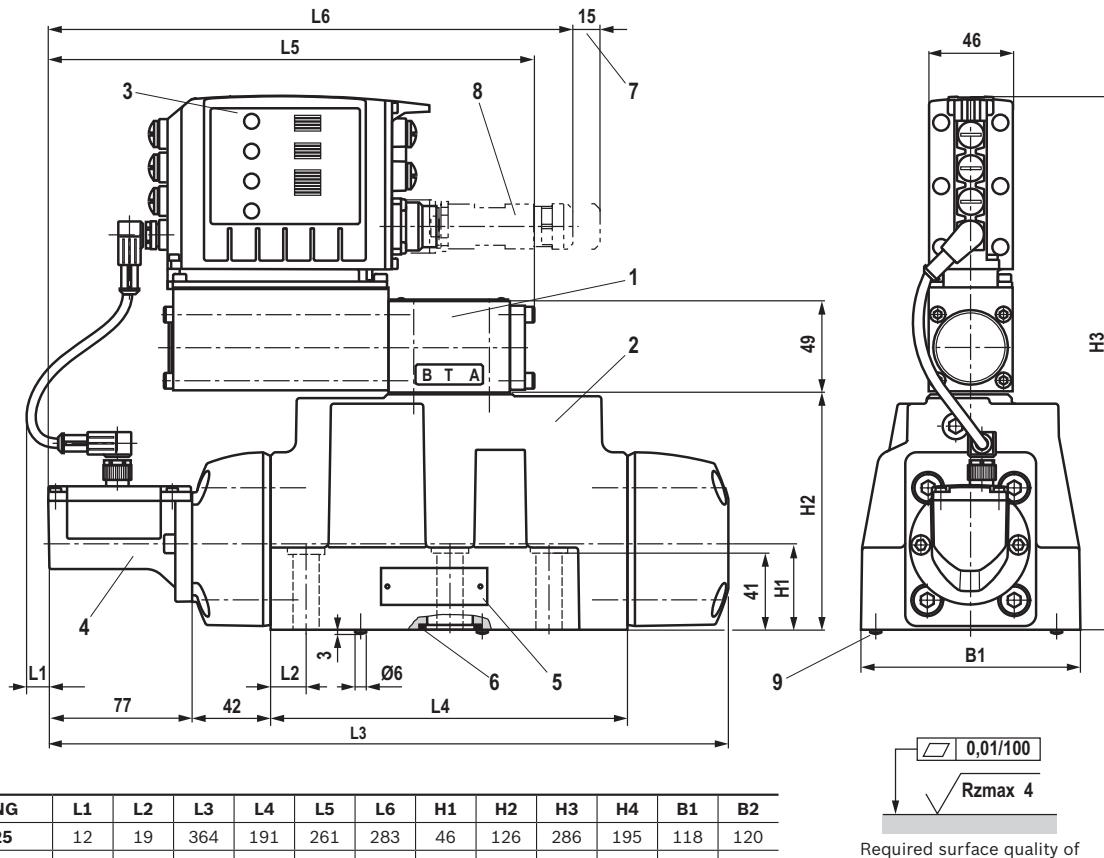

Required surface quality of  
 the valve contact surface

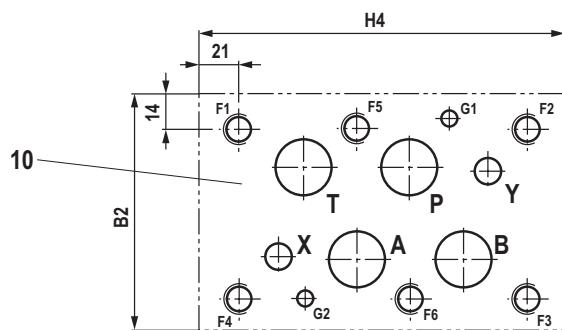

**Valve mounting screws and subplates,** see page 35.


**Notes:**

The dimensions are nominal dimensions which are subject to tolerances.


- 1 Pilot control valve
- 2 Main valve
- 3 Integrated electronics (OBE)
- 4 Inductive position transducer (main valve)
- 5 Name plate
- 6 Identical seal rings for ports P, A, B, T;  
 Identical seal rings for ports X, Y
- 7 Space required for removing the mating connector
- 8 Mating connectors, separate order, see page 37 and data sheet 08006.
- 9 Locking pin
- 10 Machined valve contact surface,  
 porting pattern according to ISO 4401-08-08-0-05  
 Deviating from the standard:  
  - NG25: Ports X, Y – Ø14 mm
  - NG27: Ports P, A, B, T – Ø32 mm
 Minimum screw-in depth:  
  - Ferrous metal: 1.5 x Ø
  - Non-ferrous metal: 2.0 x Ø

34/40 4WRLD | Directional control valve

**Dimensions:** Size 35  
 (dimensions in mm)

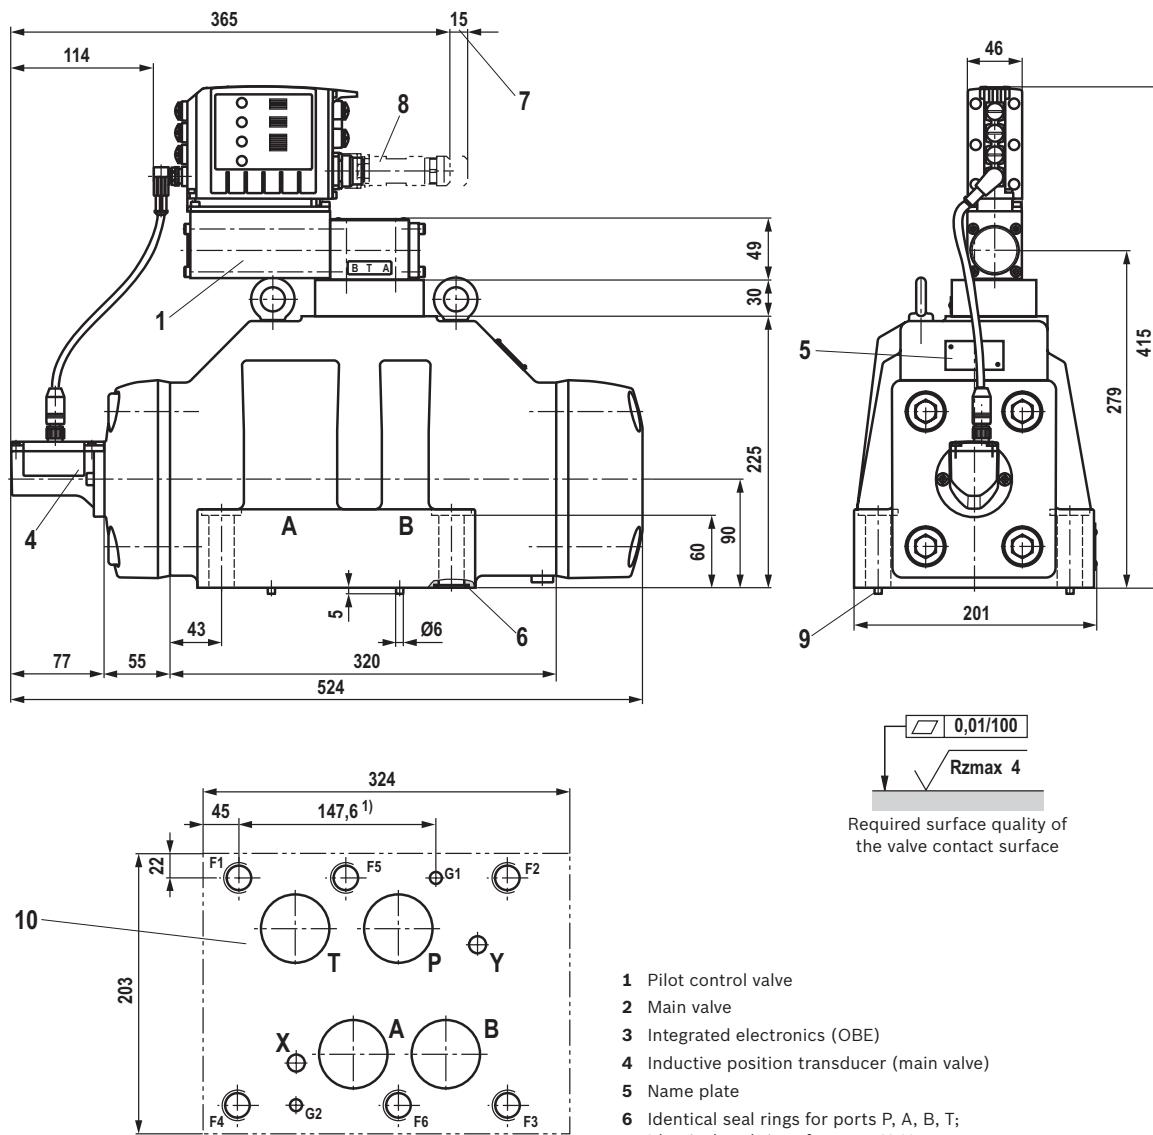

Required surface quality of  
 the valve contact surface



- 1 Pilot control valve
- 2 Main valve
- 3 Integrated electronics (OBE)
- 4 Inductive position transducer (main valve)
- 5 Name plate
- 6 Identical seal rings for ports P, A, B, T;  
 Identical seal rings for ports X, Y
- 7 Space required for removing the mating connector
- 8 Mating connectors, separate order, see page 37 and  
 data sheet 08006.
- 9 Locking pin
- 10 Machined valve contact surface,  
 porting pattern according to ISO 4401-10-09-0-05  
 Deviating from the standard:  
 Ports P, A, B, T – Ø50 mm  
<sup>1)</sup> Position G1 according to DIN 24340 Form A

**Notes:**

The dimensions are nominal dimensions which are subject to tolerances.

Bosch Rexroth AG, RE 29289, edition: 2017-09

## Dimensions

### Valve mounting screws (separate order)

Size	Quantity	Hexagon socket head cap screws	Material number
10	4	ISO 4762 - M6 x 45 - 10.9-CM-Fe-ZnNi-5-Cn-T0-H-B Tightening torque $M_A$ = 13.5 Nm ±10%	R913043777
	4	ISO 4762 - M6 x 45 - 10.9 Tightening torque $M_A$ = 15.5 Nm ±10%	Not included in the Rexroth delivery range
16	2	ISO 4762 - M6 x 60 - 10.9-flZn-240h-L Tightening torque $M_A$ = 12.2 Nm ±10%	R913000115
	4	ISO 4762 - M10 x 60 - 10.9-flZn-240h-L Tightening torque $M_A$ = 58 Nm ±20%	R913000116
25, 27	2	ISO 4762 - M6 x 60 - 10.9 Tightening torque $M_A$ = 15.5 Nm ±10%	Not included in the Rexroth delivery range
	4	ISO 4762 - M10 x 60 - 10.9 Tightening torque $M_A$ = 75 Nm ±20%	
25, 27	6	ISO 4762 - M12 x 60 - 10.9-flZn-240h-L Tightening torque $M_A$ = 100 Nm ±20%	R913000121
	6	ISO 4762 - M12 x 60 - 10.9 Tightening torque $M_A$ = 130 Nm ±20%	Not included in the Rexroth delivery range
35	6	ISO 4762 - M20 x 90 - 10.9-flZn/nc/480h/C Tightening torque $M_A$ = 465 Nm ±20%	R913009160
	6	ISO 4762 - M20 x 90 - 10.9 Tightening torque $M_A$ = 610 Nm ±20%	Not included in the Rexroth delivery range

 **Notes:**

- The tightening torque of the hexagon socket head cap screws refers to the maximum operating pressure.
- When replacing component series 3X with 4X, only the valve mounting screws listed here may be used. Prior to assembly, check the existing mounting bore on the block for sufficient screw-in depth.


**Subplates** (separate order) with porting pattern according to ISO 4401 see data sheet 45100.

36/40 4WORLD | Directional control valve


### Accessories (separate order)

#### Sensor connections X2M1 and X2M2

Cable set (analog sensors)	Length in m	Material number
Cable set for connection of the Rexroth pressure sensors type HM20, shielded, 5-pole, A coding, PUR/PVC, straight connector M12, on straight socket M12, line cross-section 0.34 mm <sup>2</sup>	0.6	R901111709
	1.0	R901111712
	2.0	R901111713
Shielded, 5-pole, A coding, straight connector M12, on free line end, line cross-section 0.34 mm <sup>2</sup>	1.5	R901111752
	3.0	R901111754
	5.0	R901111756
	10.0	R913005147

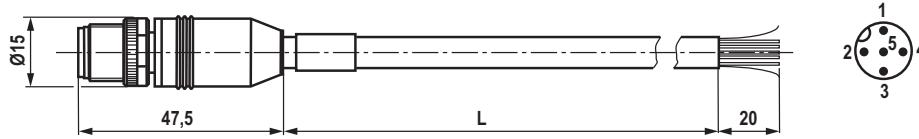

Plug-in connector (analog sensors)	View, dimensions	Material number
Plug-in connector, 5-pole, M12x1, pins, A coding, metal design (cable diameter 4 ... 6 mm)	see below	R901075542

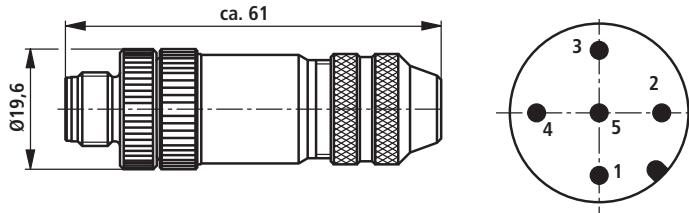

#### Sensor connection X8M

Cable set (SSI, 1Vpp only) <sup>1)</sup>	Length in m	Material number
Shielded, 8-pole, A coding, straight connector M12, on free line end, line cross-section 0.25 mm <sup>2</sup> (due to the diameter, two plug-in connectors of this type cannot be simultaneously used at X2M1 and X2M2)	10.0	R913002641

<sup>1)</sup> **Recommendation:** If an EnDat 2.2 sensor is used, please refer to the sensor manufacturer Heidenhain with respect to a cable set.

## Accessories (separate order)

### Ethernet connections X7E1 and X7E2


Cable set (Ethernet interface)	Length in m	Material number
Cable set, shielded, 4-pole, D coding, straight connector M12, on straight connector M12, line cross-section 0.25 mm <sup>2</sup> , CAT 5e	freely selectable (= xx.x)	<b>R911172111</b> (additionally indication of type designation RKB0040/xx.x)
Cable set, shielded, 4-pole, straight connector M12, on straight connector RJ45, line cross-section 0.25 mm <sup>2</sup> , CAT 5e	freely selectable (= xx.x)	<b>R911172135</b> (additionally indication of type designation RKB0044/xx.x)

### Protective cap


Protective cap M12	Version	Material number
		<b>R901075563</b>

### Port XH2

Mating connector	Version	Material number
Mating connector according to DIN EN 175201-804 (12-pole, metal design)	Mating connector (assembly kit) for a cable diameter of 12 ... 15 mm	<b>R901268000</b>
	Mating connector with 5 m cable, 12 x 0.75 mm <sup>2</sup> with cable shield, assembled	<b>R901272854</b>
	Mating connector with 20 m cable, 12 x 0.75 mm <sup>2</sup> with cable shield, assembled	<b>R901272852</b>

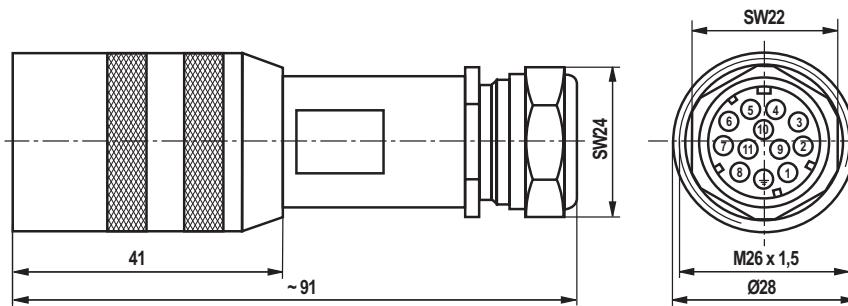

Mating connector according to DIN EN 175201-804 (12-pole, plastic variant)	Mating connector (assembly kit) Mating connector with 2 x 5 m cable, supply line (3 x 1.0 mm <sup>2</sup> ) and signal line (10 x 0.14 mm <sup>2</sup> ) separated, with cable shield, assembled	<b>R900884671</b> <b>R900032356</b>
	Mating connector with 2 x 20 m cable, supply line (3 x 1.0 mm <sup>2</sup> ) and signal line (10 x 0.14 mm <sup>2</sup> ) separated, with cable shield, assembled	<b>R900860399</b>

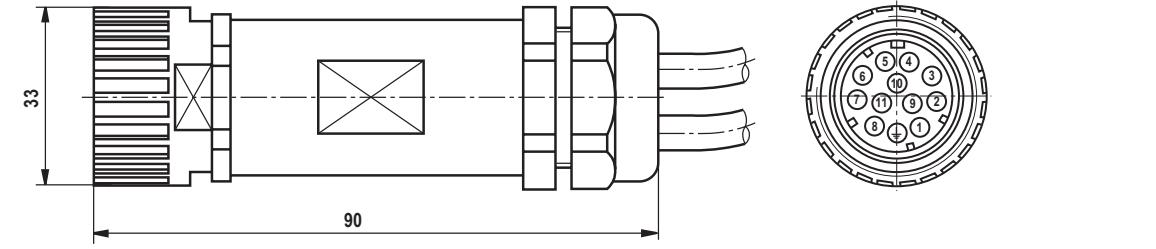


38/40 4WRLD | Directional control valve

### Accessories (separate order)

#### Parameterization

The following is required for the parameterization with PC		Material number/Download
1 Commissioning software	IndraWorks, Indraworks D, Indraworks DS	<a href="http://www.boschrexroth.com/IAC">www.boschrexroth.com/IAC</a>
2 Connection cable, 3 m	Shielded, M12 on RJ45, length can be freely selected (= xx.x)	<b>R911172135</b> (additionally indication of type designation RKB0044/xx.x)

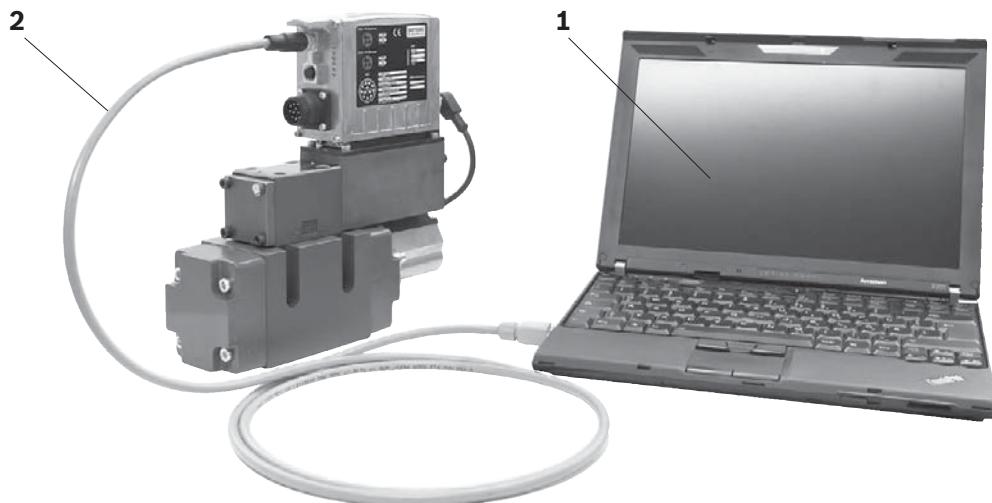

### Project planning and maintenance instructions

- ▶ The supply voltage must be permanently connected; otherwise bus communication is not possible.
- ▶ If electro-magnetic interference is to be anticipated, suitable measures must be taken to ensure the function (depending on the application, e. g. shielding, filtration)!
- ▶ The devices have been tested in the plant and are supplied with default settings.
- ▶ Only complete devices can be repaired. Repaired devices are returned with default settings. User-specific settings will not be applied. The machine end-user will have to retransfer the corresponding user parameters.

## Further information

- ▶ Directional control valve with integrated digital axis controller (IAC-Multi-Ethernet, component series 2X)  
Data sheet 29391 and 29391-B
- ▶ CE Declaration of Conformity  
upon request
- ▶ Subplates  
Data sheet 45100
- ▶ Hydraulic fluids on mineral oil basis  
Data sheet 90220
- ▶ Environmentally compatible hydraulic fluids  
Data sheet 90221
- ▶ Flame-resistant, water-free hydraulic fluids  
Data sheet 90222
- ▶ Flame-resistant hydraulic fluids - containing water (HFAE, HFAS, HFB, HFC)  
Data sheet 90223
- ▶ Hexagon socket head cap screw, metric/UNC  
Data sheet 08936
- ▶ Hydraulic valves for industrial applications  
Data sheet 07600-B
- ▶ General product information on hydraulic products  
Data sheet 07008
- ▶ Installation, commissioning and maintenance of servo valves and high-response valves  
Data sheet 07700
- ▶ Assembly, commissioning and maintenance of hydraulic systems  
Data sheet 07900
- ▶ Operation IAC-Multi-Ethernet electronics (xx = software version):
  - Functional description Rexroth HydraulicDrive HDx-xx
  - Parameter description Rexroth HydraulicDrive HDx-xx
  - Description of diagnosis Rexroth HydraulicDrive HDx-xx[www.boschrexroth.com/IAC](http://www.boschrexroth.com/IAC)
- ▶ Commissioning software and documentation on the Internet  
[www.boschrexroth.com/filter](http://www.boschrexroth.com/filter)
- ▶ Selection of filters  
[www.boschrexroth.com/spc](http://www.boschrexroth.com/spc)
- ▶ Information on available spare parts