

RE 91703/2023-11-02 Replaces: 2020-08-06



Axial piston variable motor A10VM Axial piston plug-in motor A10VE series 52



- ► Medium pressure motor with two-point control
- ▶ Sizes 28 to 85

Inhalt

Safety instructions

- ▶ Nominal pressure 280 bar
- ▶ Maximum pressure 350 bar
- Open and closed circuit

Features

- Variable displacement motor with well-tried A10-rotary unit technology
- ► Approved for high rotational speeds
- Long service life
- ► High power density
- ▶ Low noise
- ▶ Minimum swivel angle can be adjusted externally
- ► Swashplate design

Type code A10VM 2 Type code A10VE 4 6 Hydraulic fluids Working pressure range 8 Technical data 9 DG - Two-point control, direct operated 11 HZ/HZ6 - Two-point control, hydraulic 12 EZ1, EZ2, EZ6, EZ7 - Two-point control, electric 13 A10VM - Dimensions, size 28 to 85 14 A10VE - Dimensions, size 28 to 63 26 Flushing and boost-pressure valve 35 Speed sensing 36 Pin assignment, speed sensor DSA1 and DSA2 Order option C and K 36 Dimension A10VE with speed sensor DSAx and DST 37 Connector for solenoids 37 Installation instructions for A10VM 38 Installation instructions for A10VE 40 42 Project planning notes

RE 91703/2023-11-02, Bosch Rexroth AG

43



2 A10VM, A10VE series 52 | Axial piston variable motor Type code A10VM

Type code A10VM

01	02	03	04		05	06	07		80	09	10	11	12	13	14
A10	V M			1		W			V		С				
xial	piston unit	t													
01	Swashplat	e design,	variable,	nominal p	ressure 2	80 ba	r, maximu	m pressure	350 ba	ır					A10
pera	iting mode														
02	Motor, ope	n and clo	osed circui	it											М
Size (NG)														_
03	For geome	tric displ	acement,	see table (of values	, page	9				28	45	63	85]
Contr	ontrol devices 28 45 63 85														
04 Two-point control direct operated, external control pressure supply without on/off valve									•	•	•	•	DG		
	hydraulic			switching time orifice			withou	ut	•	•	•	•	HZ		
						<u> </u>		with		•	•	•	•	HZ6	
			electric		U =	_		withou	ut	•	•	•	•	EZ1	
			with swi	0	12 V				with		•	•	•	•	EZ6
				U =	S	witching t	ime orifice	withou	ut	•	•	•	•	EZ2	
					24 V				with		•	•	•	•	EZ7
Serie	5												28 .	85	
05	Series 5, i	ndex 2												•	52
Direc	tion of rota	ition											28 .	85	
06	Viewed on	drive sha	aft			٧	ariable/							•	W
Minin	num displa	cement									28	45	63	85	
07	$V_{ m g\;min}\;[m cm^3]$] steples	sly adjusta	able ¹⁾		fi	rom/to				8/28	12/25	16/38	22/50	1
						fı	rom/to				-	26/45	40/62	48/85	2
sealir	ng material	•											28 .	85	
80	FKM (fluor	oelastom	ner)											•	V
Orive	shaft														
09	Splined sh	aft simila	ar to ISO 3	8019-1		f	or high tor	que			•	•	•	•	R
						f	or reduced	d torque			-	•	•	•	W
/loun	ting flange	!											28 .	85	
10	Based on I	SO 3019	-1 (SAE); 2	2 hole										•	С

• = Available • = On request - = Not available

1) Please specify exact setting value in plain text.



Axial piston variable motor | **A10VM, A10VE series 52**Type code A10VM

01		02	03	04		05	06	07		08	09	10	11	12	13	14
A10	ν	М			/		W		-	V		С				
Work	ing p	port										28	45	63	85	
11		nge port 6162	s accord	ing to		nd B later e side,	ally, M	etric fast	ening thr	ead		•	•	•	•	10N00
		A and B; at rear; Metric fastening thread						ead		-	•	-	-	11N00		
	Threaded port according to A and B laterally, Threaded port, metric same side,							•	•	•	-	16N00				
		nge port 6162	s accord	ing to		nd B later e side,	ally, Fa	stening t	hread UN	F		•	•	•	•	60N00
					A ar	nd B ; at r	ear; Fa	stening t	hread UN	F		-	•	-	-	61N00
		eaded p 11926	ort acco	rding to		nd B later e side,	ally, Th	readed p	ort, UN			•	•	•	-	66N00
Valve	s											28	45	63	85	
12	Witl	hout val	ve									•	•	•	•	0
	l .	_	lushing v vorking l	valve line ports	10N00, (60N00 an	d 16N00), 66N00))			•	•	•	•	7
Speed	d ser	nsing										28	45	63	85	
13	Witl	hout spe	eed sens	ing (with	ut symb	ol)						•	•	•	•	
Conn	ecto	r for so	lenoids									28	45	63	85	
14	Witl	hout co	nnector ((without s	olenoid,	only for I	nydrauli	c control))			•	•	•	•	
	DEL	JTSCH -	molded	connecto	r, 2-pin –	without	suppres	sor diod	е			•	•	•	•	Р

• = Available • = On request - = Not available

Notice

- ▶ Note the project planning notes on page 42.
- ► In addition to the type code, please specify the relevant technical data when placing your order.

Type code, technical data, dimensions and information on the connector, plus safety instructions about the sensor can be found in the relevant data sheet 95131 (DST) or 95126 (DSA/20).



4 **A10VM, A10VE series 52** | Axial piston variable motor Type code A10VE

Type code A10VE

0°	$\overline{}$	02 E	03	04	,	05 52	06 W	07 T	1 _	08 V	09	10 F	11	12	13	14
			<u> </u>	<u> </u>		32	**									
4x1a 1	-	on unit	design v	variable	nominal p	ressure	280 har	maxim	ıım nressi	ıre 350 h	ar					A10
			acoign, i	variable,	nommat p		200 541	, maxim	um pressi	are 000 B						1 7.0
02		mode	-in design	n onen a	nd closed	circuits	:									E
	(NG)	o., p.a.	400.8.	., ., .,	0.0000		·									
03		geomet	ric displa	cement.	see table	of value	s. page	9					28	45	63	1
							., [28	45	63	1
Control devices 28 45 63 04 Two-point control direct operated, external control pressure supply without on/off valve • o												DG				
				hydrau					witching t			ithout	•	•	•	HZ
											w	ith	•	•	•	HZ6
				electri	С	<i>U</i> = 1	2 V	S	witching t	ime orific	e w	ithout	•	•	•	EZ1
				with s	witching oid						W	ith	•	•	•	EZ6
						<i>U</i> = 2	4 V	S	witching t	ime orific	e w	ithout	•	•	•	EZ2
											W	ith	•	•	•	EZ7
Serie	s														28 63	
05	Seri	es 5, in	dex 2												•	52
Direc	tion	of rotat	tion												28 63	
06	Viev	ved on	drive shat	ft				\	ariable/						•	w
Mini	num	displac	ement										28	45	63	
07	$V_{g\;m}$	_{iin} [cm³]	stepless	ly adjust	able ¹⁾			f	rom/to				10/28	12/25	16/38	1
								f	rom/to				_	26/45	40/62	2
Seali	ng m	aterial													28 63	
80	FKN	1 (fluoro	elastome	er)											•	V
Drive	shaf	ft											28	45	63	
09	Spli	ned sha	ıft similar	r to ISO 3	3019-1	for hi	gh torqu	е					•	•	•	R
						for re	duced to	orque					-	•	•	W
Mour	nting	flange													28 63	
10	Spe	cial flar	nge; 2 hol	le											•	F

• = Available • = On request - = Not available

¹⁾ Please specify exact setting value in plain text.

5



Axial piston variable motor | **A10VM, A10VE series 52**Type code A10VE

01		02	03	04		05	06	07		08	09	10	11	12	13	14
A10	V	Е			/	52	W		-	V		F				
Work	ing p	ort											28	45	63	
11	Flan	ge port	s accord	ing to ISO	0 6162		d B latera	ılly, M	l etric fast	ening thr	ead		•	•	•	10N00
						A and	B; at re	ar; M	letric fast	ening thr	ead		-	•	-	11N00
	Threaded port according to DIN 3852-1 A and B laterally, Threaded port, metric same side,							•	•	•	16N00					
	Flange ports according to ISO 6162 A and B laterally, Fastening thread UNF same side,								•	•	•	60N00				
						A and	B; at re	ar; Fa	astening t	read UN	IF		-	•	-	61N00
	Thre	aded p	ort accor	rding to I	SO 11926		d B latera side,	ılly, TI	hreaded p	ort, UN			•	•	•	66N00
Valve	s												28	45	63	
12	With	out val	.ve										•	•	•	0
	Integ	grated 1	flushing v	/alve (onl	y with wo	king lin	e ports 1	ON00, 6	60N00 and	I 16N00,	66N00)		-	•	•	7
Speed	d sen	sing											28	45	63	
13	With	out sp	eed sens	ing (with	out symbo	l)							•	•	•	
	Prep	ared fo	r sensor	DST or D	SAx/20								0	0	-	W
	Sens	or DSA	1/20 mc	unted (1	= one fred	uency a	and direc	tion of ı	rotation si	gnal)			0	0	-	C ¹⁾
	Sens	or DSA	2 /20 mc	ounted (2	= two 90°	phase-	shifted fr	equency	y signals)				0	0	-	K ¹⁾
	DST	sensor	mounte	d									0	0	_	E ¹⁾
Conn	ector	for so	lenoids										28	45	63	
14	With	out co	nnector (without	solenoid, c	nly for	hydraulic	control	L)				•	•	•	
	DEUTSCH - molded connector, 2-pin – without suppressor diode							•	•	•	Р					

• = Available • = On request - = Not available

Notice

- ▶ Note the project planning notes on page 42.
- ► In addition to the type code, please specify the relevant technical data when placing your order.

Type code, technical data, dimensions and information on the connector, plus safety instructions about the sensor can be found in the relevant data sheet 95131 (DST) or 95126 (DSAx/20).



6 A10VM, A10VE series 52 | Axial piston variable motor Hydraulic fluids

Hydraulic fluids

The variable displacement motor A10VM/A10VE is designed for operation with HLP mineral oil according to DIN 51524.

Application instructions and requirements for hydraulic fluid selection, behavior during operation as well as disposal and environmental protection should be taken from the following data sheets before the start of project planning:

- 90220: Hydraulic fluids based on mineral oils and related hydrocarbons
- ▶ 90221: Environmentally acceptable hydraulic fluids

Selection of hydraulic fluid

Bosch Rexroth evaluates hydraulic fluids on the basis of the Fluid Rating according to the technical data sheet 90235.

Hydraulic fluids with positive evaluation in the Fluid Rating are listed in the following data sheet:


▶ 90245: Bosch Rexroth Fluid Rating List for Rexroth hydraulic components (pumps and motors)

The hydraulic fluid should be selected so that the operating viscosity in the operating temperature range is within the optimum range ($\nu_{\rm opt}$; see selection diagram).

Viscosity and temperature of hydraulic fluids

	Viscosity	Shaft seal	Temperature ²⁾	Remarks
Cold start	$v_{\text{max}} \le 1600 \text{ mm}^2/\text{s}$	FKM	$\theta_{St} \ge -25^{\circ}C$	$t \le 3$ min, without load ($p \le 30$ bar), $n \le 1000$ rpm Permissible temperature difference between axial piston unit and hydraulic fluid in the system maximum 25 K
Warm-up phase	ν = 1600 400 mm ² /s			$t \le 15 \text{ min}, p \le 0.7 \times p_{\text{nom}} \text{ and } n \le 0.5 \times n_{\text{nom}}$
Permissible	$\nu = 400 \dots 10 \text{ mm}^2/\text{s}^{1)}$	FKM	θ ≤ +110°C	Measured at port L _X
operating range	$v_{\rm opt}$ = 36 16 mm ² /s			Optimal operating viscosity and efficiency range
Short-term operation	$v_{min} = 10 7 \text{ mm}^2/\text{s}$	FKM	θ ≤ +110°C	$t \le 1 \text{ min, } p \le 0.3 \times p_{\text{nom}}$, measured at port L_X

▼ Selection diagram

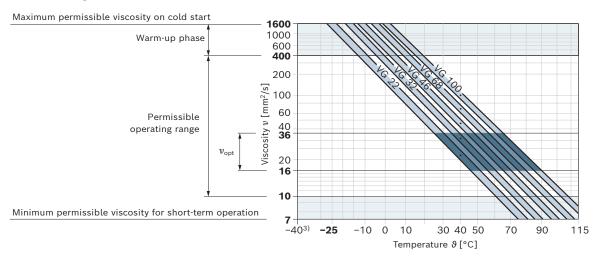

This corresponds, for example on the VG 46, to a temperature range of +4°C to +85°C (see selection diagram)

²⁾ If the temperature at extreme operating parameters cannot be adhered to, please contact us.

³⁾ For applications in the low-temperature range, please contact us.

7



Axial piston variable motor | **A10VM, A10VE series 52** Hydraulic fluids

Filtration of the hydraulic fluid

Finer filtration improves the cleanliness level of the hydraulic fluid, which increases the service life of the axial piston unit.

A cleanliness level of at least 20/18/15 under ISO 4406 should be maintained.

At a hydraulic fluid viscosity of less than 10 mm²/s (e.g. due to high temperatures during short-term operation) at the drain port, a cleanliness level of at least 19/17/14 under ISO 4406 is required.

Examples of temperatures of hydraulic fluids at a viscosity of 10 mm²/s:

- ▶ 73 °C at HLP 32
- ▶ 85 °C at HLP 46




8 **A10VM, A10VE series 52** | Axial piston variable motor Working pressure range

Working pressure range


Pressure at working port A or B		Definition
Nominal pressure p_{nom}	280 bar	The nominal pressure corresponds to the maximum design pressure.
Maximum pressure p_{\max}	350 bar	The maximum pressure corresponds to the maximum working
Single operating period	2.5 ms	pressure within a single operating period. The sum of single operating
Total operating period	300 h	periods must not exceed the total operating period.
Minimum pressure $p_{HD \ absolute}$ (high-pressure side)	10 bar	Minimum pressure on the high-pressure side (A or B) required to prevent damage to the axial piston unit.
Rate of pressure change $R_{ m A\ max}$	16000 bar/s	Maximum permissible speed of pressure build-up and reduction during a pressure change across the entire pressure range.
Pressure at port A or B (low-pre	ssure side)	
Minimum pressure $p_{ m ND \; min}$	2 bar absolute	Minimum pressure on the low-pressure side (A or B) required to prevent damage to the axial piston unit (see diagram, page 9).
Leakage pressure at port L, L ₁		
Max. static pressure $p_{ m L\ max}$	2 bar absolute	Maximum 0.5 bar higher than inlet pressure at port A or B , but not higher than $p_{\text{L max}}$. A drain line to the reservoir is required.

▼ Pressure definition



Total operating period = $t_1 + t_2 + ... + t_n$

▼ Rate of pressure change R_{A max}



Flow direction

Direction of rotation viewed on drive shaft	clockwise	Counter-clockwise
	B to A	A to B

Notice

Working pressure range applies when using hydraulic fluids based on mineral oils. Please contact us for values for other hydraulic fluids.

9




Axial piston variable motor | A10VM, A10VE series 52

Technical data

Technical data

Size			NG		28	45	63	85
Displacement geometric, per re-	volution		$V_{g\;max}$	cm ³	28	45	62	87
			V _{g min} *)	cm ³	8(VM) 10 (VE)	12	16	22
Maximum rotational speed $^{1)2)}$ at $V_{ m gmax}$			n_{nom}	rpm	4700	4000	3300	3100
	at $V_{ m g\ min}$		$n_{max\ perm}$	rpm	5400	4600	3900	3560
Minimum rotational speed continuous operation	at $V_{ m g\ max}$		n_{min}	rpm	250	250	250	250
Inlet flow	at n_{nom} and V_{gmax}		$q_{ m v\; max}$	l/min	131.6	180	205	270
Torque	at $V_{ m g\;max}$ and $p_{ m N}$ = 280 bar		$M_{\sf max}$	Nm	125	200	276	387
Actual starting torque, approx.	at n = 0 rpm and p_N = 280	bar	M	Nm	92	149	205	253
Rotary stiffness of drive shaft		R	c	Nm/rad	2600	41000	69400	152900
		W	c	Nm/rad	19800	34400	54000	117900
Moment of inertia of the rotary	group		JTW	kgm ²	0.0017	0.0033	0.0056	0,012
Maximum angular acceleration ³)		α	rad/s²	5500	4000	3300	2700
Case volume			V	l	0.6	0.7	0.8	1.0
Weight approx.			m	kg	14	18	26	34

Permissible motor speed depending on output pressure (low pressure)

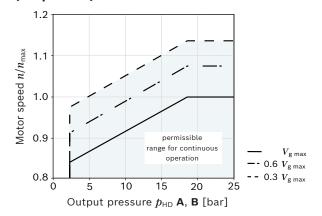

Notice

- ▶ Theoretical values, without efficiency and tolerances; values rounded
- Operation above the maximum values or below the minimum values may result in a loss of function, a reduced service life or in the destruction of the axial piston unit. Bosch Rexroth recommends checking loads through tests or calculation/simulation and comparing them with the permissible values.
- Setting of minimum displacement*): The minimum displacement can be steplessly adjusted within the ranges (or screw length) of type code position 1 or 2.

Please specify minimum displacement in plain text. For formulas to determine the characteristics, see page 10

- for the optimum viscosity range from v_{opt} = 36 to 16 mm²/s
- with hydraulic fluid based on mineral oils
- 2) The maximum rotational speed depends on the output pressure at the working port A (B) (see diagram).

¹⁾ The values are applicable:

³⁾ The data are valid for values between the minimum required and maximum permissible rotational speed. Valid for external excitation (e.g. diesel engine 2 to 8 times rotary frequency; cardan shaft twice the rotary frequency). The limit value is only valid for a single pump. The load capacity of the connection parts must be considered.



10 **A10VM, A10VE series 52** | Axial piston variable motor Working pressure range

Determination of the characteristics								
Flow	$q_{\scriptscriptstyle extsf{V}}$	= -	$\frac{V_{\rm g} \times n}{1000 \times \eta_{\rm v}}$			[l/min]		
Torque	М	= -	$\frac{1.59 \times V_{\rm g} \times \Delta p \times \eta_{\rm hm}}{100}$			[Nm]		
Power	P	= -	2 π×M×n 60000	=	$q_{\text{v}} \times \Delta p \times \eta_{\text{t}}$ 600	- [kW]		
Output speed	n	= -	$q_{ m V}$ × 1000 × $\eta_{ m V}$			[rpm]		

Key

 $V_{\rm g}$ = Displacement per revolution [cm³]

 Δp = Differential pressure [bar] n = Rotational speed [rpm] η_{v} = Volumetric efficiency

 $\eta_{\rm hm}$ = Hydraulic-mechanical efficiency $\eta_{\rm t}$ = Total efficiency $(\eta_{\rm t} = \eta_{\rm v} \times \eta_{\rm hm})$

Permissible radial and axial loading on the drive shafts

Size	_	NG	28	45	63	85
Maximum radial force at X/2	X/2 X/2 X	$F_{ m q\;max}$ N	1200	1500	1700	2000
Maximum axial force	Fax +	± $F_{\text{ax max}}$ N	1000	1500	2000	3000

Notice

► The specified values are maximum values and must not be exceeded in continuous operation. For radial and axial loading, please contact us.



Axial piston variable motor | **A10VM, A10VE series 52**DG – Two-point control, direct operated

11

DG - Two-point control, direct operated

The variable displacement motor is set to minimum swivel angle by connecting an external switching pressure to port $G(G_1)$.

This will supply control fluid directly to the stroking piston; a minimum control pressure of $p_{\rm st} \ge 40$ bar is required.


The variable displacement motor can only be switched between $V_{\rm g\ max}$ or $V_{\rm g\ min}$. $V_{\rm g\ min}$ Please specify the pre-setting in plain text.

Please note that the required switching pressure at port $G(G_1)$ is directly dependent on the actual working pressure p_B in port A or B. (See switching pressure characteristic curve).


The maximum permissible switching pressure is 280 bar.

- ▶ Switching pressure p_{st} in **G** (**G**₁) = 0 bar $\triangle V_{g max}$
- ▶ Switching pressure $p_{\rm st}$ in **G** (**G**₁) ≥ 40 bar $\triangle V_{\rm g \, min}$

▼ Switching pressure characteristic curve

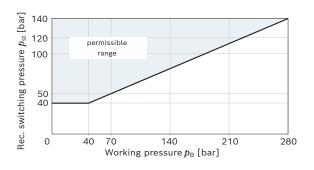

▼ Circuit diagram





12 **A10VM, A10VE series 52** | Axial piston variable motor HZ/HZ6 – Two-point control, hydraulic

HZ/HZ6 - Two-point control, hydraulic


The variable motor is set to minimum swivel angle by connecting the pilot pressure $p_{\mathbf{X}}$ to port \mathbf{X} ($p_{\mathbf{X}} \ge 30$ bar). This supplies the stroking piston with control pressure via the on/off valve.

The control pressure is taken internally from the relevant high-pressure side; a minimum working pressure difference of $\Delta p_{\rm A,B} \ge 30$ bar is required.

The motor can only be switched between $V_{\rm g\;max}$ oder $V_{\rm g\;min}$. $V_{\rm g\;min}$ - pre-setting for order please state in plain text.

Pilot pressure $p_{\rm X} \le 10$ bar $\triangle V_{\rm g\ max}$ Pilot pressure $p_{\rm X} \ge 30$ bar $\triangle V_{\rm g\ min}$

▼ HZ/HZ6 characteristic curve

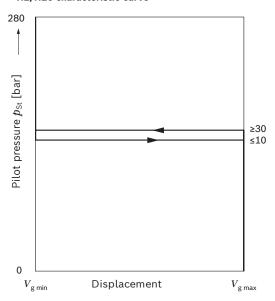

HZ/HZ6 characteristics		
Minimum pilot pressure	30 bar	
Maximum permissible pi-	280 bar	
lot pressure		

Version HZ6 with orifice for the switching time extension


The switching process is delayed by an orifice.

This allows for damped switching.


Standard orifice diameter is 0.25 mm.

Other orifice diameters upon request.

▼ HZ circuit diagram



▼ HZ6 circuit diagram

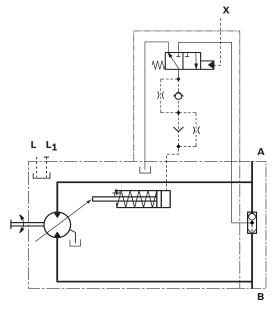



Axial piston variable motor | **A10VM, A10VE series 52** EZ1, EZ2, EZ6, EZ7 – Two-point control, electric

С

13

EZ1, EZ2, EZ6, EZ7 - Two-point control, electric


The variable displacement motor is set to minimum swivel angle by actuating the switching solenoid.

This supplies the stroking piston with control pressure via the on/off valve.

The control pressure is taken internally from the relevant high-pressure side; a minimum working pressure difference of $\Delta p_{\mathbf{A},\mathbf{B}} \geq 30$ bar is required.

The motor can only be switched between $V_{\rm g\;max}$ oder $V_{\rm g\;min}$. $V_{\rm g\;min}$ - pre-setting for order please state in plain text.

▼ EZx characteristic curve



De-energized	\triangle	$V_{g\;max}$
Energized	\triangle	$V_{g\;min}$

Solenoid technical data	EZ1/EZ6	EZ2/EZ7
Nominal voltage	12V DC ±15%	24V DC ±15%
Nominal current at 20 °C	1.5 A	0.8 A
Duty cycle	100%	100%
Type of protection of	see connector fo	or solenoids
device connector	on page 37	
Ambient temperature	-20 °C to +60 °C	>
Hydraulic fluid temperature	-20 °C to +100 °	C
Viscosity range in continuous	10 mm ² /s to 420	0mm ² /s ¹⁾
operation		


Please contact us if the temperature and viscosity ranges cannot be complied with.

EZ6/EZ7 version with orifice for switching time extension


The switching process is delayed by an orifice. This allows for damped switching. Standard orifice diameter is 0.25 mm. Other orifice diameters upon request.

1) In the range between 420 mm²/s and 1600 mm²/s only limited function

▼ EZ1/EZ2 circuit diagram



▼ EZ6/EZ7 circuit diagram






14 A10VM, A10VE series 52 | Axial piston variable motor A10VM - Dimensions, size 28 Dimensions [mm]

A10VM - Dimensions, size 28

DG - Two-point control, direct operated

Port plate 10 (60) and 16 (66) N000

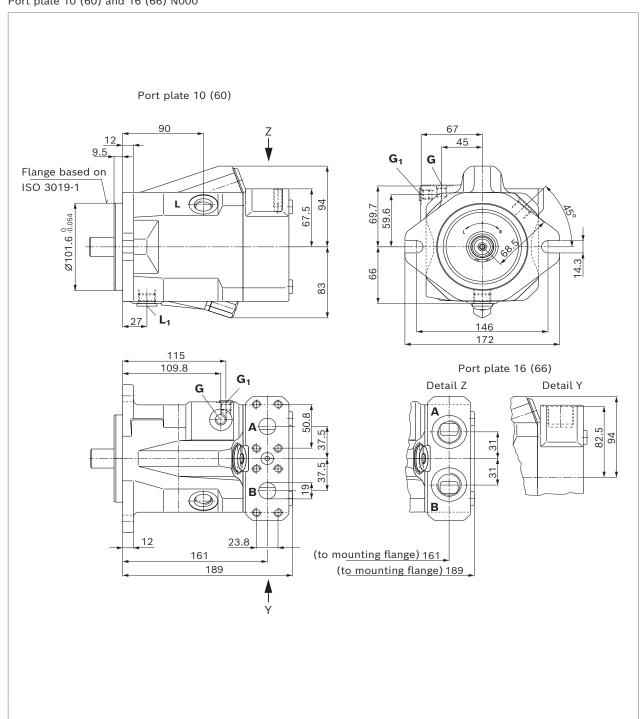




Axial piston variable motor | A10VM, A10VE series 52 15

A10VM - Dimensions, size 28

▼ Splined shaft 7/8 in (similar to ISO 3019-1)

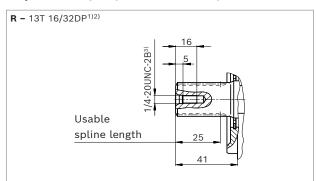

Port pl	ate ports	Standard	Size	$p_{\sf max}$ [bar] $^{4)}$	State ⁷⁾
Port pl	ate 10				
A , B	Working port (high-pressure series) Fastening thread	ISO 6162-2 DIN 13	3/4 in M10 × 1.5; 17 deep	350	0
Port pl	ate 60				
A, B Working port (high-pressure series) Fastening thread		ISO 6162-2 ASME B1.1	3/4 in 3/8-16UNC-2B; 21 deep	350	0
Port pl	ate 16				
A , B	Working port	DIN 3852-1	M27 × 2; 16 deep	350	Ο
Port pl	ate 66				
A , B	Working port	ISO 11926	1 1/16-12UN-2B; 20 deep	350	0
Other p	oorts				
L	Drain port	ISO 11926 ⁵⁾	3/4-16UNF-2B; 15 deep	4	O ⁶⁾
L ₁	Drain port	ISO 11926 ⁵⁾	3/4-16UNF-2B; 15 deep	4	X ⁶⁾
G	External control pressure (with DG control)	ISO 11926 ⁵⁾	7/16-20UNF-2B; 12 deep	350	0
G ₁	External control pressure (with DG control)	ISO 11926 ⁵⁾	7/16-20UNF-2B; 12 deep	350	X
х	Pilot pressure (with HZ control)	ISO 11926	7/16-20UNF-2B; 12 deep	350	0

X = Plugged (in normal operation)

¹⁾ Involute spline according to ANSI B92.1a, 30° pressure angle, flat root, side fit, tolerance class 5

²⁾ Spline runout is a deviation from the ISO 3019-1 standard.

 $[\]scriptstyle{
m 3)}$ Thread according to ASME B1.1

⁴⁾ Depending on the application, momentary pressure peaks can occur. Keep this in mind when selecting measuring devices and fittings.

⁵⁾ The countersink may be deeper than specified in the standard.

 $_{\rm 6)}$ Depending on the installation position, L or $L_{\rm 1}$ must be connected (see also installation instructions on pages 38 and 39).


⁷⁾ O = Must be connected (plugged on delivery)




16 **A10VM, A10VE series 52** | Axial piston variable motor A10VM – Dimensions, size 28

Dimensions [mm]

▼ **HZ, HZ6** - Two-point control, hydraulic

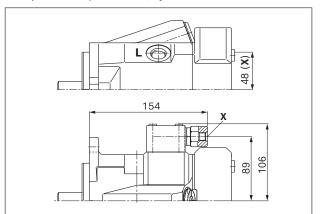



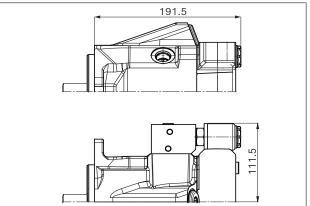

17




Dimensions [mm]

Axial piston variable motor | **A10VM, A10VE series 52** A10VM – Dimensions, size 45

A10VM - Dimensions, size 45

DG - Two-point control, direct operated

Port plate 10 (60), 16 (66) and 11 (61) N000

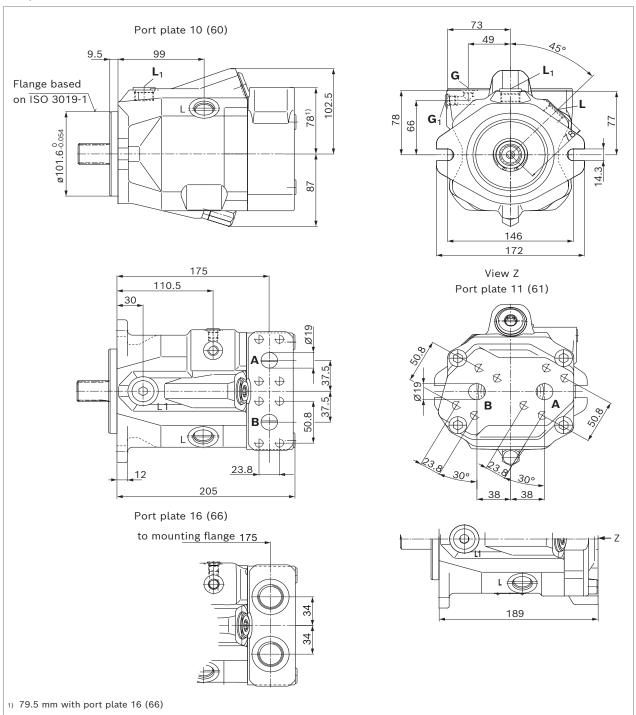





18 **A10VM, A10VE series 52** | Axial piston variable motor A10VM – Dimensions, size 45

Dimensions [mm]

▼ Splined shaft (similar to ISO 3019-1)

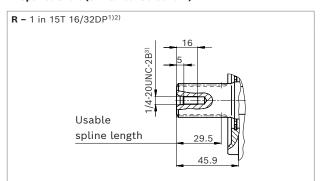

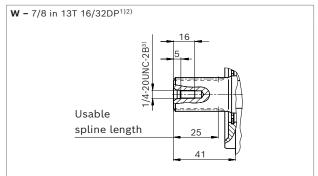

Port pl	ate ports	Standard	Size	$p_{\sf max}$ [bar] $^{4)}$	State ⁷⁾
Port pl	ate 10; 11				
А, В	Working port (high-pressure series) Fastening thread	ISO 6162-2 DIN 13	3/4 in M10 × 1.5; 17 deep	350	0
Port pl	ate 60; 61				
А, В	Working port (high-pressure series) Fastening thread	ISO 6162-2 ASME B1.1	3/4 in 3/8-16UNC-2B; 21 deep	350	0
Port pl	ate 16				
A , B	Working port	DIN 3852-1	M27 × 2; 16 deep	350	0
Port pl	ate 66				
A, B	Working port	ISO 11026	1 1/16-12UN-2B; 20 deep	350	0
Other p	oorts	'			
L	Drain port	ISO 11926 ⁵⁾	7/8-14UNF-2B; 17 deep	4	O ⁶⁾
L ₁	Drain port	ISO 11926 ⁵⁾	7/8-14UNF-2B; 17 deep	4	X ⁶⁾
G	External control pressure (with DG control)	ISO 11926 ⁵⁾	7/16-20UNF-2B; 12 deep	350	0
G ₁	External control pressure (with DG control)	ISO 11926 ⁵⁾	7/16-20UNF-2B; 12 deep	350	Х
х	Pilot pressure (with HZ control)	ISO 11926	7/16-20UNF-2B; 12 deep	350	0

¹⁾ Involute spline according to ANSI B92.1a, 30° pressure angle, flat root, side fit, tolerance class 5

²⁾ Spline runout is a deviation from the ISO 3019-1 standard.

³⁾ Thread according to ASME B1.1

⁴⁾ Depending on the application, momentary pressure peaks can occur. Keep this in mind when selecting measuring devices and fittings.

⁵⁾ The countersink may be deeper than specified in the standard.


⁶⁾ Depending on the installation position, L or L_1 must be connected (see also installation instructions on pages 38 and 39).


⁷⁾ O = Must be connected (plugged on delivery)X = Plugged (in normal operation)



Axial piston variable motor | **A10VM, A10VE series 52** 19 A10VM - Dimensions, size 45

▼ **HZ, HZ6** - Two-point control, hydraulic

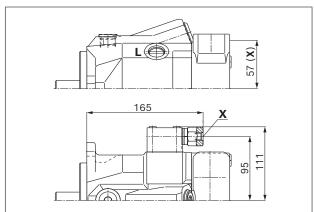

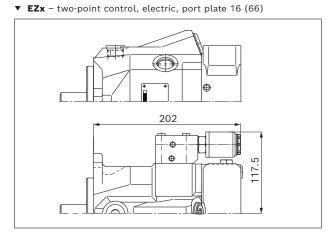




20 **A10VM, A10VE series 52** | Axial piston variable motor A10VM – Dimensions, size 63

Dimensions [mm]

A10VM - Dimensions, size 63

DG - Two-point control, direct operated


Port plate 10 (60) and 16 (66)N000

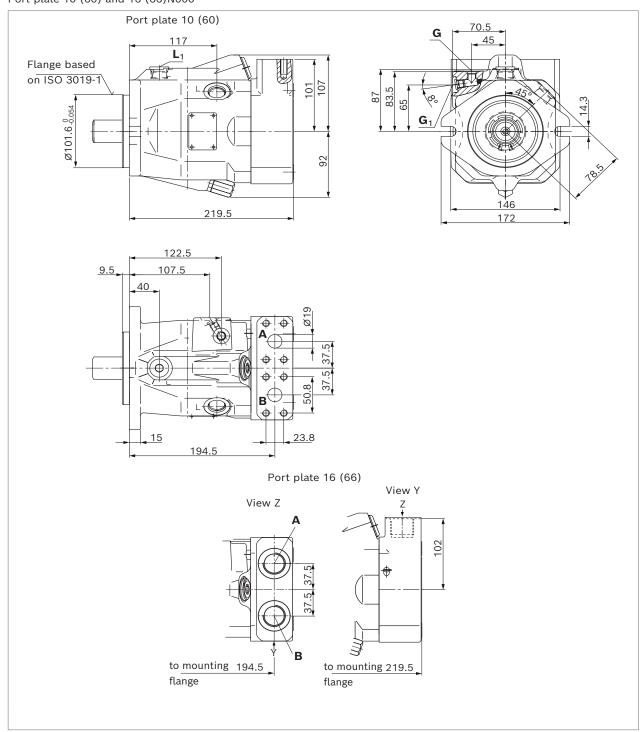




Axial piston variable motor | **A10VM, A10VE series 52** 21 A10VM - Dimensions, size 63

▼ Splined shaft (similar to ISO 3019-1)

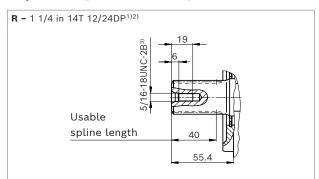

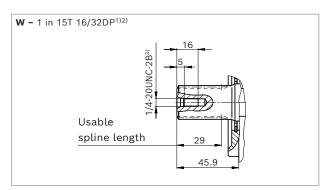

Port pl	ate ports	Standard	Size	p _{max} [bar] ⁴⁾	State ⁷⁾
Port pl	ate 10				
A , B	Working port (high-pressure series) Fastening thread	ISO 6162-2 DIN 13	3/4 in M10 × 1.5; 17 deep	350	Ο
Port pl	ate 60				
A, B Working port (high-pressure series) Fastening thread		ISO 6162-2 ASME B1.1	3/4 in 3/8-16UNC-2B; 21 deep	350	Ο
Port pl	ate 16				
A , B	Working port	DIN 3852-1	M27 × 2; 16 deep	350	0
Port pl	ate 66				
A, B	Working port	ISO 11926	1 1/16-12UN-2B; 20 deep	350	О
Other p	oorts				
L	Drain port	ISO 11926 ⁵⁾	7/8-14UNF-2B; 17 deep	4	O ⁶⁾
L ₁	Drain port	ISO 11926 ⁵⁾	7/8-14UNF-2B; 17 deep	4	X ⁶⁾
G	External control pressure (with DG control)	ISO 11926 ⁵⁾	7/16-20UNF-2B; 12 deep	350	0
G ₁	External control pressure (with DG control)	ISO 11926 ⁵⁾	7/16-20UNF-2B; 12 deep	350	Х
х	Pilot pressure (with HZ control)	ISO 11926	7/16-20UNF-2B; 12 deep	350	0

¹⁾ Involute spline according to ANSI B92.1a, 30° pressure angle, flat root, side fit, tolerance class 5

 $_{\rm 2)}\,$ Spline runout is a deviation from the ISO 3019-1 standard.

 $[\]scriptstyle{
m 3)}$ Thread according to ASME B1.1

⁴⁾ Depending on the application, momentary pressure peaks can occur. Keep this in mind when selecting measuring devices and fittings.

⁵⁾ The countersink may be deeper than specified in the standard.

⁶⁾ Depending on the installation position, L or L₁ must be connected (see also installation instructions on pages 38 and 39).


⁷⁾ O = Must be connected (plugged on delivery) X = Plugged (in normal operation)




22 **A10VM, A10VE series 52** | Axial piston variable motor A10VM – Dimensions, size 63

Dimensions [mm]

▼ **HZ, HZ6** - Two-point control, hydraulic

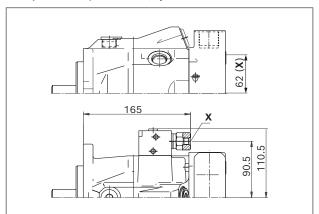

▼ EZx - Two-point control, electric

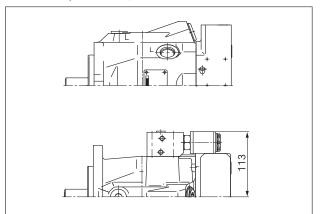




Axial piston variable motor | **A10VM, A10VE series 52** 23 A10VM - Dimensions, size 85

A10VM - Dimensions, size 85

DG - Two-point control, direct operated

Port plate 10, 60 (N000)

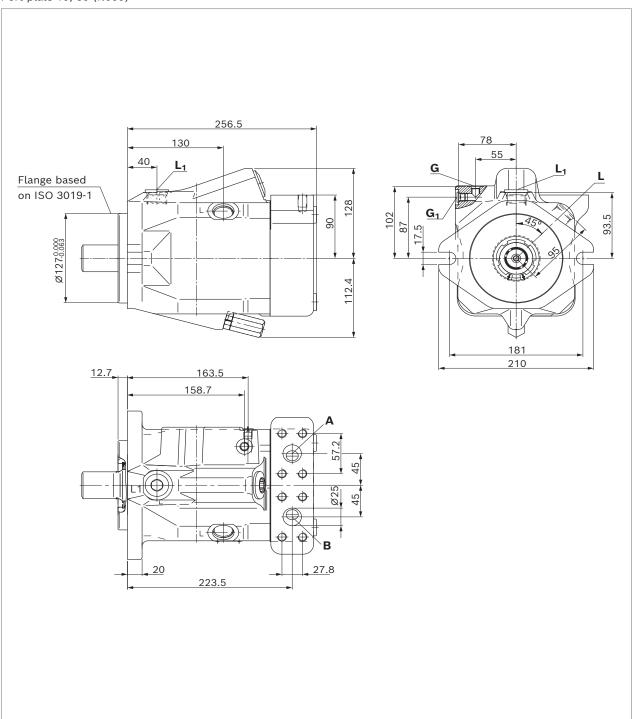





24 **A10VM, A10VE series 52** | Axial piston variable motor A10VM – Dimensions, size 85

Dimensions [mm]

▼ Splined shaft (similar to ISO 3019-1)

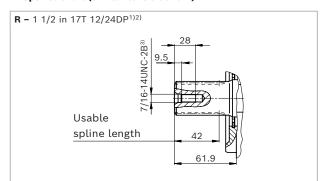

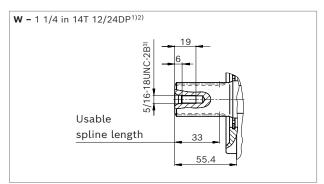

Port pl	ate ports	Standard Size		$p_{\sf max}$ [bar] $^{4)}$	State ⁷⁾
Port pl	ate 10	,			
А, В	Working port (high-pressure series)	ISO 6162-2	1 in	350	0
	Fastening thread	DIN 13	M12 × 1.75; 17 deep		
Port pl	ate 60				
A, B	Working port (high-pressure series)	ISO 6162-2	1 in	350	0
	Fastening thread	ASME B1.1	7/16-14UNC-2B; 22 deep		
Other p	ports	,			
L	Drain port	ISO 11926 ⁵⁾	1 1/16-12UNF-2B; 20 deep	4	O ⁶⁾
L ₁	Drain port	ISO 11926 ⁵⁾	1 1/16-12UNF-2B; 20 deep	4	X ₆)
G	External control pressure (with DG control)	ISO 11926 ⁵⁾	7/16-20UNF-2B; 12 deep	350	0
G ₁	External control pressure (with DG control)	ISO 11926 ⁵⁾	7/16-20UNF-2B; 12 deep	350	Χ
х	Pilot pressure (with HZ control)	ISO 11926	7/16-20UNF-2B; 10 deep	350	0

¹⁾ Involute spline according to ANSI B92.1a, 30° pressure angle, flat root, side fit, tolerance class 5

 $_{\rm 2)}\,$ Spline runout is a deviation from the ISO 3019-1 standard.

 $_{\mbox{\scriptsize 3)}}$ Thread according to ASME B1.1

⁴⁾ Depending on the application, momentary pressure peaks can occur. Keep this in mind when selecting measuring devices and fittings.

⁵⁾ The countersink may be deeper than specified in the standard.


⁶⁾ Depending on the installation position, L or L_1 must be connected (see also installation instructions on pages 38 and 39).

⁷⁾ O = Must be connected (plugged on delivery)X = Plugged (in normal operation)




Axial piston variable motor | **A10VM, A10VE series 52** 25 A10VM - Dimensions, size 85

▼ **HZ, HZ6** – Two-point control, hydraulic

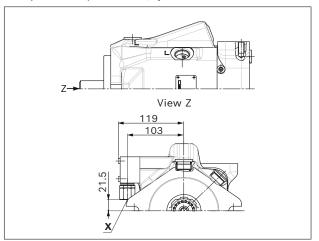



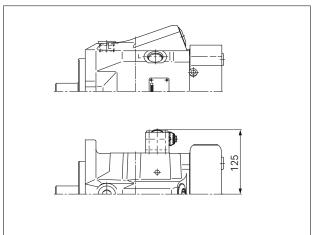




26 **A10VM, A10VE series 52** | Axial piston variable motor A10VE – Dimensions, size 28

Dimensions [mm]

A10VE - Dimensions, size 28

DG - Two-point control, direct operated


Port plate 10 (60) and 16 (66)N000

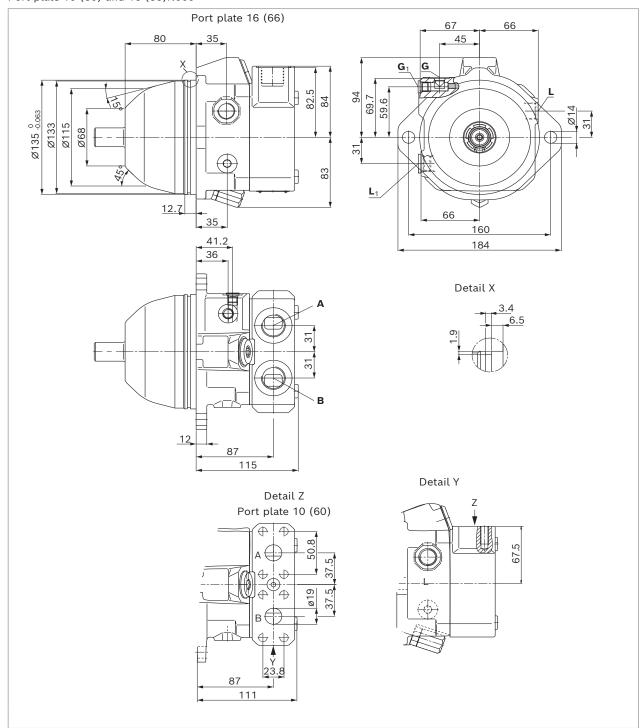



Axial piston variable motor | **A10VM, A10VE series 52** 27 A10VE - Dimensions, size 28

▼ Splined shaft (similar to ISO 3019-1)

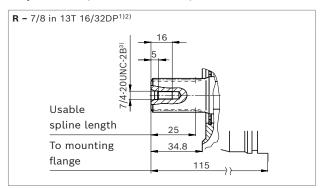

Port pl	ate ports	Standard Size		$p_{\sf max}$ [bar] $^{4)}$	State ⁷⁾
Port pl	ate 10				
А, В	Working port (high-pressure series) Fastening thread	ISO 6162-2 DIN 13	3/4 in M10 × 1.5; 17 deep	350	Ο
Port pl	ate 60				
A, B Working port (high-pressure series) Fastening thread		ISO 6162-2 ASME B1.1	3/4 in 350 3/8-16UNC-2B; 21 deep		Ο
Port pl	ate 16				
A, B	Working port	DIN 3852-1	M27 × 2; 16 deep	350	0
Port pl	ate 66				
A , B	Working port	ISO 11926	1 1/16-12UN-2B; 20 deep	350	0
Other p	oorts				
L	Drain port	ISO 11926 ⁵⁾	3/4-16UNF-2B; 15 deep	4	O ⁶⁾
L ₁	Drain port	ISO 11926 ⁵⁾	3/4-16UNF-2B; 15 deep	4	X ⁶⁾
G	External control pressure (with DG control)	ISO 11926 ⁵⁾	7/16-20UNF-2B; 12 deep	350	0
G ₁	External control pressure (with DG control)	ISO 11926 ⁵⁾	7/16-20UNF-2B; 12 deep	350	X
Х	Pilot pressure (with HZ control)	ISO 11926	7/16-20UNF-2B; 12 deep	350	0

¹⁾ Involute spline according to ANSI B92.1a, 30° pressure angle, flat root, side fit, tolerance class 5

²⁾ Spline runout is a deviation from the ISO 3019-1 standard.

³⁾ Thread according to ASME B1.1

⁴⁾ Depending on the application, momentary pressure peaks can occur. Keep this in mind when selecting measuring devices and fittings.

⁵⁾ The countersink may be deeper than specified in the standard.

⁶⁾ Depending on the installation position, L or L₁ must be connected (see also installation instructions on pages 38 and 39).


⁷⁾ O = Must be connected (plugged on delivery)X = Plugged (in normal operation)




28 **A10VM, A10VE series 52** | Axial piston variable motor A10VE – Dimensions, size 28

Dimensions [mm]

▼ **HZ, HZ6** - Two-point control, electric

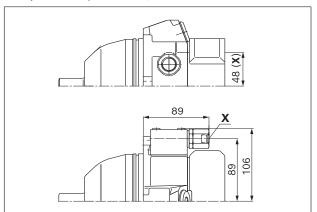

▼ EZx - Two-point control, electric

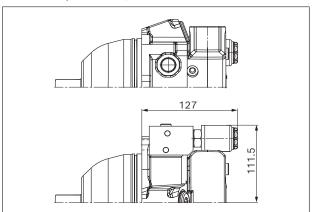




Axial piston variable motor | **A10VM, A10VE series 52** 29 A10VE - Dimensions, size 45

A10VE - Dimensions, size 45

DG - Two-point control, direct operated

Port plate 10 (60), 11 (61) and 16 (66)N000

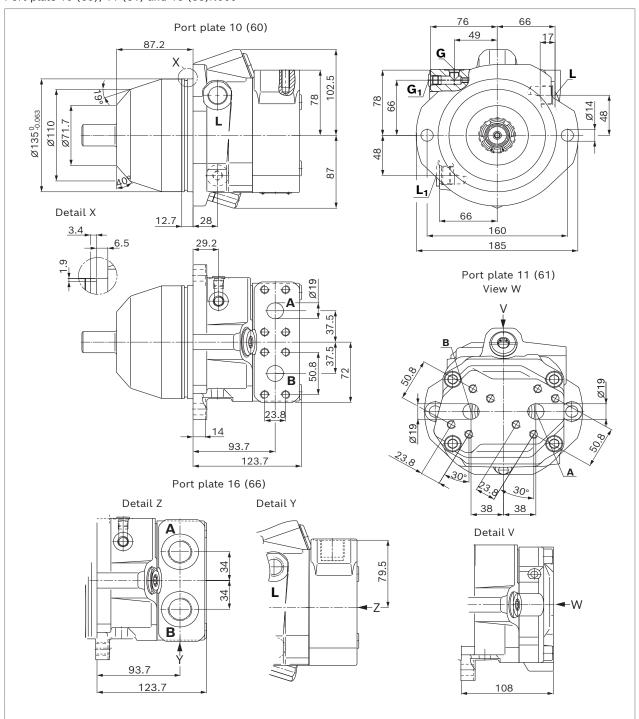





30 **A10VM, A10VE series 52** | Axial piston variable motor A10VE – Dimensions, size 45

Dimensions [mm]

▼ Splined shaft (similar to ISO 3019-1)

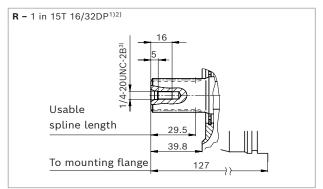

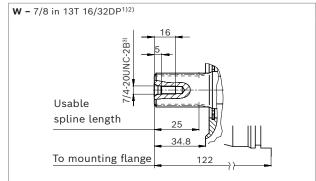

Port pl	ate ports	Standard	Size	$p_{\sf max}$ [bar] $^{4)}$	State ⁷⁾
Port pl	ate 10; 11				
A , B	Working port (high-pressure series) Fastening thread	ISO 6162-2 DIN 13	3/4 in M10 × 1.5; 17 deep	350	0
Port pl	ate 60; 61				
A , B	Working port (high-pressure series) Fastening thread	ISO 6162-2 ASME B1.1	3/4 in 3/8-16UNC-2B; 21 deep	350	0
Port pl	ate 16				
A , B	Working port	DIN 3852-1	M27 × 2; 16 deep	350	0
Port pl	ate 66				
A , B	Working port	ISO 11926	1 1/16-12UN-2B; 20 deep	350	0
Other p	ports				
L	Drain port	ISO 11926 ⁵⁾	7/8-14UNF-2B; 17 deep	4	O ⁶⁾
L ₁	Drain port	ISO 11926 ⁵⁾	7/8-14UNF-2B; 17 deep	4	X ⁶⁾
G	External control pressure (with DG control)	ISO 11926 ⁵⁾	7/16-20UNF-2B; 12 deep	350	0
G ₁	External control pressure (with DG control)	ISO 11926 ⁵⁾	7/16-20UNF-2B; 12 deep	350	Х
Х	Pilot pressure (with HZ control)	ISO 11926	7/16-20UNF-2B; 12 deep	350	0

¹⁾ Involute spline according to ANSI B92.1a, 30° pressure angle, flat root, side fit, tolerance class 5

 $_{\rm 2)}\,$ Spline runout is a deviation from the ISO 3019-1 standard.

 $_{\rm 3)}$ Thread according to ASME B1.1 $\,$

⁴⁾ Depending on the application, momentary pressure peaks can occur. Keep this in mind when selecting measuring devices and fittings.

⁵⁾ The countersink may be deeper than specified in the standard.


⁶⁾ Depending on the installation position, L or L_1 must be connected (see also installation instructions on pages 38 and 39).

⁷⁾ O = Must be connected (plugged on delivery) X = Plugged (in normal operation)




Axial piston variable motor | **A10VM, A10VE series 52** 3 A10VE - Dimensions, size 45

▼ **HZ, HZ6** - Two-point control, electric

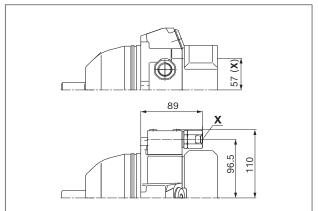



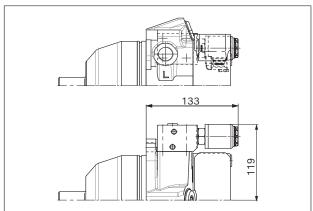




32 **A10VM, A10VE series 52** | Axial piston variable motor A10VE – Dimensions, size 63

Dimensions [mm]

A10VE - Dimensions, size 63

Hz, HZ6 - Two-point control, electric

Port plate 10 (60) and 16 (66)N000

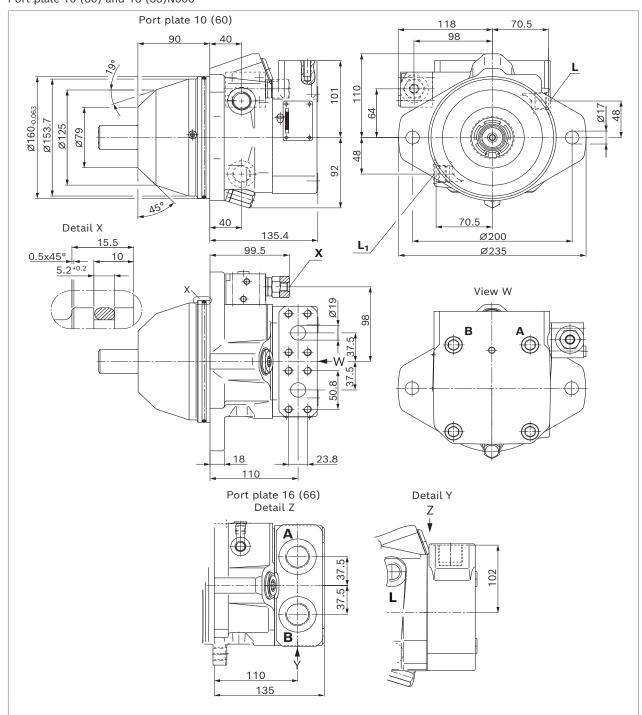





Axial piston variable motor | **A10VM, A10VE series 52** 33

A10VE - Dimensions, size 63

▼ Splined shaft (similar to ISO 3019-1)

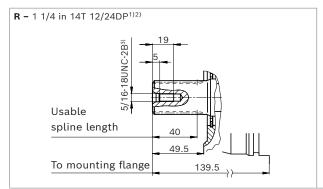

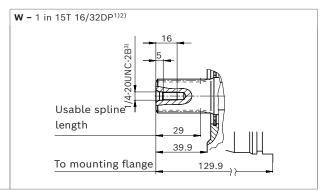

Port pl	ate ports	Standard	Size	p _{max} [bar] ⁴⁾	State ⁷⁾
Port pl	ate 10				
A, B	Working port (high-pressure series)	ISO 6162-2	3/4 in	350	0
	Fastening thread	DIN 13	M10 × 1.5; 17 deep		
Port pl	ate 60				
A, B	Working port (high-pressure series)	ISO 6162-2	3/4 in	350	0
	Fastening thread	ASME B1.1	3/8-16UNC-2B; 21 deep		
Port pl	ate 16				
A, B	Working port	DIN 3852-1	M27 × 2; 16 deep	350	0
Port pl	ate 66				
A, B	Working port	ISO 11926	1 1/16-12UN-2B; 20 deep	350	0
Other p	oorts				
L	Drain port	ISO 11926 ⁵⁾	7/8-14UNF-2B; 17 deep	4	O ⁶⁾
L ₁	Drain port	ISO 11926 ⁵⁾	7/8-14UNF-2B; 17 deep	4	X ⁶⁾
Х	Pilot pressure	ISO 11926	7/16-20UNF-2B; 12 deep	350	0

¹⁾ Involute spline according to ANSI B92.1a, 30° pressure angle, flat root, side fit, tolerance class 5

²⁾ Spline runout is a deviation from the ISO 3019-1 standard.

 $_{\rm 3)}$ Thread according to ASME B1.1 $\,$

⁴⁾ Depending on the application, momentary pressure peaks can occur. Keep this in mind when selecting measuring devices and fittings.

⁵⁾ The countersink may be deeper than specified in the standard.

 $_{6)}$ Depending on the installation position, L or L₁ must be connected (see also installation instructions on pages 38 and 39).


⁷⁾ O = Must be connected (plugged on delivery)X = Plugged (in normal operation)



34 **A10VM, A10VE series 52** | Axial piston variable motor A10VE – Dimensions, size 63

Dimensions [mm]

▼ EZx - Two-point control, electric

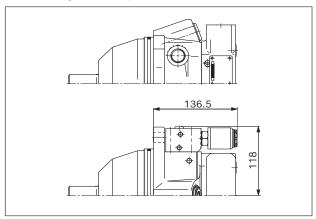



Axial piston variable motor | **A10VM, A10VE series 52**Flushing and boost-pressure valve

35

Flushing and boost-pressure valve

Order option ...N007

The flushing and boost-pressure valve is used in a closed circuit to prevent increased heat and to protect the minimum boost pressure (set to 16 bar). The valve is integrated in the port plate.


A quantity of hydraulic fluid determined by an orifice is taken from the respective low-pressure side and discharged into the motor housing. Together with the leakage, it is discharged to the reservoir via the drain port. The hydraulic fluid removed from the circuit must be replaced by the boost pump with cooled hydraulic fluid.

Standard flushing flows

At low pressure $p_{\rm ND}$ = 20 bar and orifice of Ø1.6 mm, the standard flushing quantity is 5.5 l/min (sizes 28 - 85). Please specify other orifice diameters in plain text. Other flushing flows:

Orifice diameter [mm]	Flushing flow [l/min]
1.2	3.5
1.6	5.5
1.8	7.2


▼ Circuit diagram

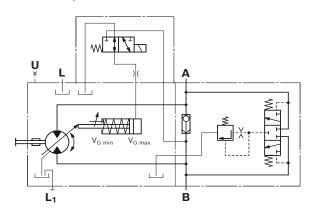



▼ Dimensions A10VM and A10VE

Port plate 10 (60)

Port plate 16 (66)







Size	A ₁	A ₂	
28	72	72	
45	77	77	
63	77	82	
85	_	_	




36 **A10VM, A10VE series 52** | Axial piston variable motor Speed sensing

Speed sensing

Order option ...W

The version A10VE...W is prepared for the installation of a speed sensor DST or DSA1/20 and DSA2/20 and is equipped with a spline on the rotary group.

▼ Dimension A10VE prepared for speed sensor

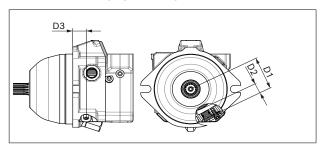

A10VE				
Size		28	45	63
D1	mm	63	68.5	_
D2	mm	20.1	19.5	_
D3	mm	24.5	44.7	_

Order option ... E, C and K

The mounted speed sensor DST (E) or DSA1/20 (C), DSA2/20 (K) can record both the rotational speed and the direction of rotation of the motor.

Additionally, the sensors also feature an NTC thermistor, which enables measuring the temperature in the installation location of the sensor.

Type code, technical data, dimensions and information on the connector, plus safety instructions about the sensor can be found in the relevant data sheet 95131 (DST) or 95126 (DSAx/20).

Notice


► Painting the sensor with electrostatic charge is not permitted (danger: ESD damage)

Electrostatic discharge

ISO 10605:2008

- ► Contact discharge (probe touches the sensor) ±8 kV (sensor operated actively and passively)
- Air discharge (arc between probe and sensor) ±15 kV (sensor operated actively and passively)

▼ Circuit diagram Example A10VE...EZ6

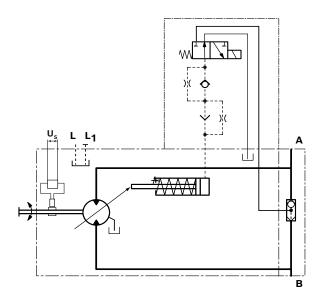


Pin assignment, speed sensor DSA1 and DSA2 Order option C and K



- 1 Supply voltage
- 2 Ground
- 3 S1 frequency
- 4 Direction of rotation
- 5 Temperature sensor
- 6 Temperature sensor

▼ Pin assignment, speed sensor DST order option "E"

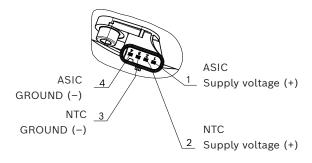




Axial piston variable motor | **A10VM, A10VE series 52**Dimension A10VE with speed sensor DSAx and DST

37

Dimension A10VE with speed sensor DSAx and DST

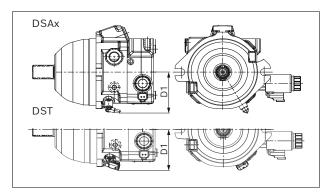

A10VE					
Size		28	45	63	
D1 / DSAx	mm	82.8	89.2	-	
(Code C, K)					
D1 / DST	mm	81.3	87.2	-	
(Code E)					

Notice

For dimensions with mating connector, please contact us.

Connector for solenoids

DEUTSCH DT04-2P-EP04

Molded, 2-pin, without bidirectional suppressor diode. There is the following type of protection with the mounted mating connector:

- ▶ IP67 (DIN/EN 60529) and
- ► IP69K (DIN 40050-9)

▼ Switching symbol



▼ Mating connector DEUTSCH DT06-2S-EP04

Consisting of	DT designation
1 housing	DT06-2S-EP04
1 wedge	W2S
2 sockets	0462-201-16141

The mating connector is not included in the scope of delivery.

This can be supplied by Bosch Rexroth on request (material number R902601804).

Notice

- If necessary, you can change the position of the connector by turning the solenoid body.
 The procedure is defined in the instruction manual.
- Only the dead weight (<1 N) of the connection cable with a length of 150 mm may act on the plug-in connection and the solenoid coil with coil nut. Other forces and vibrations are not permissible. For example, this can be realized by suspension of the cable at the same vibration system.



38 **A10VM, A10VE series 52** | Axial piston variable motor Installation instructions for A10VM

Installation instructions for A10VM

General

The axial piston unit must be filled with hydraulic fluid and air bled during commissioning and operation.

This must also be observed following a longer standstill as the axial piston unit may empty via the hydraulic lines.

Please contact us regarding the installation position "drive shaft at top or bottom".

The leakage in the housing area must be directed to the reservoir via the highest positioned drain port (\mathbf{L} , \mathbf{L}_1). If a shared drain line is used for several units, make sure that the respective case pressure in each unit is not exceeded. The shared drain line must be dimensioned to ensure that the maximum permissible case pressure of all connected units is not exceeded in any operating condition, particularly at cold start. If this is not possible, separate drain line must be laid, if necessary.

To prevent the transmission of structure-borne noise, use elastic elements to decouple all connecting lines from all vibration-capable components (e.g., reservoir, frame parts).

Under all operating conditions, the drain line must flow into the reservoir below the minimum fluid level. When designing the reservoir, ensure that there is adequate distance between the suction line and the drain line. We recommend using a baffle (baffle plate) between suction line and drain line. A baffle improves the air separation ability as it gives the hydraulic fluid more time for desorption. Apart from that, this prevents the heated return flow from being drawn directly back into the suction line. The suction port must be supplied with air-free, calmed and cooled hydraulic fluid.

Notice

In certain installation positions, an influence on the adjustment or control can be expected. Gravity, dead weight and case pressure can cause minor characteristic shifts and changes in actuating time.

Installation position

See the following examples 1 to 8.
Further installation positions are available upon request.
Recommended installation position: 1, 3, 5 and 7

Key	
F	Filling / Air bleeding
L, L ₁	Drain port
SB	Baffle (baffle plate)
h _{t min}	Minimum required immersion depth (200 mm)
h _{min}	Minimum required distance to reservoir bottom (100 mm)

Notice

Port ${\bf F}$ is part of the external piping and must be provided on the customer side to make filling and air bleeding easier.

39





Axial piston variable motor | **A10VM, A10VE series 52**Installation instructions for A10VM


Below-reservoir installation (standard)

Below-reservoir installation means that the axial piston unit is installed outside of the reservoir below the minimum fluid level.

Installati	on position A10VM, NG 28	Air bleed	Filling
1		F, L	F, L
	SB ht mir		

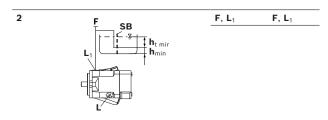

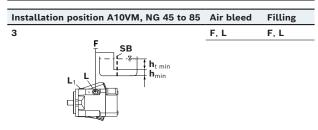

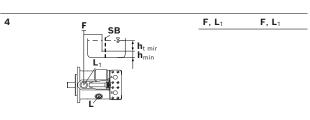


For key, see page 38


Above-reservoir installation

Above-reservoir installation means that the axial piston unit is installed above the minimum fluid level of the reservoir.

Installation position NG 28	Air bleed	Filling
SB ht m	F, L	F, L
6	E 1	E 1

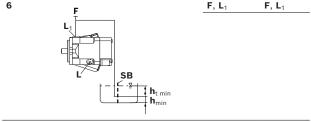

Installation position NG 45 to 85	Air bleed	Filling
7	F, L	F, L
L, L		
SB h _{t min}		

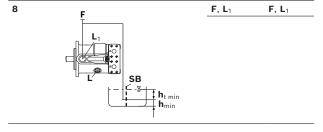



40 A10VM, A10VE series 52 | Axial piston variable motor Installation instructions for A10VE

Installation instructions for A10VE

General

The axial piston unit must be filled with hydraulic fluid and air bled during commissioning and operation.

This must also be observed following a longer standstill as the axial piston unit may empty via the hydraulic lines.

Please contact us regarding the installation position "drive shaft at top or bottom".

The leakage in the housing area must be directed to the reservoir via the highest available drain port (L). If this is not possible, separate drain line must be laid. If a shared drain line is used for several units, make sure that the respective case pressure in each unit is not exceeded. The shared drain line must be dimensioned to ensure that the maximum permissible case pressure of all connected units is not exceeded in any operating condition, particularly at cold start. If this is not possible, separate drain line must be laid, if necessary.

To prevent the transmission of structure-borne noise, use elastic elements to decouple all connecting lines from all vibration-capable components (e.g., reservoir, frame parts).

Under all operating conditions, the drain line must flow into the reservoir below the minimum fluid level. When designing the reservoir, ensure that there is adequate distance between the suction line and the drain line. We recommend using a baffle (baffle plate) between suction line and drain line. A baffle improves the air separation ability as it gives the hydraulic fluid more time for desorption. Apart from that, this prevents the heated return flow from being drawn directly back into the suction line. The suction port must be supplied with air-free, calmed and cooled hydraulic fluid.

Notice

In certain installation positions, an influence on the adjustment or control can be expected. Gravity, dead weight and case pressure can cause minor characteristic shifts and changes in actuating time.

Installation position

See the following examples 1 to 8.
Further installation positions are available upon request.
Recommended installation position: 2 and 4

Key	
F	Filling / Air bleeding
L, L ₁	Drain port
SB	Baffle (baffle plate)
h _{t min}	Minimum required immersion depth (200 mm)
h _{min}	Minimum required distance to reservoir bottom (100 mm)

Notice


Port ${\bf F}$ is part of the external piping and must be provided on the customer side to make filling and air bleeding easier.





Axial piston variable motor | **A10VM, A10VE series 52** 41 Installation instructions for A10VE


Below-reservoir installation (standard)

Below-reservoir installation means that the axial piston unit is installed outside of the reservoir below the minimum fluid level.

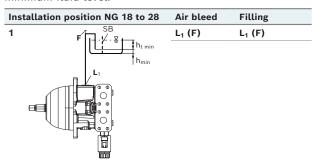

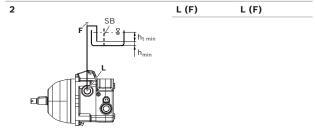

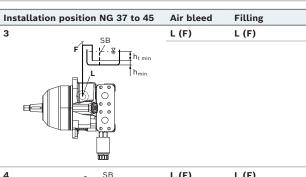


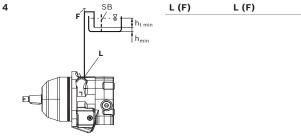


For key, see page 40.

Above-reservoir installation

Above-reservoir installation means that the axial piston unit is installed above the minimum fluid level of the reservoir.

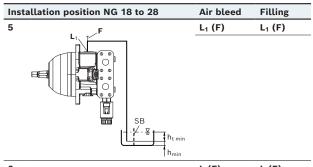

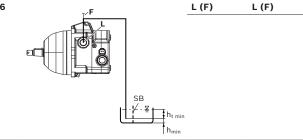

Installation position NG 37 to 45	5 Air bleed	Filling
7	L (F)	L (F)
SI	- ¥ h _t	
8	h _m L (F)	L (F)
SB SB	h _{t min}	



42 **A10VM, A10VE series 52** | Axial piston variable motor Project planning notes

Project planning notes

- ► The axial piston variable motor, A10VM and A10VE, is intended to be used in open and closed circuits.
- Project planning, installation and commissioning of the axial piston units requires the involvement of skilled personnel.
- Before using the axial piston unit, please read the corresponding instruction manual completely and thoroughly. If necessary, this can be requested from Bosch Rexroth.
- Before finalizing your design, please request a binding installation drawing.
- The specified data and notes contained herein must be observed.
- ► Depending on the operating conditions of the axial piston unit (working pressure, fluid temperature), the characteristic curve may shift.
- ► The characteristic curve may also shift due to the dither frequency or control electronics.
- ▶ Preservation: Our axial piston units are supplied as standard with preservation protection for a maximum of 12 months. If longer preservation protection is required (maximum 24 months), please specify this in plain text when placing your order. The preservation periods apply under optimal storage conditions, details of which can be found in the data sheet 90312 or the instruction manual.
- ▶ Not all versions of the product are approved for use in safety functions according to ISO 13849.

 Please consult the proper contact at Bosch Rexroth if you require reliability parameters (e.g., MTTF_d) for functional safety.
- ▶ Depending on the type of control used, electromagnetic effects can be produced when using solenoids. Use of the recommended direct current (DC) on the electromagnet does not produce any electromagnetic interference (EMI) nor is the electromagnet influenced by EMI. A possible electromagnetic interference (EMI) exists if the solenoid is supplied with modulated direct current (e.g. PWM signal). The machine manufacturer should conduct appropriate tests and take appropriate measures to ensure that other components or operators (e.g. with a pacemaker) are not affected by this potentiality.

- ► A pressure relief must be provided in the hydraulic system. In this connection, observe the technical limits of the pressure relief valve.
- ► For drives that are operated for a long period of time with constant rotational speed, the natural frequency of the hydraulic system can be stimulated by the excitation frequency of the pump (rotational speed frequency x 9). This can be prevented with suitably designed hydraulic lines.
- Please note the details regarding the tightening torques of port threads and other threaded joints in the instruction manual.
- ▶ The ports and fastening threads are designed for the p_{max} permissible pressures of the respective ports, see the connection tables. The machine or system manufacturer must ensure that the connecting elements and lines correspond to the specified application conditions (pressure, flow, hydraulic fluid, temperature) with the necessary safety factors.
- ► The service ports and function ports are only intended to accommodate hydraulic lines.



Axial piston variable motor | **A10VM, A10VE series 52** 43 Safety instructions

Safety instructions

- During and shortly after operation, there is a risk of burning on the axial piston unit and especially on the solenoids. Take the appropriate safety measures (e.g. by wearing protective clothing).
- Moving parts in control equipment (e.g. valve spools) can, under certain circumstances, get stuck in position as a result of contamination (e.g. contaminated hydraulic fluid, abrasion, or residual dirt from components). As a result, the hydraulic fluid flow and the build-up of torque in the axial piston unit can no longer respond correctly to the operator's specifications. Even the use of various filter elements (external or internal flow filtration) will not rule out a fault but merely reduce the risk. The machine/system manufacturer must test whether remedial measures are needed on the machine for the application concerned in order to bring the driven consumer into a safe position (e.g., safe stop) and ensure any measures are properly implemented.