#### RE 29391

Edition: 2022-03 Replaces: 2021-05



# Directional control valve, direct operated, with integrated digital axis controller (IAC-Multi-Ethernet)

# **Type 4WRPDH**



- ► Sizes 6 and 10
- ► Component series 2X
- Maximum operating pressure 350 bar
- ► Maximum flow 100 l/min ( $\Delta p = 35$  bar)

CE

#### **Features**

#### Open

- Integrated digital axis control functionality (IAC-Multi-Ethernet)
- Bus connection/service interface (sercos, EtherCAT, EtherNet/IP, PROFINET RT, POWERLINK, VARAN)

#### ► Scalable

- 2 configurable analog sensor inputs
- 1 input for linear position measurement system (SSI, 1Vpp or EnDat 2.2)

#### ▶ Safe

- Internal safety function (can be used up to category 4/PL e according to EN 13849-1)
- CE conformity according to EMC Directive 2014/30/EU

#### ▶ Precise

- Best-in-class hydraulic controller
- High response sensitivity and low hysteresis

# Contents

Features	1
Ordering code	2, 3
Symbols	3
Function, section	4, 5
Technical data	6 9
Representation of the axis controller in the	
system network	10
Block diagram/controller function block	11
Electrical connections, assignment	12, 13
LED displays	14
Characteristic curves	15 18
Dimensions	19 21
Accessories	22, 23
Project planning and maintenance instructions	23
Further information	24

# Ordering code

01	02	03	04	05	06	07	08	09		10		11		12	13	14	15	16	_	
4	WRP	D	Н			В			-	2X	/		/	24		D6			╛	
01	4 main ı	ports																		4
02	Directio	nal c	ontrol	valve	!															WRP
03	With int	egrat	ed dig	gital a	xis coı	ntrolle	er													D
04	Control	spoo	l/slee	ve																Н
05	Size 6																			6
	Size 10																			10
06	Symbols	s; pos	sible	versio	on see	page	3													
07	Installat	tion s	ide of	the ir	nducti	ve pos	sition	transo	ducer											В
	d flow at	70 ba	ar pre	ssure	differ	ential	(35 ba	ar/cor	ntrol e											
80						"L			ı			aracte	ristic 40%)	1		<b>'P"</b> (in	flection	on sc	۱%۱	
	- Size 6										(11111)	ection	40%)			<b>P</b> (III	песп		770)	
	2 l/min					<b>/</b>						_					_			02
	4 l/min											<b>✓</b>					_			04
	12 l/mir	1										_					_			12
	15 l/mir						- /						15							
	24 l/mir					<b>✓</b>						_					_			24
	25 l/mir					_						_					1			25
	40 l/mir					<b>/</b>	>					<b>✓</b>					_			40
	- Size 1	0																		
	50 l/mir	n				<b>✓</b> ⟨	>					<b>✓</b>					_			50
	100 l/m	in				✓ <	>					✓					-			100
ow	characte	eristic	:																	
09	Linear																			L ♦
	Inflected	d cha	racter	istic o	curve (	(inflec	tion 6	0% fc	or NG6	with r	ated 1	flows	" <b>15</b> " a	nd " <b>25</b>	s", oth	erwise	infle	ction	40%)	Р
10	Compor	nent s	eries	20	29 (20	0 29	9: unc	hange	ed inst	allatior	n and	conne	ection	dimer	nsions	)				2X
	material																			
11	NBR sea		21 VC C	отпра	crorercy	7 01 30	415 111	cii iiy	araatic	, itala t	asca,	300 p	ugc 1)							M \$
	FKM sea																			v
12	Supply	voltas	ze 24	V																24
	rnet inter		50 2 1	•																
13	EtherNE																			E
	PROFINET RT								N											
	Sercos																			S
	EtherCA	T (CA	Nope	n pro	file)															Т
	POWER					e)												-		w
	VARAN																			V
004	trical inte	rface																		_
. <b>ес</b> т 14	±10 VD0			) m ^																D6
. +	1 - 10 100	J UI 4	20	, IIIA																

# **Ordering code**


01	02	03	04	05	06	07	80	09		10		11		12	13	14	15	16	
4	WRP	D	Н			В			_	2X	/		/	24		D6			

## Sensor interfaces

15	0 10 V/4 20 mA/EnDat 2.2	s
	0 10 V/4 20 mA/SSI	T \$
	0 10 V/4 20 mA/1Vpp	U ¢
16	Further details in the plain text	*

**Notice: ♦** = Preferred type

# **Symbols**

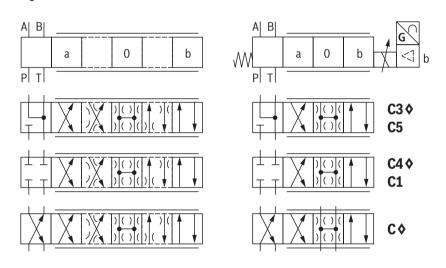

With symbols C5 and C1: 1)

 $P \rightarrow A: \boldsymbol{q}_{V \text{ nom}}$   $B \rightarrow T: \boldsymbol{q}_{V \text{ nom}}/2$  $P \rightarrow B: \boldsymbol{q}_{V \text{ nom}}/2$   $A \rightarrow T: \boldsymbol{q}_{V \text{ nom}}$ 

<sup>1)</sup> Standard = 1:1,  $q_{V \text{ nom}}$  2:1 from rated flow = 40 l/min (version "40")

# M Notice:

Representation according to DIN ISO 1219-1. Hydraulic interim positions are shown by dashes.

# Flow characteristic

Symbol	Linear characteristic curve (version "L")	Inflected characteristic curve (version "P")						
		Inflection 60% ( <b>q</b> <sub>V nom</sub> = 15, 25 l/min)	Inflection 40% ( <b>q</b> <sub>V nom</sub> = 4, 40 l/min – NG6) ( <b>q</b> <sub>V nom</sub> = 50, 100 l/min – NG10)					
C3, C5 C4, C1	dγ	qν Δs	qν Δs					
С	qν Δs	-	_					


# **Function**, section

# Set-up

The directional control valve with IAC-Multi-Ethernet electronics mainly consists of:

- ► Direct operated directional control valve (1) with control spool and sleeve in servo quality
- ► Integrated digital axis controller (2) with:
  - analog/digital interface (XH2)
  - Ethernet interfaces (X7E1, X7E2)
  - analog sensor interfaces (X2M1, X2M2)
  - digital sensor interface (X8M)

Directional control valve with integrated axis controller, analog interfaces (X2M1, X2M2), digital interfaces (XH2, X8M) and Ethernet interfaces (X7E1, X7E2)

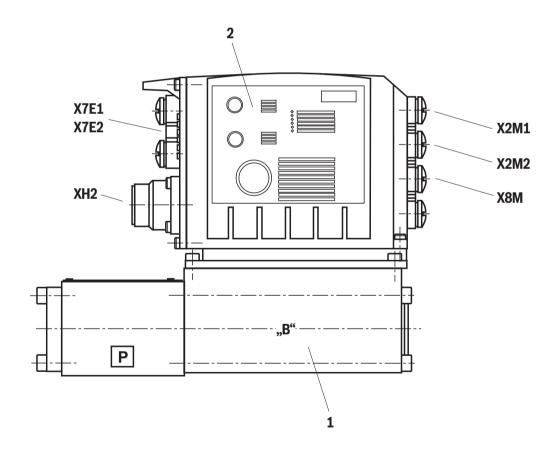

# **Function**, section

## **Functional description**

The IAC-Multi-Ethernet valve (Integrated Axis Controller based on directional control valves) is a digital directional control valve with integrated axis controller and the following functionalities:

- ▶ Position control
- ► Pressure/force control
- ► Closed-loop speed control
- ► Alternating control (position pressure/force)
- Alternating control (flow pressure/force)
- ▶ pQ function (flow-controlled)

This enables, amongst others, the following operating modes:

- ▶ Valve direct control
- ▶ Drive-controlled position control
- ► Drive-controlled positioning
- ► Positioning block operation
- ► The command values are preset via the Ethernet interface (X7E1 or X7E2) or, alternatively, via the analog/digital interface (XH2)
- ► The feedback information of the actual value signals to the higher-level control is provided optionally either via the Ethernet interface (X7E1 or X7E2) or the analog/digital interface (XH2)
- ► The controller parameters are set via the Ethernet interface (X7E1 or X7E2)

# Safety function

Thanks to the control solenoid (enable pin 3, low signal) at the connector (XH2), shut-off is enabled. After shut-off, the control spool of the valve is in fail-safe position.

Enable acknowledgment pin 8 for solenoid B is "high". By connection of the control solenoid (enable pin 3, high signal), the valve can be regulated in both directions by command value presetting.

Enable acknowledgment pin 8 for solenoid B is "low".

The integrated control electronics of the valve enables the additional shut-off of a channel according to EN 13849-1 in the direction P to A (depending on the application, the fail-safe position must be adhered to). For this purpose, a suitable control system must be provided to perform the plausibility check between the direction-dependent valve signals "enable input" and "enable acknowledgment" (diagnosis signal fed back by the valve) and react in an error case.

It is not possible to switch off direction P to B in a safety-relevant manner according to EN 13849-1 (depending on valve type).

## **Monitoring**

The digital control electronics enable comprehensive monitoring functions/error detection including:

- ▶ Undervoltage
- Communication error
- ► Cable break for analog sensor inputs and digital position measurement system
- ▶ Short-circuit monitoring for analog/digital outputs
- ► Monitoring of the microcontroller (watchdog)
- ▶ Temperature of the integrated electronics

## IndraWorks DS PC program

To implement the project planning task and to parameterize the IAC-Multi-Ethernet valves, the user may use the IndraWorks DS engineering tool (see accessories):

- ▶ Project planning
- ► Parameterization
- **▶** Commissioning
- ▶ Diagnosis
- ► Comfortable administration of all data on a PC
- ▶ PC operating systems: Windows XP (SP3), Windows 7

# Motice:

- ► 4/4 directional control valves do not have a leakage-free basic locking when deactivated. Leakage must be considered when designing the drive. While the electrical supply voltage is being switched off, the drive may be accelerated for a short time in functional direction P→B.
- ▶ Valve type 4WRPDH can be used as shut-off element cat. 3 or 4 (up to PL e according to EN 13849-1). For both categories, an additional shut-off element is required to achieve a two-channel shut-off. For further information on the safety application, see operating instructions 29391-B.

(For applications outside these values, please consult us!)

General								
Size		NG	6	10				
Type of connectio	n		Plate connection					
Porting pattern			ISO 4401-03-02-0-05	ISO 4401-05 04-0-05				
Weight		kg	3.2 7.2					
Installation position	on		any					
Ambient temperat	ture range	°C	-20 +60					
Storage temperati	ure range	°C	+5 +40					
Maximum storage	time	years	1 (if the storage conditions are observed, refer to the operating instructions 07600-B)					
Maximum relative	humidity (no condensation)	%	95					
Maximum surface	temperature	°C	150					
MTTF <sub>D</sub> value acco	rding to EN ISO 13849	years	150 (for further details, see operating instructions 29391-B)					
Sine test accordin	ng to DIN EN 60068-2-6		10 2000 Hz / maximum of 10 g / 10 cycles / 3 axes					
Noise test accordi	ing to DIN EN 60068-2-64		20 2000 Hz / 10 g <sub>RMS</sub> / 30 g peak / 30 r	nin / 3 axes				
Transport shock a	according to DIN EN 60068-2-27		15 g / 11 ms / 3 axes					
Conformity	► CE according to EMC directive 2014/30/EU, tested according to		EN 61000-6-2 and EN 61000-6-3					
	► RoHS directive		2011/65/EU <sup>1)</sup>					
Protection class a	according to EN 60529		IP65 (if suitable and correctly mounted mating connectors are used)					

Hydraulic											
Maximum operating	▶ Ports A, B, P	bar	350							315	
pressure	▶ Port T	bar	250								
Hydraulic fluid			see tab	le page	7						
Hydraulic fluid temperature range (flown-through) °C				+60							
Viscosity range	mm²/s	20 100									
	► Maximum admissible	um admissible mm²/s 10 800									
Maximum admissible degree of contamination of the hydraulic fluid; cleanliness class according to ISO 4406 (c)				Class 18/16/13 <sup>2)</sup>							
Rated flow ( <b>Δp</b> = 35 ba	ar per control edge <sup>3)</sup> )	l/min	2	4	12	15	24/25	40	50	100	
Leakage flow	► Linear characteristic curve "L"	cm³/min	<150	<180	<300	_	<500	<900	<1200	<1500	
(at 100 bar)	► Inflected characteristic curve "P"	cm³/min	_	_	-	<180	<300	<450	<600 (1:1) <500 (2:1)	<600	
Limitation of use	▶ Symbols C3, C5	bar	350	350	350	350	350	160	315	160	
(transition in fail safe position)	► Symbols C4, C1	bar	350	350	350	280	250	100	250	100	

The product fulfills the substance requirements of the RoHS directive 2011/65/EU.

<sup>3)</sup> Flow for deviating  $\Delta p$  (per control edge):

$$q_{x} = q_{Vnom} \times \sqrt{\frac{\Delta p_{x}}{35}}$$

The cleanliness classes specified for the components must be adhered to in hydraulic systems. Effective filtration prevents faults and at the same time increases the life cycle of the components.

(For applications outside these values, please consult us!)

Hydraulic fluid		Classification	Suitable sealing materials	Standards	Data sheet
Mineral oils		HL, HLP, HLPD, HVLP, HVLPD	NBR, FKM	DIN 51524	90220
Bio-degradable	► Insoluble in water	HETG	FKM	ISO 15380	
		HEES	FKM	150 15380	90221
	► Soluble in water	HEPG	FKM	ISO 15380	
Flame-resistant	▶ Water-free	HFDU (glycol base)	FKM		
		HFDU (ester base)	FKM	ISO 12922	90222
		HFDR	FKM		
	► Containing water	HFC (Fuchs: Hydrotherm 46M, Renosafe 500; Petrofer: Ultra Safe 620; Houghton: Safe 620; Union: Carbide HP5046)	NBR	ISO 12922	90223

# Important information on hydraulic fluids:

- ► For further information and data on the use of other hydraulic fluids, please refer to the data sheets above or contact us.
- ► There may be limitations regarding the technical valve data (temperature, pressure range, life cycle, maintenance intervals, etc.).
- ► The ignition temperature of the hydraulic fluid used must be 50 K higher than the maximum surface temperature.
- ▶ Bio-degradable and flame-resistant containing water:

  If components with galvanic zinc coating (e.g. version "J3" or "J5") or parts containing zinc are used, small amounts of dissolved zinc may get into the hydraulic system and cause accelerated aging of the hydraulic fluid. Zinc soap may form as a chemical reaction product, which may clog filters, nozzles and solenoid valves particularly in connection with local heat input.

#### ► Flame-resistant – containing water:

- Due to the increased cavitation tendency with HFC hydraulic fluids, the life cycle of the component may be reduced by up to 30% as compared to the use with mineral oil HLP. In order to reduce the cavitation effect, it is recommended – if possible specific to the installation – backing up the return flow pressure in ports T to approx. 20% of the pressure differential at the component.
- Dependent on the hydraulic fluid used, the maximum ambient and hydraulic fluid temperature must not exceed 50 °C.
   In order to reduce the heat input into the component, the command value profile is to be adjusted for proportional and high-response valves.

Static / dynamic						
Hysteresis	%	≤ 0.2				
Manufacturing tolerance <b>q</b> <sub>Vmax</sub>	%	≤10				
Temperature drift	%/10 K	Zero shift < 0.25				
Pressure drift	%/100 bar	Zero shift < 0.15				
Zero point calibration	%	±1 (ex works)				

(For applications outside these values, please consult us!)

Electrical, integrated el	ectronics (OBE)							
Size		NG	6	10				
Supply voltage 4; 5)	► Nominal value	VDC	24					
	► Minimum	VDC	18					
	► Maximum	VDC	36					
	► Maximum residual ripple	Vpp	p 2.5 (comply with the absolute supply voltage limit values					
Current consumption	► Maximum <sup>6)</sup>	А	2.5					
	► Impulse current	А	4					
Maximum power consum	ption	W	40	60				
Relative duty cycle		%	100 (continuous operation)					
Fuse protection, external	l	А	4, time-lag					
Functional ground and screening			see connector pin assignment (CE-compliant installation) page 12 and 13					
Booting time		S	<15					

<sup>&</sup>lt;sup>4)</sup> Supply voltage is used directly for sensor connections X2M1, X2M2 and X8M (no internal voltage limitation)

<sup>5)</sup> Voltage limit values must be observed directly at the connector of the valve (observe line length and cable cross-section!)


<sup>6)</sup> The maximum current consumption will increase when using the sensor inputs or the switching output according to the external load

(For applications outside these values, please consult us!)

ted electronics (OBE)	_	
► Quantity		optionally up to 2, configurable (analog inputs are omitted
► Low level	V	-3 5
► High level	V	15 <b>U</b> B
► Maximum current consumption at high level	mA	< 1
► Quantity		1
► Low level	V	0 3
► High level	V	15 <b>U</b> B
► Current carrying capacity	Α	1.5 (short-circuit-proof)
► Inductive load admissible		no
► Number <sup>7)</sup>		optionally up to 2, configurable (digital inputs are no longer required)
► Voltage inputs (differential inputs)		
- Measurement range	V	-10 +10
- Input resistance	kΩ	80 +10%
► Current inputs (reference to AGND)		
- Input current	mA	4 20 (0 20 physically)
- Input resistance	Ω	200, measuring resistance plus FET
► Number <sup>7)</sup>		1
► Voltage outputs		
- Output range	V	-10 +10 (0 10 by software)
- Minimum load impedance	kΩ	10
► Current outputs		
- Output range	mA	0 20 (4 20 by software)
- Maximum load	Ω	200
▶ Number <sup>7)</sup>		1 per connector
► Supply voltage	V	24 (corresponding to supply voltage applied to XH2)
► Maximum supply current	mA	350 (sum X2M1, X2M2 and X8M)
► Voltage inputs		
- Measurement range	V	0 10
- Input resistance	kΩ	80 +10%
► Current inputs (reference to AGND)		
	mA	4 20 (0 20 physically)
- Input resistance	Ω	200, measuring resistance plus PTC
·	V	24 or 5
► Maximum supply current — 24 V	mA	350 (sum X2M1, X2M2 and X8M)
- 5 V	mA	250
► SSI transducer		
- Coding		Gray
- Data width	bit	12 28
		80 kHz 1 MHz
		RS485
► Endat encoder		
		   RS485
– Line receiver / driver		
Line receiver / driver     Resolution		
- Resolution		minimum 10 nm and multiple
·		
	► Quantity  ► Low level  ► High level  ► Maximum current consumption at high level  ► Quantity  ► Low level  ► High level  ► Current carrying capacity  ► Inductive load admissible  ► Number 7)  ► Voltage inputs (differential inputs)  - Measurement range  - Input resistance  ► Current inputs (reference to AGND)  - Input current  - Input resistance  ► Number 7)  ► Voltage outputs  - Output range  - Minimum load impedance  ► Current outputs  - Output range  - Maximum load  ► Number 7)  ► Supply voltage  ► Maximum supply current  ► Voltage inputs  - Measurement range  - Input resistance  ► Current inputs (reference to AGND)  - Input current  - Input resistance  ► Supply voltage  ► Maximum supply current  - Supply voltage  ► Maximum supply current  - Input resistance  ► Supply voltage  ► Maximum supply current  - 24 V  - 5 V	▶ Countity         V           ▶ High level         V           ▶ Maximum current consumption at high level         mA           ▶ Quantity         V           ▶ Low level         V           ▶ High level         V           ▶ Current carrying capacity         A           ▶ Inductive load admissible         V           ▶ Number 70         Voltage inputs (differential inputs)           - Measurement range         V           - Input resistance         kΩ           ▶ Current inputs (reference to AGND)         mA           - Input current         mA           - Input resistance         kΩ           ▶ Voltage outputs         V           - Output range         MA           - Maximum load impedance         kΩ           ▶ Current outputs         MA           - Maximum load         Ω           ▶ Supply voltage         V           ▶ Maximum supply current         mA           ▶ Voltage inputs         MA           - Input resistance         kΩ           ▶ Current inputs (reference to AGND)         MA           - Input resistance         N           ▶ Supply voltage         V           ▶ Maximum supply cu

<sup>7)</sup> Current and voltage input parameterizable

# Representation of the axis controller in the system network

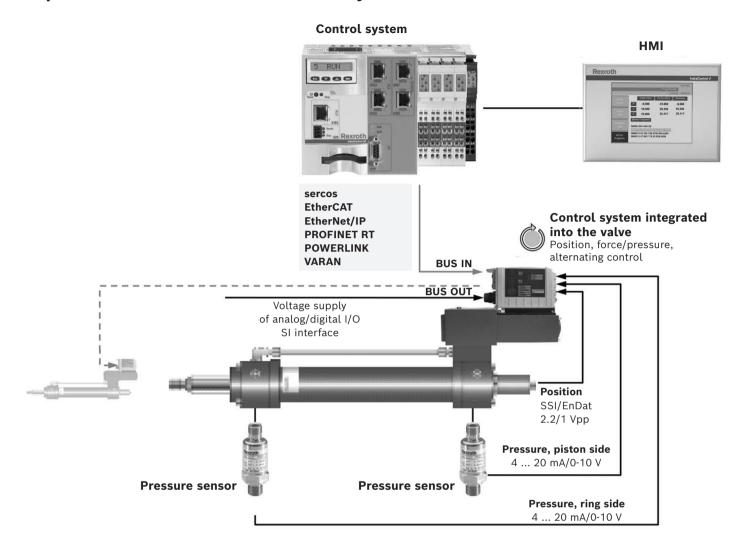


# Block diagram/controller function block X8M Position sensor digital X2M2 Pressure sensor 2 X2M1 Pressure sensor 1 0 0: P→A, safely switched off (safe deactivation with simultaneous use of enable acknowledgment) Output stage Actuating adaptation Valve controller variable × evaluation Position Alternating control ×° × controller Position controller Force F<sub>p,S</sub> F<sub>p,I</sub> × × 1: $P \rightarrow A$ , safely switched off **Bus interface** Actual value processing 0: Valve active 1: Valve active Command generator 유 Protective grounding conductor 'PE 2 $\infty$ ၈ 9 XH2 X7E2 XH2 X7E1 Connection, optional Enable acknowledgment Input 1 (configurable) Output (configurable) POWERLINK, VARAN Input 2 (configurable) Reference for inputs Sercos, EtherCAT, PROFINET RT, EtherNet/IP, Enable input 24 V supply not used not used Routing GND

# **Electrical connections, assignment**

# Connector pin assignment XH2, 11-pole + PE according to EN 175201-804


	Core m	narking	
Pin	Cable, one-part 1)	Cable, split <sup>2)</sup>	Interface D6 assignment
1	1	1	24 V DC supply voltage
2	2	2	GND
3	3	white	Enable input 24 VDC (high ≥ 15 V; low < 2 V)
4	4	yellow	Command values 1 (4 20 mA/±10 V) <sup>3)</sup>
5	5	green	Reference for command values
6	6	violet	Actual value (4 20 mA/±10 V) <sup>3; 4)</sup>
7	7	pink	Command value 2(4 20 mA/±10 V) <sup>3)</sup>
8	8	red	Enable acknowledgment 24 VDC (I <sub>max</sub> 50 mA) <sup>5)</sup>
9	9	brown	not used
10	10	black	not used
11	11	blue	Switching output 24 V, configurable (fault-free operation (24 V)/error (0V) or power circuit signal), maximum 1.5 A $^{3;5)}$
PE	green-yellow	green-yellow	Functional ground (connected directly to metal housing)

- Core marking of the connection lines for mating connector with cable set (see accessories, page 22, material numbers R901268000, R901272854, R901272852)
- <sup>2)</sup> Core marking of the connection lines for mating connector with cable set (see accessories, page 22, material numbers R900884671, R900032356, R900860399)
- 3) Selection via commissioning software
- <sup>4)</sup> For diagnostic purposes, precise actual value response via Ethernet interface
- 5) A load increases the current consumption on pin 1



# Connector pin assignment for Ethernet interface "X7E1" and "X7E2" (coding D), M12, 4-pole, socket


Pin	Assignment
1	TxD +
2	RxD +
3	TxD -
4	RxD -
5	not used



# Analog configurable sensor interfaces, connections "X2M1", "X2M2" (coding A), M12, 5-pole, socket

Pin	Assignment
1	+24 V voltage output (sensor supply) 1; 2)
2	Sensor signal input current (4 20 mA) <sup>3)</sup>
3	GND
4	Sensor signal input voltage (0 10 V) <sup>3)</sup>
5	Negative differential amplifier input to pin 4 (optional)


- Voltage output same as voltage supply connected to input XH2. (Maximum load capacity see page 13)
- 2) A load increases the current consumption of the valve (pin 1 on the connector XH2)
- 3) Only one signal input per interface, configurable



# **Electrical connections, assignment**

# Digital sensor interface SSI, EnDat 2.2 or 1Vpp measurement system "X8M", M12, 8-pole, socket

Pin	SSI pin assignment 1)	EnDat 2.2 pin assignment 1; 2)	1Vpp pin assignment
1	GND	GND	GND
2	+24 V <sup>3)</sup>	+5 V <sup>3)</sup>	+5 V <sup>3)</sup>
3	Data +	Data +	A +
4	Data –	Data –	A -
5	GND	GND	B +
6	Clock -	Clock –	B -
7	Clock +	Clock +	R +
8	+24 V <sup>3)</sup>	+5 V <sup>3)</sup>	R -




- $^{1)}$  Pins 2, 8 and 1, 5 have the same assignment each
- 2) Supported resolution ≥ 10 nm
- 3) A load increases the current consumption of the valve (pin 1 on the connector XH2)

# M Notice:

- ▶ Reference potential for all signals: GND
- We recommend connecting the shields on both sides via the metal housings of the plug-in connectors.
   Using connector pins will affect the shielding effect!
   Internal screens are not required.

# **LED displays**

LED	Interface	Sercos	EtherNET/IP	EtherCAT	PROFINET RT	POWERLINK	VARAN
1		Activity	Activity	not used	Activity	not used	Active
2	X7E1	Link	Link	Link/activity	Link	Link/data activity	Link
3	Electronics	S	Network status	Network status	Network status	Status/error	Network status
4	module	Module status	Module status	Module status	Module status	Module status	Module status
5		Activity	Activity	not used	Activity	not used	not used
6	X7E2	Link	Link	Link/activity	Link	Link/data activity	not used

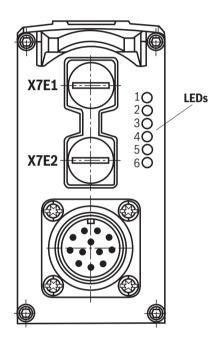

# Displays of the status LEDs

Module status LED (LED 4)	Display status
Off	No voltage supply
Green-red, flashing	Initialization
Green, flashing	Drive ready for operation
Green	Drive active
Orange, flashing	Warning
Red, flashing	Error
Network status LED (LED 3)	Display status
Off	No voltage supply
Green	Operation
·	
Activity LED (LED 1 and 5)	Display status
Flashing	Data sent/received
Link LED and Activity LED (LED 2 and 6)	Display status
Permanently lit	Cable plugged in, connection established




- ▶ LEDs 1, 2, 5 and 6 relate to interfaces "X7E1" and "X7E2"
- ▶ Module status LEDs 3 and 4 relate to the electronics module
- ▶ For a detailed description of the diagnosis LEDs, please refer to the functional description "Rexroth HydraulicDrive HDx".
- ▶ Function is only available after start-up of the electronics.

# Characteristic curves: Size 6 - Flow characteristic (measured with HLP46, $\vartheta_{oil}$ = 40 ±5 °C)

# Flow/signal function






1 q<sub>VA</sub>: q<sub>VB</sub> = 1:1 **2**  $q_{VA}$ :  $q_{VB}$  = 2:1


← Command value in % →

# Inflected characteristic curve "P", inflection at 60%

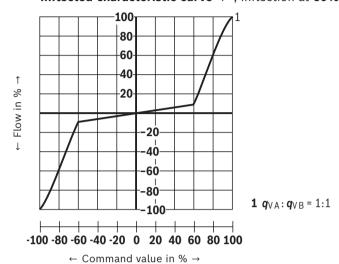

Inflected characteristic curve "P", inflection at 40%

 $p = 100 \text{ bar} \to 10 \text{ ms}$ 



1 qvA: qvB = 1:1 **2**  $q_{VA}: q_{VB} = 2:1$ 

← Command value in % →


	Fail-safe posit	ion		
A B G G b		Leakage flow at 100 bar	P→A P→B	50 cm³/min 70 cm³/min
		Flow at <b>Ap</b> = 35 bar	A→T B→T	10 20 l/min 7 20 l/min
A B G S b		Lackage flaw at 100 hav	P→A P→B	50 cm³/min 70 cm³/min
		Leakage flow at 100 bar	A→T B→T	70 cm³/min 50 cm³/min
p o bai · i iiis		Enable "off" or internal shut-of		
Fail-safe	1001	$U_{\rm B} \le 18 \text{ V or } I \le 2 \text{ mA (with 4)}.$	20 mA signal, c	able break detection:

current threshold configurable)


# **Characteristic curves:** Size 6

(measured with HLP46, 9<sub>oil</sub> = 40 ±5 °C)


# Pressure/signal characteristic curve

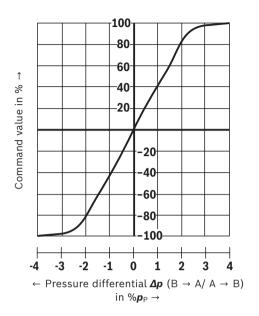

# Transition function with stepped electric input signals

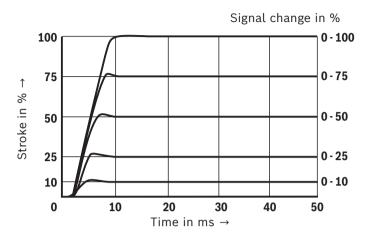


## Frequency response

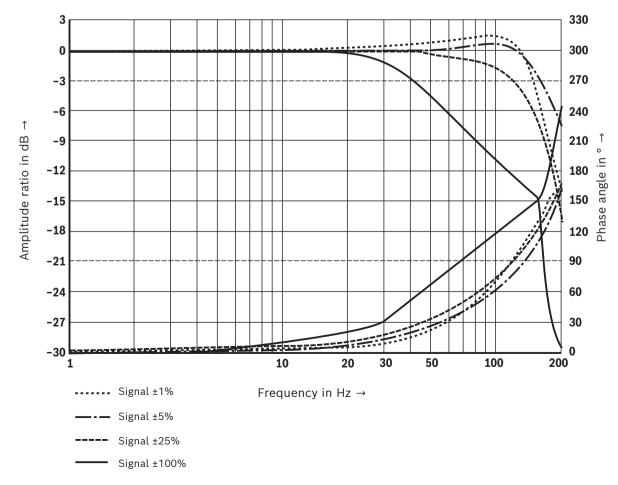

# **Characteristic curves:** Size 10 – Flow characteristic (measured with HLP46, $\theta_{oil}$ = 40 ±5 °C)

# Flow/signal function




-100 -80 -60 -40 -20 0 20 40 60 80 100


← Command value in % →

#### Inflected characteristic curve

"P", inflection at 40% (1:1)




# Linear characteristic curve "L" (2:1)



← Command value in % →

# Inflected characteristic curve

"P", inflection at 40% (2:1)



Fail-safe position

P|T| |  $p = 0 \text{ bar} \rightarrow 12 \text{ ms}$ Fail-safe  $p = 100 \text{ bar} \rightarrow 16 \text{ ms}$ 

Enable "off" or internal shut-off if an error has occurred  $U_B \le 18$  V or  $I \le 2$  mA (with 4 ... 20 mA signal, cable break detection: current threshold configurable)


 $A \rightarrow T$ 

70 cm<sup>3</sup>/min 50 cm<sup>3</sup>/min


# Characteristic curves: Size 10

(measured with HLP46,  $\vartheta_{oil}$  = 40 ±5 °C)


# Pressure/signal characteristic curve

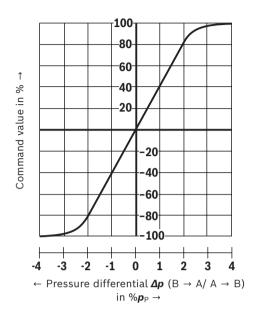


# Transition function with stepped electric input signals

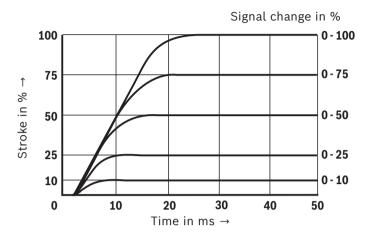

# Frequency response

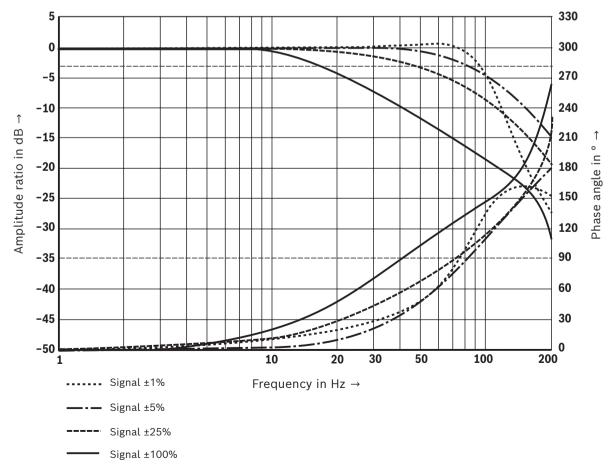

# **Dimensions:** Size 6 (dimensions in mm)

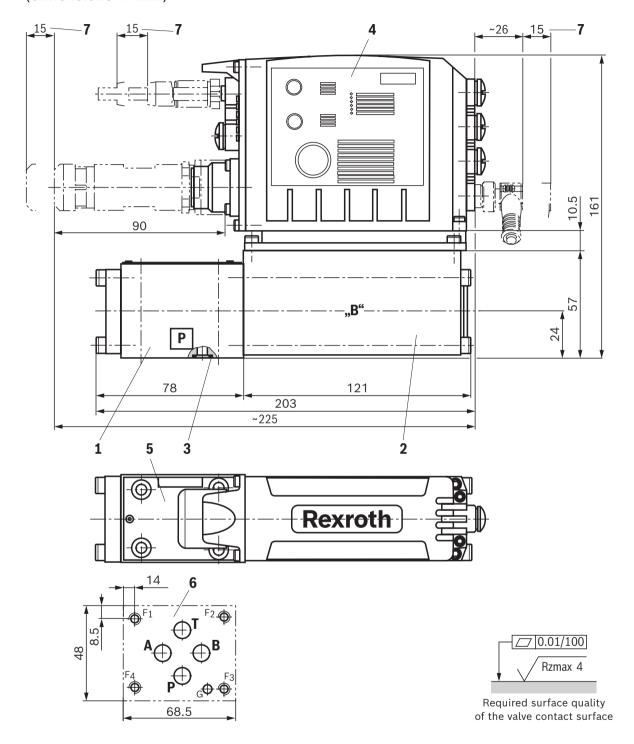


- 1 Valve housing
- 2 Control solenoid with position transducer
- 3 Identical seal rings for ports A, B, P, T
- 4 Integrated digital control electronics
- 5 Name plate
- **6** Machined valve contact surface, porting pattern according to ISO 4401-03-02-0-05
- 7 Space required to remove the mating connectors

# Motice:

The dimensions are nominal dimensions which are subject to tolerances.

Valve mounting screws see page 21.

# **Dimensions:** Size 10 (dimensions in mm)

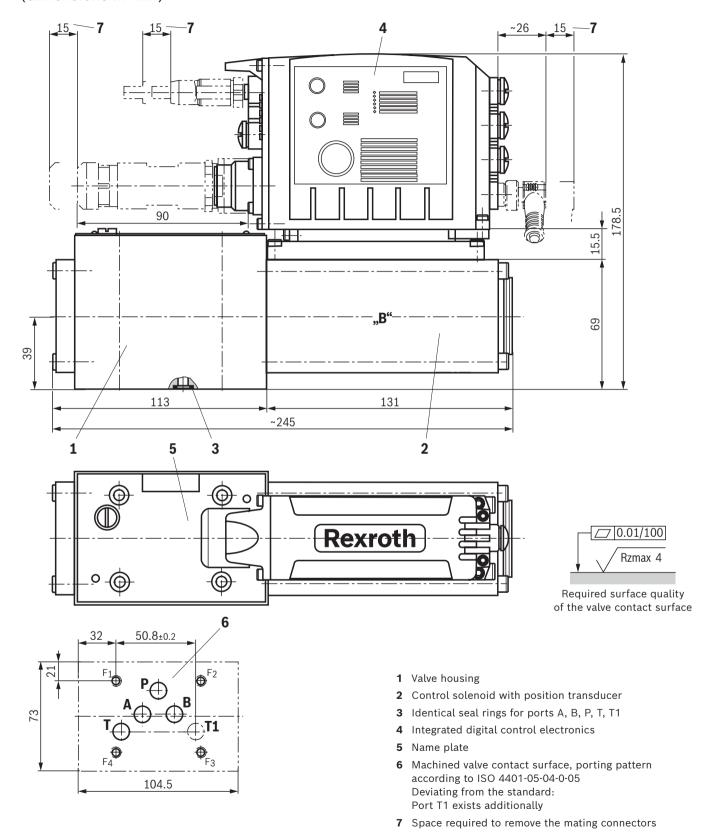

# Motice:

The dimensions are nominal dimensions which are subject to tolerances.

Valve mounting screws see page 21.

# **Dimensions**

# Valve mounting screws (separate order)

Size	Hexagon socket head cap screws	Material number
6	4 hexagon socket head cap screws ISO 4762 - M5 x 30 - 10.9-N67F 821 70 (galvanized according to Bosch standard N67F821 70) Tightening torque $M_A = 6^{+2}$ Nm	2910151166
10	4 hexagon socket head cap screws ISO 4762 - M6 x 40 - 10.9-N67F 821 70 (galvanized according to Bosch standard N67F821 70) Tightening torque M <sub>A</sub> = 11 <sup>+3</sup> Nm	2910151209

# Motice:

The tightening torque of the hexagon socket head cap screws refers to the maximum operating pressure.

# **Accessories** (separate order)

## Mating connectors and cable sets

Port	Designation	Version	Short designation	Material number	Data sheet
XH2	Mating connector;	Metal, shielded	12PN11 EMC	R901268000	08006
	for valves with round connector, 11-pole + PE	Plastic, two cable outlets	12PN112XD8	R900884671	
	Cable sets;	Metal, shielded, 5 m	12PN11REFS	R901272854	
	for valves with round connector, 11-pole + PE	Metal, shielded, 20 m	EMVBG	R901272852	
	connector, 11-pote + FE	Plastic, shielded, 5 m	12PN11REFF	R900032356	
		Plastic, shielded, 20 m	2X	R900860399	
X7E1, X7E2	Cable set; shielded, 4-pole, D coding	Straight connector M12, on straight connector M12, line cross-section 0.25 mm², CAT 5e, length freely selectable (= xx.x)	-	R911172111 <sup>1)</sup>	_
	Cable set; shielded, 4-pole	Straight connector M12, on straight connector RJ45, line cross-section 0.25 mm², CAT 5e, length freely selectable (= xx.x)	-	R911172135 <sup>2)</sup>	_
X2M1, X2M2	Cable set; shielded, 5-pole, for connecting Rexroth pressure sensors, type HM20, A coding	PUR/PVC, straight connector M12, on straight socket M12, line cross-section 0.34 mm <sup>2</sup> , 0.6 m	_	R901111709	_
		PUR/PVC, straight connector M12, on straight socket M12, line cross-section 0.34 mm <sup>2</sup> , 1.0 m	_	R901111712	_
		PUR/PVC, straight connector M12, on straight socket M12, line cross-section 0.34 mm <sup>2</sup> , 2.0 m	_	R901111713	_
	Cable set; shielded, 5-pole, A coding	Straight connector M12, on free line end, line cross-section 0.34 mm², 1.5 m	-	R901111752	_
		Straight connector M12, on free line end, line cross-section 0.34 mm², 3.0 m	_	R901111754	_
		Straight connector M12, on free line end, line cross-section 0.34 mm², 5.0 m	_	R901111756	_
		Straight connector M12, on free line end, line cross-section 0.34 mm², 10.0 m	_	R913005147	_
	Plug-in connector; 5-pole, M12 x 1, pins, A coding	Metal (cable diameter 4 6 mm2)	-	R901075542	-
X8M	Cable set; Shielded, 8-pole, A coding (only SSI, 1Vss) 3)	Straight connector M12, on free line end, line cross-section 0.25 mm², 10 m	-	R913002641	_

<sup>1)</sup> Additional indication of type designation RKB0040/xx.x

# Notice:

- ► Tighten the M12 connector with a manual torque wrench by 1 Nm.
- ► Self-locking M12 cables must be used.
- ▶ It must be ensured that cables are secured without radial forces.
- ▶ All cables connected to XH2, X7E1 and X7E2 must be bundled in a wire harness after 20 cm at the latest. The wire harness must be fixed after further 20 ... 30 cm. Make sure that there is no relative motion between the fixation and the valve.
- ▶ Before the fixation point, there must not be any cable loops.
- ▶ In general, the information on installation provided by the cable manufacturers must be observed.
- ► Respectively, the cables of X2M1, X2M2 and X8M, if used, are also fixed as described above.
- ► For further information, see operating instructions 29391-B

<sup>2)</sup> Additional indication of type designation RKB0044/xx.x

<sup>3)</sup> Recommendation: If an EnDat 2.2 sensor is used, please refer to the sensor manufacturer Heidenhain with respect to a cable set.

# Accessories (separate order)

## **Protective cap**

Protective cap M12	Version	Material number
		R901075563

## **Parameterization**

The following is required for the p	Material number/download	
Commissioning software IndraWorks, Indraworks D, Indraworks DS		www.boschrexroth.com/IAC
Connection cable, 3 m	Shielded, M12 on RJ45, length can be freely selected (= xx.x)	R911172135 (additional indication of type designation RKB0044/xx.x)

# **Project planning and maintenance instructions**

- ► The supply voltage must be permanently connected; otherwise, bus communication is not possible.
- ► If electro-magnetic interference is to be expected, take appropriate measures for ensuring the function (depending on the application, e.g. shielding, filtration).
- ► The devices have been tested in the plant and are supplied with default settings.
- ▶ Only complete devices can be repaired. Repaired devices are returned with default settings. User-specific settings will not be applied. The machine end-user will have to retransfer the corresponding user parameters.

► Assembly, commissioning and maintenance of hydraulic systems

► Commissioning software and documentation on the Internet

► Information on available spare parts

# **Further information**

<ul> <li>Directional control valve with integrated digital axis controller</li> <li>Operation IAC-Multi-Ethernet electronics (xx = software version):         <ul> <li>Functional description Rexroth HydraulicDrive HDx-xx</li> <li>Parameter description Rexroth HydraulicDrive HDx-xx</li> <li>Description of diagnosis Rexroth HydraulicDrive HDx-xx</li> </ul> </li> </ul>	Operating instructions 29391-B
► Subplates	Data sheet 45100
► Hydraulic fluids on mineral oil basis	Data sheet 90220
► Environmentally compatible hydraulic fluids	Data sheet 90221
► Flame-resistant, water-free hydraulic fluids	Data sheet 90222
► Hydraulic valves for industrial applications	Operating instructions 07600-B
<ul> <li>Directional control valves, direct operated, with electrical position feedback and integrated electronics (OBE)</li> </ul>	Data sheet 29035 and 29037
<ul> <li>Directional control valve with integrated digital axis controller (IAC-R) and field bus interface</li> </ul>	Data sheet 29191
<ul> <li>Directional control valve with integrated digital axis controller (IAC-R) and clock-synchronized PROFIBUS DP/V2 (PROFIdrive profile)</li> </ul>	Data sheet 29291
► CE Declaration of Conformity	upon request
<ul> <li>General product information on hydraulic products</li> </ul>	Data sheet 07008
Installation, commissioning and maintenance of servo valves and high-response valves	Data sheet 07700

Data sheet 07900